



An Equal
Opportunity
Employer

Southwest Florida Water Management District

Bartow Office
170 Century Boulevard
Bartow, Florida 33830-7700
(863) 534-1448 or
1-800-492-7862 (FL only)

Sarasota Office
78 Sarasota Center Boulevard
Sarasota, Florida 34240-9770
(941) 377-3722 or
1-800-320-3503 (FL only)

Tampa Office
7601 U.S. 301 North (Fort King Highway)
Tampa, Florida 33637-6759
(813) 985-7481 or
1-800-836-0797 (FL only)

2379 Broad Street, Brooksville, Florida 34604-6899
(352) 796-7211 or 1-800-423-1476 (FL only)

WaterMatters.org

July 22, 2025

Tampa Bay Water
Attn: Cathleen Beaudoin Jonas
2575 Enterprise Road
Clearwater, FL 33763

Subject: Notice of Final Agency Action – Approval
Water Use Permit No.: 20 011794.003
Project Name: Alafia River Withdrawal Facility
County: Hillsborough

Dear Sir/Madam:

The Southwest Florida Water Management District (District) is in receipt of your application for Water Use Permit No. 20 011794.003. Based upon a review of the information you submitted, the application was approved by the District's Governing Board. A copy of the permit is enclosed for your records. Please refer to the attached Notice of Rights to determine any legal rights you may have concerning the District's agency action on the permit application described in this letter.

The District's action in this matter only becomes closed to future legal challenges from members of the public if such persons have been properly notified of the District's action and no person objects to the District's action within the prescribed period of time following the notification. The District does not publish notices of agency action. If you wish to limit the time within which a person who does not receive actual written notice from the District may request an administrative hearing regarding this action, you are strongly encouraged to publish, at your own expense, a notice of agency action in the legal advertisement section of a newspaper of general circulation in the county or counties where the activity will occur. Publishing notice of agency action will close the window for filing a petition for hearing. Legal requirements and instructions for publishing notices of agency action, as well as a noticing form that can be used, are available from the District's website at www.WaterMatters.org/permits/noticing. If you publish notice of agency action, a copy of the affidavit of publication provided by the newspaper should be sent to the District's Tampa Service Office for retention in this permit's File of Record.

Please be advised that the Governing Board has formulated a water shortage plan referenced in a Standard Water Use Permit Condition (Exhibit A) of your permit, and will implement such a plan during periods of water shortage. You will be notified during a declared water shortage of any change in the conditions of your Permit or any suspension of your Permit, or of any restriction on your use of water for the duration of any declared water shortage. Please further note that water conservation is a condition of your Permit and should be practiced at all times.

The ID tags for your withdrawals shall be installed by a District representative. This representative will attempt to contact you within 30 days to discuss placement of your tags. If you have any questions or concerns regarding your tags, please contact Joseph Hagin at 813-278-7784 in the Tampa Service Office. If you have any questions or concerns regarding your permit or any other information, please contact the Water Use Permit Bureau in the Tampa Service Office.

Sincerely,

April Breton Electronically Signed

April Breton
Bureau Chief
Water Use Permit Bureau
Regulation Division

Encl: Permit
Notice of Rights

cc: Cathleen Beaudoin Jonas

**SOUTHWEST FLORIDA WATER MANAGEMENT DISTRICT
WATER USE PERMIT
Individual PERMIT
NO. 20 011794.003**

PERMIT ISSUE DATE: July 22, 2025 **EXPIRATION DATE:** May [SW Board Mtg Date]__, 2040

The Permittee is responsible for submitting an application to renew this permit no sooner than one year prior to the expiration date, and no later than the end of the last business day before the expiration date, whether or not the Permittee receives prior notification by mail. Failure to submit a renewal application prior to the expiration date and continuing to withdraw water after the expiration date is a violation of Chapter 373, Florida Statutes, and Chapter 40D-2, Florida Administrative Code, and may result in a monetary penalty and/or loss of the right to use the water. Issuance of a renewal of this permit is contingent upon District approval.

TYPE OF APPLICATION: Modification
GRANTED TO: Tampa Bay Water/Attn: Cathleen Beaudoin Jonas
2575 Enterprise Road
Clearwater, FL 33763
Tampa Bay Water Alafia River Project

PROJECT NAME:
WATER USE CAUTION AREA(S): SOUTHERN WATER USE CAUTION AREA

COUNTY: Hillsborough


TOTAL QUANTITIES AUTHORIZED UNDER THIS PERMIT (in gallons per day)	
ANNUAL AVERAGE	32,200,000 gpd *
MAXIMUM	75,000,000 gpd
ANNUAL AVERAGE	32,200,000 gpd *

* The actual quantities authorized under the permit are based on the flows in the Alafia River as described in Special Condition No. 9. The annual average quantity shown above is a projection based on Historical Flows.

ABSTRACT:

This is a modification of an existing water use permit for public supply and authorizes a maximum daily withdrawal of 75 mgd of water from the Alafia River. Actual withdrawals are not limited by the Annual Average quantity and instead will be based on withdrawals in accord with permit conditions including the percentage withdrawal schedule provided below, which is increased from the previous revision of 10% to 19% of the available flow above the Minimum Flow threshold. Tampa Bay Water is a regional utility that relies on multiple sources to meet demand, including the Alafia River Withdrawal Facility which has been developed for conjunctive use to meet regional demand, optimize wellfield withdrawals, and relieve associated environmental stresses. There is no change in Use Type from the previous revision. The Annual Average quantity is an estimate only of the long-term average yield. The Maximum Daily quantity represents maximum system pumping capacity.

TBW ALAFIA RIVER DIVERSION SCHEDULE	
Permitted daily withdrawal	When baseline flow for previous day is:
No withdrawals	≤128 cfs (82.7 mgd)
All flow above 128 cfs (82.7 mgd)	>128 cfs (82.7 mgd) and ≤ 158 cfs (102.1 mgd)
19% of Flow, up to 116.1 cfs (75 mgd)	>158 cfs (102.1 mgd)
Permitted daily withdrawal	When baseline flow for previous day is:



Special Conditions include those that require the Permittee to submit the Annual Surface Water Withdrawal Report by July 1 of each year, monthly reporting of withdrawals, continued monitoring of river stage, streamflow and spring discharge. Report compliance with the Minimum Flow for the Alafia River, daily calculations of Baseline Flow and permitted withdrawal rates, and continued implementation of the Hydrobiological Monitoring Plan, with annual data and periodic interpretive reports also due by July 1 of each year.

USE TYPE

Regional Public
Supply System




WITHDRAWAL POINT QUANTITY TABLE

Water use from these withdrawal points are restricted to the quantities given below
:




I.D. NO.	DEPTH		USE DESCRIPTION	AVERAGE	PEAK	MONTH	MAXIMUM
PERMITTEE/	DIAM	TTL./CSD.FT.		(gpd)			(gpd)
<u>DISTRICT</u>	<u>(in.)</u>	<u>(feet bls)</u>	<u>USE DESCRIPTION</u>	<u>(gpd)</u>		<u>(gpd)</u>	
1 / 1	120	N/A / N/A	Public Supply	Per Special Cond. 9		Per Special Cond. 9	75,000,000

WITHDRAWAL POINT LOCATION TABLE




<u>DISTRICT I.D. NO.</u>	<u>LATITUDE/LONGITUDE</u>
1	27° 51' 25.74"/82° 16' 07.22"

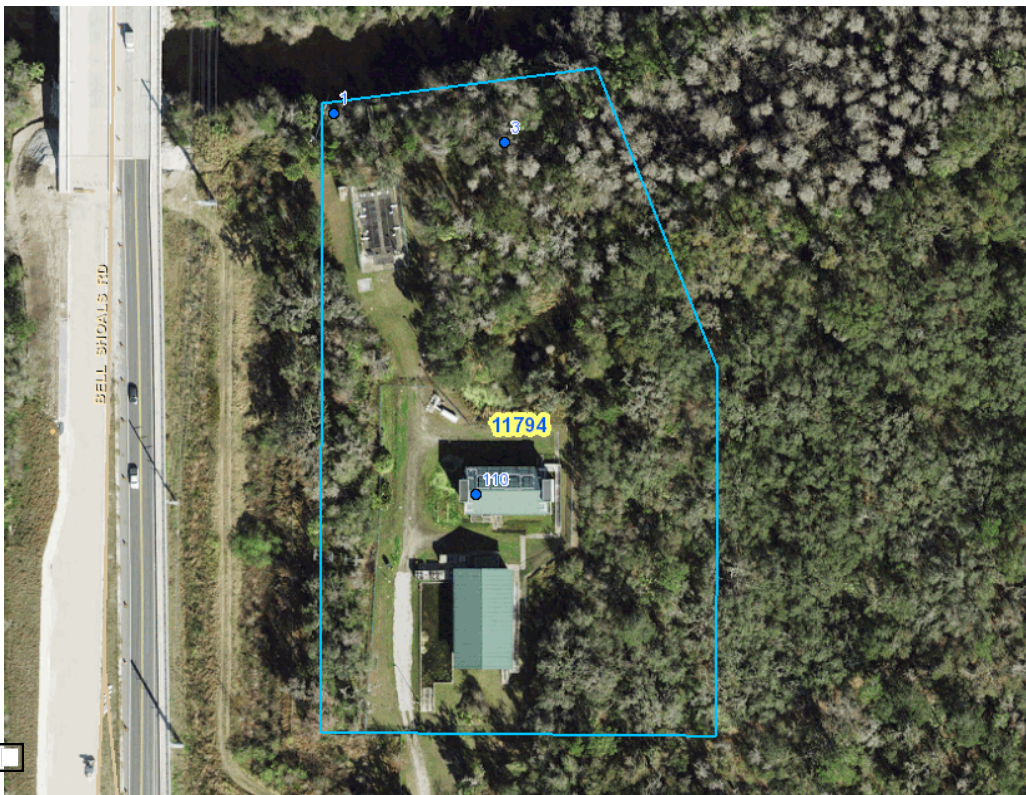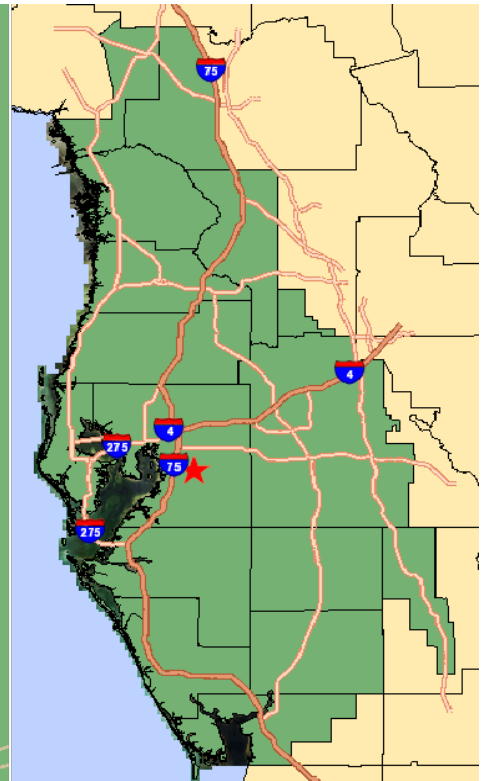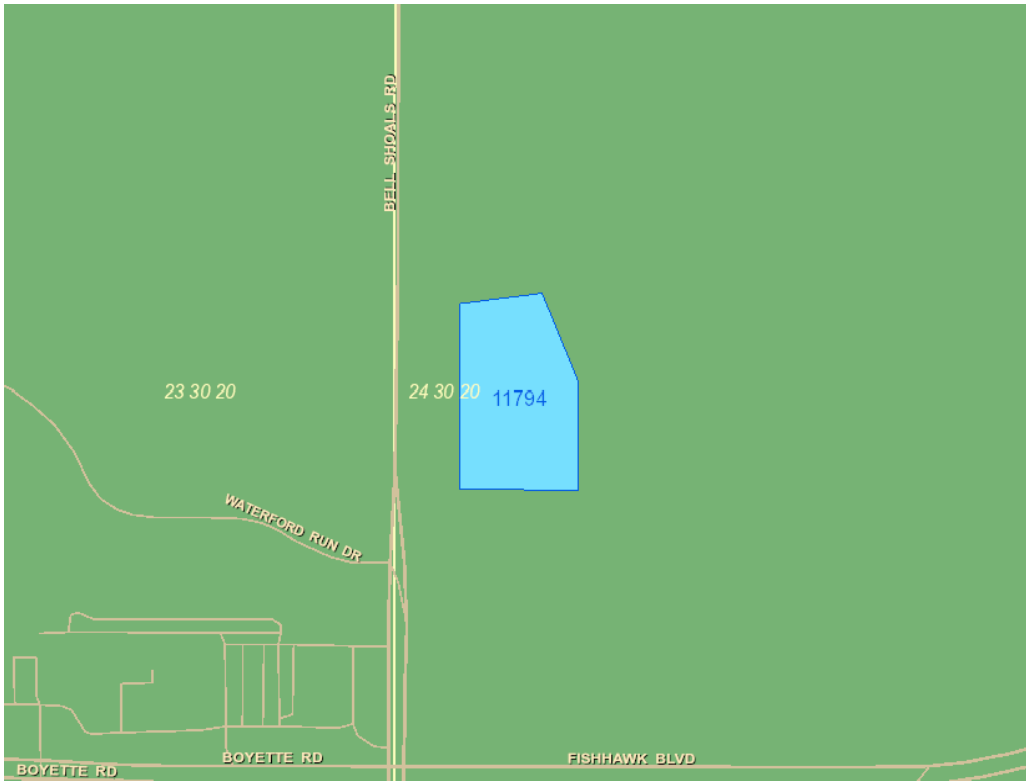


Location Map
Tampa Bay Water/Attn: Cathleen Beaudoin Jonas
WUP No. 20 011794.003



Legend

-  DIDs
-  WUP Boundary
-  Natural Color Imagery

HILLSBOROUGH COUNTY



*Southwest Florida
Water Management District*



[] [] []

STANDARD CONDITIONS:

The Permittee shall comply with the Standard Conditions attached hereto, incorporated herein by reference as Exhibit A and made a part hereof.

SPECIAL CONDITIONS:

1. All reports and data required by condition(s) of the permit shall be submitted to the District according to the due date(s) contained in the specific condition. If the condition specifies that a District-supplied form is to be used, the Permittee should use that form in order for their submission to be acknowledged in a timely manner. The only alternative to this requirement is to use the District Permit Information Center (www.swfwmd.state.fl.us/permits/epermitting/) to submit data, plans or reports online. There are instructions at the District website on how to register to set up an account to do so. If the report or data is received on or before the tenth day of the month following data collection, it shall be deemed as a timely submittal.

All mailed reports and data are to be sent to:

Southwest Florida Water Management District
Tampa Service Office, Water Use Permit
Bureau 7601 U.S. Hwy. 301 North
Tampa, Florida 33637-6759

Submission of plans and reports: Unless submitted online or otherwise indicated in the special condition, the original and two copies of each plan and report, such as conservation plans, environmental analyses, aquifer test results, per capita annual reports, etc. are required.

Submission of data: Unless otherwise indicated in the special condition, an original (no copies) is required for data submittals such as crop report forms, meter readings and/or pumpage, rainfall, water level, evapotranspiration, or water quality data.

(499)

2. The Annual Average Daily quantity for District ID No. 1, Permittee ID No. 1, shown in the Withdrawal Point Quantity Table, is an estimate only of the long-term average yield, and is not intended to restrict the withdrawal quantities authorized from the Alafia River. The quantities withdrawn from the Alafia River are limited by Special Conditions in this Permit and the Maximum Daily quantity of 75 MGD.(221)
3. The Permittee shall investigate complaints related to withdrawals. This condition shall be an ongoing effort for the duration of this permit. All complainants will make an application to the Permittee and must receive an investigation report, including any action to be taken within a reasonable time by the Permittee. The Permittee shall file a report of the complaint, the findings of facts, and any mitigation action taken or to be taken by the Permittee, to the Water Use Bureau Chief for review and approval within 90 days of the receipt of any complaint. The report shall include:
 - a. The name and address of each complainant;
 - b. The date and nature of the complaint;
 - c. A summary of the Permittee's investigation;
 - d. A summary of the Permittee's determination, including details of any mitigation activities; and
 - e. Cost of mitigation activity for each complaint.

Full mitigation shall not exceed 180 days from complaint receipt, unless additional time is granted by the District. A summary of the investigations of complaint and mitigation activities related to the Alafia River Withdrawal Facility for the annual reporting period shall be provided in the Annual Report.(448)

4. The Permittee shall submit a concise individual annual report ("Alafia River Surface Water Withdrawal Annual Report") to the District which compiles the data collected during the course of the year, by Special Condition of this permit and as part of the HBMP, and provides an assessment of the water resources and environmental systems in the area of the Alafia River. The Surface Water Withdrawal

[Redacted]

[Redacted]

[Redacted]

Annual Report shall concisely summarize the elements listed below, and any other elements within this

permit which require annual environmental reporting, with emphasis on the interactions between these elements, where appropriate. Three hard copies of each Surface Water Withdrawal Annual Report, plus one copy in electronic format, shall be submitted to the Water Use Bureau Chief by July 1 of each year. The report shall cover the preceding water year from October 1 to September 30.

1. Hydrologic Data and Water Production Summary. Flow metering, stage, streamflow and spring discharge monitoring data collected as part of this permit shall be summarized. This section shall also include a summary of activities conducted to maintain accuracy of flow metering, and discussion as to how this facility is operated in compliance with the Tampa Bay Water Optimized Regional Operations Plan.

2. Environmental Conditions and HBMP Implementation. Data collected as part of the HBMP shall be summarized and analyzed by the Permittee to document any effects of surface water withdrawals on the Alafia River and its estuary. Each annual report will contain a HBMP data report of all raw data collected during the past year. A brief summary of any recommended changes to the monitoring requirements shall also be included. More comprehensive analyses for the HBMP shall be included in the HBMP Interpretive reports which shall be submitted every five years.

3. Investigation of Complaints. A summary of the investigations of all complaints concerning adverse impacts to existing legal users, land uses and environmental features, as well as all of the Permittee's efforts to mitigate such adverse impacts, shall be provided for each reporting period.
(524)

5. This Permit is located within the Southern Water Use Caution Area (SWUCA). Pursuant to Section 373.0421, Florida Statutes, the SWUCA is subject to a minimum flows and levels recovery strategy, which became effective on January 1, 2007. The Governing Board may amend the recovery strategy, including amending applicable water use permitting rules based on an annual assessment of water resource criteria, cumulative water withdrawal impacts, and on a recurring five-year evaluation of the status of the recovery strategy up to the year 2025 as described in Chapter 40D-80, Florida Administrative Code. This Permit is subject to modification to comply with new rules.(652)

6. A. Flow Metering

Flow data recorded at the Alafia River intake structure pipeline shall represent the total surface water source pumpage for the Alafia River Withdrawal Facility. For flow monitoring points equipped with SCADA, the Permittee shall maintain the following for each flow monitoring point: one venturi-type flow meter or other approved flow meter, one non-resettable totalizing recording device at each monitoring point, and one remote transmitter unit that transfers the recorded flow data by telemetry to the remote SCADA master station. The SCADA master station flow data shall be recorded on a daily basis for each flow monitoring point and for the combined facility pumpage. For all SCADA-equipped monitoring points, the non-resettable totalizing recording device at each monitoring point shall be recorded on an annual basis, and reported in the Annual Report with a comparison to the SCADA-retrieved cumulative flow for each monitoring point. If and when any part of the facility becomes equipped with SCADA, the provisions of this paragraph shall apply.

The Permittee shall undertake regular and routine testing, calibration and preventive/corrective maintenance for all flow meters to ensure that they have and maintain an accuracy within 5 percent of actual flow as installed. Within 3 working days of identification of a meter that does not meet this standard, the Permittee shall inform the District in writing of the facts regarding the problem. Until the problem is corrected, flows through the metered point shall be estimated. The Permittee shall correct the problem within 15 days following identification of the problem, or discontinue use of the withdrawal until the problem is corrected, unless an extension is confirmed in writing from the Water Use Permit Bureau Chief. The Annual Report shall summarize activities conducted to maintain accuracy of flow metering.

B. Stage, Streamflow and Spring Discharge Monitoring

The Permittee shall monitor the average daily stage and estimated average daily flow for the Alafia River, and the average daily stage and spring discharge for Buckhorn and Lithia Springs at the sites and frequencies listed in Exhibit D. The sites listed in Exhibit D are currently monitored in accordance with the South Central Hillsborough Regional Wellfield (SCHRWF) and Brandon Urban Dispersed Wellfield (BUDWF) Water Use Permits (WUPs 4352 and 11732, respectively). The Permittee may utilize data obtained from the SCHRWF and BUDWF to satisfy the permit monitoring requirements for this condition. However, should monitoring at the sites listed in Exhibit D cease to be required under the SCHRWF and/or BUDWF WUPs, the Permittee shall be required to monitor the listed sites for this

permit, or establish new District-approved sites to replace the lost sites.

The sites listed in Exhibit D shall continue to be monitored and reported in accordance with the SCHRWF and BUDWF permits. Data from these sites shall not be reported for this permit as long as the data is submitted in support of the SCHRWF and BUDWF permits. For the purpose of this permit, data obtained from the listed sites during the annual reporting period shall be summarized in the Annual Report required by this permit. Any proposed changes to the recording frequency and locations shall be approved by the Water Use Permit Bureau Chief, and shall be summarized in the Annual Report as described in the applicable Special Condition.

(675)

7. The Permittee shall continue implementation of the Tampa Bypass Canal/Alafia River Water Supply Projects Hydrobiological Monitoring Plan 2010 Update (HBMP), dated February 2011 and as modified on 8/1/2012, which is incorporated herein as Exhibit C. Any proposed changes to the HBMP should be submitted in writing to the Water Use Permit Bureau Chief for review and approval.

The HBMP includes an annual Data report due by July 1 each year, and periodic Interpretive reports on a five-year cycle with the next due by July 1, 2026. Upon completion of each five-year cycle of the HBMP, a draft Interpretive report shall be submitted to the District as part of the overall annual Data report. The District shall review and provide written comments within 45 days of the submittal of each draft Interpretive report. Final Interpretive reports shall be submitted by the Permittee within 90 days of receipt of District comments.

The District will review the results of these reports to determine if the withdrawals have or are expected to result in unacceptable environmental impacts to the natural resources of the Alafia River and its estuary as addressed in Section 4 of the District's Basis of Review, Water Use Permit Information Manual, Part B. If unacceptable environmental impacts have or are expected to occur due to the withdrawals, then the District shall require a revision to the withdrawal schedule.(676)

8. The following withdrawal facilities shall continue to be maintained and operated with existing, non-resettable, totalizing flow meter(s) or other measuring device(s) as approved by the Water Use Permit Bureau Chief:

District ID No. 1, Permittee ID No. 1 (Alafia River Withdrawal Facility intake near Bell Shoals Road)
District ID No. 2, Permittee ID No. ALF-2 (Influent meter into the Regional Water Treatment Plant from all sources)

Meter reading and reporting, as well as meter accuracy checks every five years shall be in accordance with instructions in Exhibit B, Metering Instructions, attached to and made part of this permit.(719)

9. Surface water withdrawals at DID No.1 will be based on adjusted previous day's average flow of the Alafia River at the "Alafia River at Lithia" gage (USGS Gage 02301500) combined with weekly measured flows at Buckhorn Springs and Lithia Springs Major. This will be referred to as Baseline Flow and shall be determined on a daily basis using the following formula:

1. Average daily river flow as measured at the Lithia gage for the previous day shall be multiplied by a factor of 1.117, to account for additional watershed contributions between the gage and the Alafia River Withdrawal Facility intake.
2. The most recent springflow measured at Buckhorn Springs and Lithia Springs Major shall be added to the product in Step One.
3. The Annual Average Daily withdrawal of 5.06 MGD (approximately 8 cfs) permitted to upgradient existing legal user Mosaic (WUP 1532) shall be added to the sum in Step Two.
4. The resulting quantity is the Baseline Flow for purposes of determining Tampa Bay Water's permitted daily withdrawal.

Baseline Flow shall be calculated and recorded on a daily basis and reported to the Permit Data Section (using District approved forms) on or before the fifteenth (15th) day of the following month, as DID No. 110. The recordings shall include daily average water flow in million gallons per day (MGD), and daily average water flow in cubic feet per second (cfs).

The quantities withdrawn from the lower Alafia River by Tampa Bay Water are limited by the adopted Minimum Flow, delineated in Rule 40D-8.041(8), Florida Administrative Code, and the maximum diversion capacity, and are set forth as referenced below:

- a. No diversion from the Alafia River may occur when the calculated Baseline Flow for the previous day is 128 cfs (82.7 mgd) or less, representing the Low Flow Threshold of 120 cfs plus the Annual Average Daily withdrawal of 8 cfs permitted to Mosaic;
- b. For a calculated Baseline Flow between 128 cfs (82.7 mgd) and 158 cfs (102.1 mgd) for the previous day, the daily diversion is limited to the difference between the Baseline Flow and 128 cfs (82.7 mgd).
- c. For a calculated Baseline Flow of 158 cfs (102.1 mgd) or greater for the previous day, the daily diversion is limited to 19% of the Baseline Flow.
- d. The maximum diversion on any single day shall not exceed 75 MGD (116.1 cfs).

Potential Adjustment of Special Condition 9:

(i) Existing Legal User Status: After December 31, 2032, but before 2040, if the Polk Regional Water Cooperative (PRWC) submits a water use permit application to the District for the withdrawal of surface water from the North or South Prongs of the Alafia River for potable public water use solely for its members located in Polk County consistent with the Settlement and Coordination Agreement Between Polk Regional Water Cooperative, Tampa Bay Water, & Southwest Florida Water Management District (Settlement Agreement), Tampa Bay Waters's existing legal user status, as defined, in part, under condition 9.3. above, shall be limited to 14% of Baseline Flow, unless a different percentage is determined based on the Settlement Agreement for a prorata reduction.

(ii) Tampa Bay Water Alafia River Allocation Modification: After December 31, 2032, but before December 31, 2040, upon the request of PRWC, within thirty (30) days, Tampa Bay Water shall submit a letter to the District to modify its permit to limit its permitted withdrawal from the Lower Alafia River based on the following modified diversion schedule, to become effective upon actual commencement of the withdrawal of surface water for potable water use by the PRWC from the North or South Prongs of the Alafia River located in Polk County.

(iii) Modification or Deletion of Special Condition 9: Special Condition 9 may only be modified or deleted before the expiration date of this permit in 2040 if the PRWC accepts an Alternative Project as set forth in the Settlement Agreement, PRWC fails to determine an Alafia River project is feasible as set forth in the Settlement Agreement, or the parties to the Settlement and Coordination Agreement agree in writing otherwise.

1. No diversion from the Alafia River may occur when the calculated Baseline Flow for the previous day is 128 cfs (82.7 mgd) or less.
2. For a calculated Baseline Flow between 128 cfs (82.7 mgd) and 149 cfs (96.3 mgd) for the previous day, the daily diversion is limited to the difference between the Baseline Flow and 128 cfs (82.7 mgd).
3. For a calculated Baseline Flow of 149 cfs (96.3 mgd) or greater for the previous day, the daily diversion is limited to 14% of the Baseline Flow.
4. The maximum diversion on any single day shall not exceed 75 mgd (116.1 cfs). (990)
10. This permit and the facilities governed by the permit shall be operated in accordance with the Tampa Bay Water Optimized Regional Operations Plan, and all modifications thereof, as approved by the District.(991)
11. Total influent quantities delivered to the C.W. Bill Young Reservoir shall be calculated on a daily basis and reported to the District as District ID No. 4, Permittee ID No. RES INF by the fifteenth day of each month.(992)
12. The remedies for violation of this permit are cumulative. Thus, the pursuit of one remedy shall not preclude the pursuit of other remedies provided by this permit or by applicable law. The pursuit of any remedy provided in this permit or by applicable law shall not constitute a forfeiture or waiver of any other remedy. The waiver of one violation shall not be deemed a waiver of any other violation. Forbearance to enforce one or more of the remedies provided by this permit or by applicable law on

[redacted] an event of violation shall not be deemed or construed to constitute a waiver of the right to any remedy for that violation.(995) [redacted]

40D-2
Exhibit A

WATER USE PERMIT STANDARD CONDITIONS

1. With advance notice to the Permittee, District staff with proper identification shall have permission to enter, inspect, collect samples, take measurements, observe permitted and related facilities and collect and document any information deemed necessary to determine compliance with the approved plans, specifications and conditions of this permit. The Permittee shall either accompany District staff onto the property or make provision for access onto the property.
2. When necessary to analyze impacts to the water resource or existing users, the District shall require the Permittee to install flow metering or other measuring devices to record withdrawal quantities and submit the data to the District.
3. A District identification tag shall be prominently displayed at each withdrawal point that is required by the District to be metered or for which withdrawal quantities are required to be reported to the District, by permanently affixing the tag to the withdrawal facility.
4. The Permittee shall mitigate any adverse impact to environmental features or offsite land uses as a result of withdrawals. When adverse impacts occur or are imminent, the District shall require the Permittee to mitigate the impacts. Examples of adverse impacts include the following:
 - A. Significant reduction in levels or flows in water bodies such as lakes, impoundments, wetlands, springs, streams or other watercourses; or
 - B. Damage to crops and other vegetation causing financial harm to the owner; and
 - C. Damage to the habitat of endangered or threatened species.
5. The Permittee shall mitigate any adverse impact to existing legal uses caused by withdrawals. When adverse impacts occur or are imminent, the District may require the Permittee to mitigate the impacts. Adverse impacts include:
 - A. A reduction in water levels which impairs the ability of a well to produce water;
 - B. Significant reduction in levels or flows in water bodies such as lakes, impoundments, wetlands, springs, streams or other watercourses; or
 - C. Significant inducement of natural or manmade contaminants into a water supply or into a usable portion of an aquifer or water body.
6. Permittee shall notify the District in writing within 30 days of any sale, transfer, or conveyance of ownership or any other loss of permitted legal control of the Project and / or related facilities from which the permitted consumptive use is made. Where Permittee's control of the land subject to the permit was demonstrated through a lease, the Permittee must either submit documentation showing that it continues to have legal control or transfer control of the permitted system / project to the new landowner or new lessee. All transfers of ownership are subject to the requirements of Rule 40D-1.6105, F.A.C. Alternatively, the Permittee may surrender the consumptive use permit to the District, thereby relinquishing the right to conduct any activities under the permit.
7. All withdrawals authorized by this WUP shall be implemented as conditioned by this permit, including any documents submitted as part of the permit application incorporated by reference in a permit condition. This permit is subject to review and modification, enforcement action, or revocation, in whole or in part, pursuant to Section 373.136 or 373.243, F.S.
8. This permit does not convey to the Permittee any property rights or privileges other than those specified herein, nor relieve the Permittee from complying with any applicable local government, state, or federal law, rule, or ordinance.
9. The Permittee shall cease or reduce surface water withdrawal as directed by the District if water levels in lakes fall below the applicable minimum water level established in Chapter 40D-8, F.A.C., or rates of flow in streams fall below the minimum levels established in Chapter 40D-8, F.A.C.

- [] [] []
10. The Permittee shall cease or reduce withdrawal as directed by the District if water levels in aquifers fall below the minimum levels established by the Governing Board.
 11. A Permittee may seek modification of any term of an unexpired permit. The Permittee is advised that section 373.239, F.S., and Rule 40D-2.331, F.A.C., are applicable to permit modifications.
 12. The Permittee shall practice water conservation to increase the efficiency of transport, application, and use, as well as to decrease waste and to minimize runoff from the property. At such time as the Governing Board adopts specific conservation requirements for the Permittee's water use classification, this permit shall be subject to those requirements upon notice and after a reasonable period for compliance.
 13. The District may establish special regulations for Water-Use Caution Areas. At such time as the Governing Board adopts such provisions, this permit shall be subject to them upon notice and after a reasonable period for compliance.
 14. Nothing in this permit should be construed to limit the authority of the District to declare a water shortage and issue orders pursuant to chapter 373, F.S. In the event of a declared water shortage, the Permittee must adhere to the water shortage restrictions, as specified by the District. The Permittee is advised that during a water shortage, reports shall be submitted as required by District rule or order.
 15. This permit is issued based on information provided by the Permittee demonstrating that the use of water is reasonable and beneficial, consistent with the public interest, and will not interfere with any existing legal use of water. If, during the term of the permit, it is determined by the District that a statement in the application and in the supporting data are found to be untrue and inaccurate, the use is not reasonable and beneficial, in the public interest, or does impact an existing legal use of water, the Governing Board shall modify this permit or shall revoke this permit following notice and hearing, pursuant to sections 373.136 or 373.243, F.S. The Permittee shall immediately notify the District in writing of any previously submitted information that is later discovered to be inaccurate.
 16. Within the Southern Water Use Caution Area, if the District determines that significant water quantity or quality changes, impacts to existing legal uses, or adverse environmental impacts are occurring, the District, upon reasonable notice to the Permittee, including a statement of facts upon which the District based its determination, may reconsider the quantities permitted or other conditions of the permit as appropriate to address the change or impact, but only after an opportunity for the Permittee to resolve or mitigate the change or impact or to request a hearing.
 17. All permits are contingent upon continued ownership or legal control of all property on which pumps, wells, diversions or other water withdrawal facilities are located.

[] [] []

Exhibit B
Instruction
s

METERING INSTRUCTIONS

The Permittee shall meter withdrawals from surface waters and/or the ground water resources, and meter readings from each withdrawal facility shall be recorded on a monthly basis within the last week of the month. The meter reading(s) shall be reported to the Water Use Permit Bureau on or before the tenth day of the following month for monthly reporting frequencies.

For bi-annual reporting, the data shall be recorded on a monthly basis and reported on or before the tenth day of the month following the sixth month of recorded data.

The Permittee shall submit meter readings online using the Permit Information Center at www.swfwmd.state.fl.us/permits/epermitting/ or on District supplied scanning forms unless another arrangement for submission of this data has been approved by the District. Submission of such data by any other unauthorized form or mechanism may result in loss of data and subsequent delinquency notifications. Call the Water Use Permit Bureau in Tampa at (813) 985-7481 if difficulty is encountered.

The meters shall adhere to the following descriptions and shall be installed or maintained as follows:

1. The meter(s) shall be non-resettable, totalizing flow meter(s) that have a totalizer of sufficient magnitude to retain total gallon data for a minimum of the three highest consecutive months permitted quantities. If other measuring device(s) are proposed, prior to installation, approval shall be obtained in writing from the Water Use Permit Bureau Chief.
2. The Permittee shall report non-use on all metered standby withdrawal facilities on the scanning form or approved alternative reporting method.
3. If a metered withdrawal facility is not used during any given month, the meter report shall be submitted to the District indicating the same meter reading as was submitted the previous month.
4. The flow meter(s) or other approved device(s) shall have and maintain an accuracy within five percent of the actual flow as installed.
5. Meter accuracy testing requirements:
 - A. For newly metered withdrawal points, the flow meter installation shall be designed for inline field access for meter accuracy testing.
 - B. The meter shall be tested for accuracy on-site, as installed according to the Flow Meter Accuracy Test Instructions in this Exhibit B, every five years in the assigned month for the county, beginning from the date of its installation for new meters or from the date of initial issuance of this permit containing the metering condition with an accuracy test requirement for existing meters.
 - C. The testing frequency will be decreased if the Permittee demonstrates to the satisfaction of the District that a longer period of time for testing is warranted.
 - D. The test will be accepted by the District only if performed by a person knowledgeable in the testing equipment used.
 - E. If the actual flow is found to be greater than 5% different from the measured flow, within 30 days, the Permittee shall have the meter re-calibrated, repaired, or replaced, whichever is necessary. Documentation of the test and a certificate of re-calibration, if applicable, shall be submitted within 30 days of each test or re-calibration.
6. The meter shall be installed according to the manufacturer's instructions for achieving accurate flow to the specifications above, or it shall be installed in a straight length of pipe where there is at least an upstream length equal to ten (10) times the outside pipe diameter and a downstream length equal to two (2) times the outside pipe diameter. Where there is not at least a length of ten diameters upstream available, flow straightening vanes shall be used in the upstream line.
7. Broken or malfunctioning meter:
 - A. If the meter or other flow measuring device malfunctions or breaks, the Permittee shall notify the District within 15 days of discovering the malfunction or breakage.
 - B. The meter must be replaced with a repaired or new meter, subject to the same specifications given above, within 30 days of the discovery.

[Redacted]

[Redacted]

[Redacted]

C. If the meter is removed from the withdrawal point for any other reason, it shall be replaced with another meter having the same specifications given above, or the meter shall be reinstalled within 30 days of its removal

from the withdrawal. In either event, a fully functioning meter shall not be off the withdrawal point for more than 60 consecutive days.

8. While the meter is not functioning correctly, the Permittee shall keep track of the total amount of time the withdrawal point was used for each month and multiply those minutes times the pump capacity (in gallons per minute) for total gallons. The estimate of the number of gallons used each month during that period shall be submitted on District scanning forms and noted as estimated per instructions on the form. If the data is submitted by another approved method, the fact that it is estimated must be indicated. The reason for the necessity to estimate pumpage shall be reported with the estimate.

9. In the event a new meter is installed to replace a broken meter, it and its installation shall meet the specifications of this condition. The permittee shall notify the District of the replacement with the first submittal of meter readings from the new meter.

FLOW METER ACCURACY TEST INSTRUCTIONS

1. Accuracy Test Due Date - The Permittee is to schedule their accuracy test according to the following schedule:

A. For existing metered withdrawal points, add five years to the previous test year, and make the test in the month assigned to your county.

B. For withdrawal points for which metering is added for the first time, the test is to be scheduled five years from the issue year in the month assigned to your county.

C. For proposed withdrawal points, the test date is five years from the completion date of the withdrawal point in the month assigned to your county.

D. For the Permittee's convenience, if there are multiple due-years for meter accuracy testing because of the timing of the installation and/or previous accuracy tests of meters, the Permittee can submit a request in writing to the Water Use Permit Bureau Chief for one specific year to be assigned as the due date year for meter testing. Permittees with many meters to test may also request the tests to be grouped into one year or spread out evenly over two to three years.

E. The months for accuracy testing of meters are assigned by county. The Permittee is requested but not required to have their testing done in the month assigned to their county. This is to have sufficient District staff available for assistance.

January	Hillsborough
February	Manatee, Pasco
March	Polk (for odd numbered permits)*
April	Polk (for even numbered permits)*
May	Highlands
June	Hardee, Charlotte
July	None or Special Request
August	None or Special Request
September	Desoto, Sarasota
October	Citrus, Levy, Lake
November	Hernando, Sumter, Marion
December	Pinellas

* The permittee may request their multiple permits be tested in the same month.

2. Accuracy Test Requirements: The Permittee shall test the accuracy of flow meters on permitted withdrawal points as follows:

A. The equipment water temperature shall be set to 72 degrees Fahrenheit for ground water, and to the measured water temperature for other water sources.

B. A minimum of two separate timed tests shall be performed for each meter. Each timed test shall consist of measuring flow using the test meter and the installed meter for a minimum of four minutes duration. If the two tests do not yield consistent results, additional tests shall be performed for a minimum of eight minutes or

longer per test until consistent results are obtained.

C. If the installed meter has a rate of flow, or large multiplier that does not allow for consistent results to be obtained with four- or eight-minute tests, the duration of the test shall be increased as necessary to obtain accurate and consistent results with respect to the type of flow meter installed.

D. The results of two consistent tests shall be averaged, and the result will be considered the test result for the meter being tested. This result shall be expressed as a plus or minus percent (rounded to the nearest one-tenth percent) accuracy of the installed meter relative to the test meter. The percent accuracy indicates the deviation (if any), of the meter being tested from the test meter.

3. Accuracy Test Report: The Permittees shall demonstrate that the results of the meter test(s) are accurate by submitting the following information within 30 days of the test:

A. A completed Flow Meter Accuracy Verification Form, Form LEG-R.101.00 (5/14) for each flow meter tested. This form can be obtained from the District's website (www.watmatters.org) under "ePermitting and Rules" for Water Use Permits.

B. A printout of data that was input into the test equipment, if the test equipment is capable of creating such a printout;

C. A statement attesting that the manufacturer of the test equipment, or an entity approved or authorized by the manufacturer, has trained the operator to use the specific model test equipment used for testing;

D. The date of the test equipment's most recent calibration that demonstrates that it was calibrated within the previous twelve months, and the test lab's National Institute of Standards and Testing (N.I.S.T.) traceability reference number.

E. A diagram showing the precise location on the pipe where the testing equipment was mounted shall be supplied with the form. This diagram shall also show the pump, installed meter, the configuration (with all valves, tees, elbows, and any other possible flow disturbing devices) that exists between the pump and the test location clearly noted with measurements. If flow straightening vanes are utilized, their location(s) shall also be included in the diagram.

F. A picture of the test location, including the pump, installed flow meter, and the measuring device, or for sites where the picture does not include all of the items listed above, a picture of the test site with a notation of distances to these items.

WELL COMPLAINT INSTRUCTIONS

The permittee shall adhere to the following process for handling water resource, surface or ground water withdrawal point impact, dewatering complaints, or discharge/seepage of water from their property:

1. Within 48 hours of a complaint received by the Permittee related to their withdrawal or use of water or dewatering activity, the Permittee shall notify the District, perform a preliminary investigation to determine whether the Permittee's pumpage, dewatering activity, or discharge/seepage from their property may have caused the problem.

2. If this preliminary assessment indicates that the Permittee may be responsible, the Permittee shall, within 72 hours of complaint receipt, supply the complainant with any water necessary for health and safety purposes, such as drinking water.

3. If the resulting investigation determines that the Permittee was not responsible for the well problem, the Permittee shall document the reasons for this determination.

4. If the detailed investigation confirms that the complainant's problem was caused by the Permittee's pumpage, dewatering, or discharge or water impoundment activities:

A. The complainant's problem shall be fully corrected within 15 days of complaint receipt.



B. Impacts to wells: Full correction shall be restoration of the complainant's well to pre-impact condition or better, including the aspects of pressure levels, discharge quantity, and water quality. This

[Redacted]

[Redacted]

[Redacted]

detailed investigation shall include, but not be limited to, an analysis of water levels and pumpage impacts at the time of the complainant's problem, well and pump characteristics including depths, capacity, pump



curves, and irrigation system requirements.

5. The Permittee shall file a report of the complaint, the findings of facts, appropriate technical data, and any mitigating action taken or to be taken by the Permittee, to the Water Use Permit Bureau Chief, for review and approval within 20 days of the receipt of any complaint. The report shall include:
 - A. The name and address of each complainant;
 - B. The date and nature of the complaint;
 - C. A summary of the Permittee's investigation;
 - D. A summary of the Permittee's determination, including details of any mitigation activities; and
 - E. Cost of mitigation activity for each complaint.
6. A copy of the report shall be sent to the complainant within 20 days of complaint receipt.

April Breton Electronically Signed

Authorized Signature
SOUTHWEST FLORIDA WATER MANAGEMENT DISTRICT

This permit, issued under the provision of Chapter 373, Florida Statutes and Florida Administrative Code 40D-2, authorizes the Permittee to withdraw the quantities outlined above, and may require various activities to be performed by the Permittee as described in the permit, including the Special Conditions. The permit does not convey to the Permittee any property rights or privileges other than those specified herein, nor relieve the Permittee from complying with any applicable local government, state, or federal law, rule, or ordinance.

Exhibit C
Tampa Bypass Canal / Alafia River
Water Supply Projects
Hydrobiological Monitoring Program
2010 Update

**Tampa Bypass Canal / Alafia River
Water Supply Projects
Hydrobiological Monitoring Program
2010 Update**

FINAL

Prepared by



2575 Enterprise Road
Clearwater, Florida 33763



4030 Boy Scout Boulevard
Tampa, Florida 33607

February 2011

Contents

Section	Page
Contents	i
List of Tables	iii
List of Figures	iv
Abbreviations and Acronyms	v
References and Relevant Literature	vi
1.0 Introduction.....	1-1
1.1. Background.....	1-1
1.2. HBMP Goals and Objectives	1-1
1.3. HBMP Monitoring Areas	1-2
1.4. HBMP Monitoring Elements	1-3
2.0 HBMP Design Approach	2-1
2.1. HBMP Design - General Considerations	2-1
2.2. General Design Criteria Associated with HBMP Monitoring Elements	2-2
2.3. General Indicator Characteristics for HBMP Monitoring Elements	2-4
2.4. Reporting Units and Spatial Strata	2-5
2.5. Spatial Randomization	2-6
2.6. Temporal Strata	2-7
2.6.1. Lower Hillsborough River	2-8
2.6.2. TBC/Palm River	2-8
2.6.3. McKay Bay	2-8
2.6.4. Lower Alafia River	2-9
3.0 Tampa Bypass Canal/Hillsborough River HBMP	3-1
3.1. Introduction	3-1
3.2. Lower Hillsborough River, Tampa Bypass Canal and McKay Bay Reporting Units	3-1
3.3. Lower Hillsborough River and Tampa Bypass Canal Permit Conditions.....	3-1
3.4. Sampling Site Selection	3-2
3.5. Hydrology / Water Quality.....	3-3
3.6. Biota	3-4
3.6.1. Benthic Macroinvertebrates	3-5
3.6.2. Ichthyoplankton and other Zooplankton.....	3-5
3.6.3. Fish	3-5
3.7. Habitat / Vegetation.....	3-6
4.0 Alafia River HBMP	4-1
4.1. Introduction	4-1
4.2. Lower Alafia River Reporting Unit.....	4-1
4.3. Alafia River Permit Conditions	4-1
4.4. Sampling Site Selection	4-2
4.5. Hydrology / Water Quality.....	4-3
4.6. Biota	4-4
4.6.1. Benthic Macroinvertebrates	4-4
4.6.2. Ichthyoplankton and other Zooplankton.....	4-4
4.6.3. Fish	4-4
4.7. Habitat / Vegetation.....	4-5
5.0 HBMP Data Quality and Management.....	5-1

Contents

5.1.	Data Quality Objectives	5-1
5.1.1.	Representativeness	5-2
5.1.2.	Completeness	5-2
5.1.3.	Comparability	5-3
5.1.4.	Accuracy and Precision	5-3
5.2.	Data Precision and Accuracy	5-3
5.2.1.	Field Measurements	5-4
5.2.2.	Method Detection Limits	5-4
5.3.	HBMP Data Management	5-5
5.3.1.	Data Sources	5-5
5.3.2.	Database Management	5-6
5.3.3.	Data Verification	5-6
6.0	HBMP Reporting and Future Program Modifications	6-1
6.1.	Reporting	6-1
6.1.1.	TBC/Hillsborough River HBMP	6-1
6.1.2.	Alafia River HBMP	6-1
6.2.	Data Analysis	6-2
6.2.1.	Descriptive Statistics and Time Series	6-2
6.2.2.	HBMP Elements / Indicators	6-2
6.2.3.	HBMP Biotic Parameters of Interest	6-5
6.2.4.	Center of Abundance	6-8
6.2.5.	Abundance Weighted Salinity	6-8
6.2.6.	Dissolved Oxygen and Chlorophyll-a Thresholds and Exceedances	6-8
6.2.7.	Hydrodynamic Models	6-8
6.3.	Potential Future Program Modifications	6-8
6.3.1.	Annual Reporting	6-9
6.3.2.	Hydrology/Water Quality	6-9
6.3.3.	Benthic Macroinvertebrate Sampling (Special Studies)	6-9
6.3.4.	Fish and Freshwater Inflows (SWFWMD Study)	6-11
6.3.5.	Habitat / Vegetation	6-11
7.0	HBMP Programmatic Criteria	7-1
7.1.	Background	7-1
7.2.	Minimum Flows and Levels	7-2
7.2.1.	TBC MFL	7-4
7.2.2.	Lower Hillsborough River MFL	7-4
7.2.3.	Lower Alafia River MFL	7-5
7.3.	WUP Requirements	7-7
7.3.1.	Tampa Bypass Canal Water Supply Project	7-7
7.3.2.	Alafia River Water Supply Project	7-8
7.4.	HBMP Programmatic Criteria	7-9
7.5.	HBMP Management Responses	7-11

Appendices

- Appendix A Previously Authorized HBMP Design and Programmatic
Changes
Appendix B List of HBMP Reports and Other Documents

List of Tables

Table		Page
Table 3.5.1.	Hydrologic and water quality parameters measured in the three reporting units	3-4
Table 3.1.1.	Sampling Program Summary for the Lower Hillsborough River Reporting Unit.....	3-7
Table 3.1.2.	Sampling Program Summary for the TBC Reporting Unit.....	3-8
Table 3.1.3.	Sampling Program Summary for the McKay Bay Reporting Unit	3-9
Table 4.5.1	Hydrologic and water quality parameters measured in the Alafia River	4-3
Table 4.1.1.	Sampling Program Summary for the Alafia River Reporting Unit.....	4-7
Table 6.2.1.	HBMP Elements/Indicators and SWFWMD MFL Resources of Concern.....	6-3
Table 6.2.2.	HBMP Key Biotic Indicators: TBC and McKay Bay	6-5
Table 6.2.3.	HBMP Key Biotic Indicators: Lower Hillsborough River	6-5
Table 6.2.4.	HBMP Key Biotic Indicators: Lower Alafia River.....	6-6

List of Figures

Figure	Page
Figure 2.4.1. The Hillsborough River Reporting Unit.....	2-10
Figure 2.4.2. The TBC Reporting Unit	2-11
Figure 2.4.3. The McKay Bay Reporting Unit	2-12
Figure 2.4.4. The Alafia River Reporting Unit.....	2-13
Figure 2.4.5. The Hillsborough Bay Reporting Unit.	2-14
Figure 5.1.1. HBMP Organizational Chart.....	5-8

Abbreviations and Acronyms

AR	Alafia River
Chl-a	Chlorophyll-a
DOC	Dissolved Organic Carbon
DO	Dissolved Oxygen
EMAP	Environmental Monitoring and Assessment Program
EPA	Environmental Protection Agency (U.S.)
EPCHC	Environmental Protection Commission of Hillsborough County
FIM	FWRI Fisheries Independent Monitoring Program
FWRI	Fish and Wildlife Research Institute (formerly Florida Marine Research Institute)
GIS	Geographic Information System
HBMP	Hydrobiological Monitoring Program
HR	Hillsborough River
MB	McKay Bay
NRC	National Research Council
NWS	National Weather Service
PBS&J	PBS&J, Inc.
PR	Palm River
PSU	Practical Salinity Units
PPT	Parts per Thousand
QA/QC	Quality Assurance/ Quality Control
Rkm	River Kilometer
SAV	Submerged Aquatic Vegetation
SAS	Software system developed by the SAS Institute, Cary, NC.
SWFWMD	Southwest Florida Water Management District
TBC	Tampa Bypass Canal
TOC	Total Organic Carbon
TSS	Total Suspended Solids
USF	University of South Florida
USGS	U.S. Geological Survey
WUP	Water Use Permit

References and Relevant Literature

- Cochran, W.G. 1977. *Sampling Techniques*. 3rd Edition. John Wiley & Sons. New York.
- Cochran, W.G., F. Mosteller, and J.W. Tukey. 1954. Principles of sampling. *Journal of the American Statistical Association* 49:13-35.
- Kaufman, K. 1990. *A Field Guide to Advanced Birding*. Peterson Field Guide Series. Houghton Mifflin Company. Boston, Massachusetts.
- Kirchner, C.J. 1983. Quality Control in Water Analysis. *Environmental Science and Technology* 17(4):174A-181A.
- National Research Council. 1990. *Managing Troubled Waters*. National Academy Press. Washington, D.C.
- PBS&J. 2000. *Tampa Bypass Canal/Alafia River Water Supply Projects Hydrobiological Monitoring Program*. Final Report prepared for Tampa Bay Water by PBS&J, Tampa, Florida.
- PBS&J. 2003. *Tampa Bypass Canal/Alafia River Water Supply Projects Hydrobiological Monitoring Program: Water Year 2002-Year 3 Interpretive Report*. Prepared for Tampa Bay Water by PBS&J, Tampa, Florida.
- PBS&J and Janicki Environmental, Inc. 2006. *Tampa Bypass Canal Alafia River Water Supply Projects Hydrobiological Monitoring Program: Water Year 2005-Year 6 Interpretive Report*. Prepared for Tampa Bay Water by PBS&J, Tampa, Florida.
- PBS&J. 2008. *Tampa Bypass Canal/Alafia River Water Supply Projects Hydrobiological Monitoring Program: Quality Assurance and Quality Control Plan-Version 2.1*. Prepared for Tampa Bay Water by PBS&J, Tampa, Florida.
- PBS&J and Janicki Environmental, Inc. 2009. *Alafia River Water Supply Project Hydrobiological Monitoring Program: Water Year 2009-Year 9 Interpretive Report*. Prepared for Tampa Bay Water by PBS&J, Tampa, Florida.
- PBS&J and Janicki Environmental, Inc. 2010. *Tampa Bypass Canal Water Supply Project Hydrobiological Monitoring Program: Water Year 2010-Year 10 Interpretive Report*. Prepared for Tampa Bay Water by PBS&J, Tampa, Florida.
- Southwest Florida Water Management District (SWFWMD), 2005. *Minimum Flows for the Tampa Bypass Canal, Tampa, Fl*. Prepared by the Southwest Florida Water Management District Ecologic Evaluation Section, Brooksville, Florida.
- Southwest Florida Water Management District (SWFWMD), 2006. *Lower Hillsborough River Low Flow Study Results and Minimum Flow Recommendation*. Prepared by the Southwest Florida Water Management District, Brooksville, Florida.

Southwest Florida Water Management District (SWFWMD), 2008. The Determination of Minimum Flows for the Lower Alafia River Estuary. Prepared by the Southwest Florida Water Management District Ecologic Evaluation Section, Brooksville, Florida.

Stanley, T.W., and S.S. Verner. 1985. The U.S. Environmental Protection Agency's Quality Assurance Program. In: J.K. Taylor and T.W. Stanley (eds.) *Quality Assurance for Environmental Measurements*. American Society for Testing Materials. Philadelphia, Pennsylvania.

Summers, J.K., and G. Maddox. 1999. Design of the Status Monitoring Network. In: *Overview of the Florida Department of Environmental Protection's Integrated Water Resource Monitoring Efforts and the Design Plan of the Status Network*. Florida Department of Environmental Protection. Tallahassee, Florida.

Taylor, J.K. 1987. *Quality Assurance of Chemical Measurements*. Lewis Publishers. Boca Raton, Florida.

1.0 Introduction

Special conditions in the Southwest Florida Water Management District (SWFWMD or District) Water Use Permits (WUPs) 2011794.00 and 2011796.00 required development and implementation of comprehensive hydrobiological monitoring programs (HBMPs) for the Alafia River and the Tampa Bypass Canal/Hillsborough River Water Supply Projects. Because of the consistent elements and the close proximity of the two water supply projects, a single, integrated HBMP was designed and implemented to meet the permit requirements for both projects (PBS&J, 2000).

This document, the HBMP 2010 Update, incorporates all previously approved program modifications and reflects the current HBMP as of July 2010.

1.1. Background

Design of the Alafia River/Tampa Bypass Canal HBMP began in May 1999. The HBMP was designed in a series of workshops and subcommittee meetings attended by regulatory agency and local government representatives, and other stakeholders. A final HBMP design document was completed in late 1999 (PBS&J, 2000).

HBMP field sampling was initiated in April 2000, and continued implementation of the HBMP has been required under special conditions for the renewed and modified water use permits for these regional public water supply projects. The HBMP was intended to be routinely modified based on field conditions and the ongoing evaluation of HBMP data.

In the ten years since the acceptance of the final HBMP design by both the design group and the Tampa Bay Water Board, several modifications have been made to the HBMP design. These modifications were in response to requests by the District and other stakeholders, logistical problems encountered during early implementation, and the sampling modifications identified based on evaluations of HBMP data.

Potential modifications to improve the monitoring program have been provided in HBMP annual and multi-year interpretative reports and discussed at Annual HBMP Meetings. All modifications approved by the District and incorporated into the program are listed in Appendix A.

1.2. HBMP Goals and Objectives

In accordance with the District's Basis for Review for water use permitting, the minimal goal of the HBMP is to generate information at an appropriate scale and resolution to determine if the permitted water supply projects are in compliance with District rules. Accordingly, the overall goals established for the HBMP are consistent with the District's performance standards provided in the Basis of Review.

The goal of the HBMP is to ensure that reduced flows in the Tampa Bypass Canal, Hillsborough River and Alafia River attributable to Tampa Bay Water's permitted surface water withdrawals do not deviate from the normal rate and range of fluctuation to the extent that:

- Water quality, vegetation, and animal populations are adversely impacted in streams and estuaries
- Salinity distributions in tidal streams and estuaries are significantly altered as a result of withdrawals
- Recreational use or aesthetic qualities of the resource are adversely impacted.

In addition to the above stated goals, the 1999 design process also generated programmatic objectives to address the District's process for evaluating compliance with these Water Use Permits. Accordingly, stakeholders agreed upon HBMP objectives as follows:

- Document existing conditions in the potentially affected waterbodies
- Enable the detection of changed conditions in the potentially affected waterbodies
- Determine if the detected changed conditions are attributable to reductions in freshwater inflows
- Provide a scientifically defensible means to evaluate whether the permitted surface water withdrawals are causing or significantly contributing to the detected changed conditions
- Determine whether the detected changed conditions constitute or could result in unacceptable adverse impacts
- Recommend appropriate management actions or operational changes designed to eliminate or mitigate unacceptable adverse impacts if they occur or are expected to occur.

As reflected in the above listed objectives, the overall purpose and scope of the HBMP extend beyond just data acquisition, analysis, and reporting. The HBMP also incorporates programmatic criteria that have been developed to ensure that the permitted withdrawals are consistent with District rules throughout the lifetime of the permits.

1.3. HBMP Monitoring Areas

Stakeholders involved in the 1999 design process came to consensus that any potential impacts from the permitted surface water withdrawals would likely first be manifested in the river systems where surface water withdrawals will take place, and possibly Hillsborough Bay. Therefore, the potentially affected waterbodies or portions of waterbodies were identified based on geographic areas of concern; these were defined as "reporting units" for purposes of monitoring program design.

HBMP reporting units were established for each of five potentially affected waterbodies:

- The lower Alafia River below Bell Shoals Road
- The Tampa Bypass Canal/Palm River below Structure S-160
- McKay Bay
- The lower Hillsborough River below the City of Tampa dam
- Hillsborough Bay

The design stakeholder group concluded that Hillsborough Bay proper could be potentially affected by the permitted water supply projects, but that additional sampling in Hillsborough Bay

as a component of the HBMP was not warranted for two reasons. First, impacts from Tampa Bay Water withdrawals should be detected in the other reporting units before being detected in Hillsborough Bay. Second, the data gathered from existing long-term EPCHC and FWRI monitoring programs can be used to characterize the status of this reporting unit.

1.4. HBMP Monitoring Elements

The HBMP has three monitoring program elements:

- Hydrology/Water quality
- Biota
- Habitat/Vegetation

During the design of the HBMP, critical indicators were identified for each monitoring element in each reporting unit. Critical indicators are units of measure that describe the status of the statistical populations or subpopulations of interest, usually in response to some environmental stressor. Structural and hydrobiological differences among the reporting units necessitate slightly different groups of critical indicators for each.

Specific monitoring objectives for each of the three HBMP elements adopted by the stakeholder group are summarized briefly below.

- Hydrology/Water Quality
 - Estimate the daily freshwater inflows, freshwater withdrawals, and water levels in each reporting unit.
 - Estimate the distribution of water quality indicators by reporting unit on an appropriate temporal basis.

Estimates of freshwater inflows and withdrawals, and water levels, are to be made on a daily basis. The temporal basis is consistent for all water quality indicators; however, the temporal basis differs among the spatial reporting units. All reporting units have adequate sample size to ensure both annual and seasonal estimates of water quality conditions.

- Biota
 - Estimate by reporting unit on an appropriate temporal basis, the species composition (to the lowest practical identifiable level), and abundance and distribution of:
 - Juvenile and adult fishes
 - Benthic macroinvertebrate infauna and epifauna
 - Ichthyoplankton and other macrozooplankton.

As with water quality, the temporal basis is consistent for all biotic indicators, however, the temporal basis differs among the spatial reporting units. All reporting units have adequate sample size to ensure both annual and seasonal estimates of biotic conditions in all reporting units.

An additional indicator for the biota element, “estimate the species composition (to the lowest practical identifiable level) and abundance of water-dependent birds in upper McKay Bay and

the Alafia Banks on an appropriate temporal basis”, was included in the initial design, but was discontinued from the program based on evaluation of data collected (see Appendix A).

- Habitat/Vegetation
 - Estimate the areal extent and upstream/downstream limits of emergent vegetation communities by reporting unit on a periodic basis.
 - Estimate species composition and relative abundance of submerged aquatic vegetation communities in the Alafia River on periodic basis.
 - Estimate the distribution of sediment grain size and sediment total organic matter by reporting unit on an appropriate temporal basis (derived from benthic sampling).

Typically, there is little within-year variation in the habitat indicators, therefore, estimation of the status of these indicators on an annual or multi-year basis was considered appropriate. The temporal basis is consistent for all habitat indicators across all spatial reporting units. All reporting units have adequate sample size to ensure annual estimates of habitat conditions.

2.0 HBMP Design Approach

This section provides an overview of the sampling techniques and strategies used in the HBMP. Sections 2.1 and 2.2 discuss the general design of the program. Section 2.3 discusses the general indicators used in the program. HBMP geographic reporting units, spatial strata and randomization, temporal stratification, and considerations for each reporting unit are discussed in Sections 2.4-2.6.

2.1. HBMP Design - General Considerations

Appropriate environmental monitoring programs are critical components of effective resource management. According to the National Research Council (1990), effective environmental monitoring:

- Provides the information needed to evaluate the effectiveness of, and to appropriately adjust, resource management actions
- Provides an early warning system, allowing for lower cost solutions to environmental problems
- Contributes to the knowledge of ecosystems and how they are affected by human activity, and such knowledge allows for the establishment of priorities for environmental protection and for the assessment of status and trends
- Provides information that helps to answer layperson questions
- Is essential for the construction, adjustment, and verification of quantitative predictive models which are an important basis for evaluating, developing, and selecting environmental management strategies
- Provides resource managers the scientific rationale for setting environmental standards
- Determines legal compliance with established environmental standards and conditions as set forth in regulatory programs.

Environmental monitoring programs need to have clearly articulated goals and objectives to minimize data gaps and unanswered critical questions. Therefore, monitoring programs need to be properly designed at the outset, and monitoring methods appropriately applied, if they are to meet the multiple expectations of all those who rely on the information generated. Even when monitoring programs are technically sound, it is their overall design and institutional context that often limits the usefulness of the resulting information.

The National Research Council (1990) has identified the following factors for sound program design and objective implementation of monitoring programs:

- The goals and objectives of the monitoring program must be clearly articulated in terms that pose questions that are meaningful to the public and that provide the basis for scientific investigation
- Not only must data be gathered, but attention must also be paid to their management, synthesis, interpretation, and analysis
- Procedures for quality assurance are needed, including multiple levels of peer review

- Well-designed monitoring programs often result in unanswered questions about environmental processes or human impacts. Therefore, where feasible, supportive research should be provided
- Adequate resources are needed not only for data collection but also for detailed analysis, evaluation, and reporting over the long term
- Programs should be sufficiently flexible to allow for their modification when and where changes in conditions or new information suggests the need
- Provision should be made to ensure that monitoring information is made available to all interested parties in a form that is useful to them.

2.2. General Design Criteria Associated with HBMP Monitoring Elements

The initial step undertaken in the development of the HBMP was to define those parameters that were thought to be indicators of potential changes in each of the potentially affected water bodies. The next step was to define the geographical areas where data collection should be implemented. It was agreed that the HBMP sampling design should provide technically sound and practical methods for collecting the data needed to obtain unbiased population, subpopulation, and variance estimates.

Unbiased population and subpopulation estimates are metrics whose average value, taken over all possible samples, is equal to the population parameter value of the metric. In other words, the estimate gives the correct value for some measure of the population. Here, the term **population** refers to the totality of individual observations about which inferences are to be made within a definitely specified sampling area limited in space and time.

Cochran et al. (1954) point out that the population to be sampled (the *sampled* population) should coincide with the population about which inferences are to be drawn (the *target* population). Cochran (1977) further states that at times, for reasons of practicability or convenience, the sampled population is more restricted than the target population. In such cases, it should be noted that conclusions drawn from the sample apply to the sampled population. Judgment must be used to determine the extent to which the conclusions will also apply to the target population. One way in which this problem can be avoided is to ensure at the design phase that the sampled population is carefully defined to closely agree with the target population definition.

A **subpopulation** is a specific portion of the population, defined either in space or time. For example, the subpopulation may be the shallow portion (defined by some specific depth) of the waterbody of concern. A subpopulation could also be all measurements made in a particular season of the year (e.g., wet or dry season subpopulations).

Sampling theory was employed to determine the best design for the HBMP sampling strategy. There are basically two common types of sampling strategies (Cochran, 1977):

Probability Sampling - Employing this approach requires a definition of the set of distinct samples that the sampling program is capable of sampling if applied to a specific population.

Each possible sample must have a known probability of selection. The samples are selected by a random process in which each sample receives its appropriate probability of being selected.

Nonprobability Sampling - Common approaches include: sampling a restricted portion of the population that is readily accessible (e.g., fixed station sampling of salinity from a bridge); haphazard sample selection without conscious planning; and a selection of “typical” or “representative” sample units that are considered close to the average of the target population.

If conditions are appropriate, each of the methods can provide useful results. However, the only way to verify if an estimate is unbiased is to compare it with the actual population values or an estimate derived from a probability sampling approach. Even if such a test comparison demonstrates that the nonprobability sampling estimate is unbiased, this does not necessarily mean that method will continue to give unbiased results under all circumstances. For example, future changes in drainage patterns in a watershed may cause more or less runoff to enter the waterbody of concern. Therefore, in this example, checks of the unbiased nature of the nonprobability sample estimate would have to continue throughout the length of the monitoring program. A probability sampling approach yields unbiased estimates regardless of changing conditions.

Unbiased variance estimates will provide a measure of uncertainty in the population and subpopulation estimates. In order to ensure that variance estimates are unbiased, it is recommended that the sampling design follow the basic rules for probability sampling and variance estimation. Thus, for all elements of the sampling design, at least two samples must be collected from each subpopulation for which an unbiased estimate of variance is required, and each sampling unit in the subpopulation must have a known, non-zero probability of inclusion in the sample. In addition, the pairwise inclusion probabilities of all possible combinations of the two samples must be known and non-zero. Logistical constraints may require that some sampling units have a lower inclusion probability than others, and can be incorporated into the sampling design, if necessary. The inclusion probabilities used to select sampling units will be specified quantitatively, introduced as weights in all computations of estimates and associated variances, and hence allow all estimates to be unbiased.

Given the above conditions, and based on the efforts of the HBMP design stakeholder group, it was concluded that a probability-based design was best suited to meet the programmatic goals and objectives of the HBMP. It should, however, be noted that several other data needs were also identified that would not be best addressed using a probability-based approach. These informational needs were anticipated to be addressed separately as “special studies” (see Appendix A and PBS&J, 2000 for additional information).

To implement the design approach, a series of decisions were made regarding the specifics of the monitoring program design. First, specific **monitoring objectives** were defined. Second, the **indicators** of the status of the population (or subpopulations) were defined. Third, the **reporting units** were defined with respect to both space and time.

The general probability sampling approach allows inferences to be drawn not only about the target populations but also a variety of subpopulations. As a general rule of thumb, if it is desired

to draw an inference with regard to a particular subpopulation, then that subpopulation or **stratum** should be designed into the overall monitoring plan (Summers and Maddox, 1999). The use of strata within a sampling design enhances the power to detect differences because it optimizes the design based on the natural variability characteristics of the indicators being measured.

Cochran (1977) concludes that incorporating strata into the sampling design, referred to as **stratified random sampling**, is a common and indicated technique if:

- Data of known precision are wanted for certain subpopulations, in which case it is advisable to treat each such subdivision as a “population” in its own right
- Convenience dictates the use of stratification
- Sampling problems differ markedly in different parts of the population
- It is desired to increase the precision of estimates of the characteristics of the population as a whole.

The HBMP design stakeholder group concluded that a stratified random sampling approach was the best sampling design to meet HBMP objectives.

2.3. General Indicator Characteristics for HBMP Monitoring Elements

Following the identification of specific measurable monitoring objectives, the next step in the monitoring design process is the definition of appropriate indicators. Indicators are units of measure that describe the status of the statistical populations, or subpopulations, of interest, usually in response to some environmental stressor. The term **indicator** in this context is somewhat analogous to the term *parameter*, as it is applied in environmental monitoring jargon; however, it is broader in scope.

Indicators can be generally broken down into two classes: 1) desirable indicators, and 2) critical indicators. General characteristics for each of these are listed below.

General characteristics of desirable indicators include:

- Sampling Unit Stable - measurements of the response indicator taken at a sampling unit should be stable over the course of the sampling period
- Available Method - should have a generally accepted, standardized method of measurement that can be applied on a regional scale
- Historical Record - has a historical database, or a historical database can be generated from acceptable data sources
- Retrospective - can be related to past conditions via retrospective analyses
- Anticipatory - provides an early warning of widespread changes in ecosystem processes or conditions
- Cost-Effective - has low incremental cost relative to its information value
- New Information - provides new information; does not merely duplicate data already collected by other agencies or investigators

General characteristics of critical indicators include:

- Regionally Responsive - must reflect changes in ecosystem conditions and respond to stressors of concern across most resource classes and habitats in a region
- Unambiguously Interpretable - must be related to an assessment endpoint or relative exposure or habitat variable that forms part of the investigators' overall conceptual model of ecological structure and function
- Low Measurement Error - exhibits low measurement error and stability of regional cumulative frequency distribution during the index period
- Simple Quantification - can be quantified by cost-effective synoptic or automated monitoring
- Environmental Impact - sampling must have minimal environmental impact
- Low Year-to-Year Variability - must have sufficiently low natural inter-annual variation to detect ecologically significant changes within a reasonable time frame

It is important to note that, with respect to surface water supply projects, all potentially applicable response indicators must have either a direct relationship to changes in freshwater inflows, or an indirect relationship (e.g., center of fish population distribution). Indicators with a direct relationship to freshwater inflows are typically physical or chemical in nature (e.g., salinity), and respond more or less instantaneously to changing inflows. Indicators with an indirect relationship to freshwater inflows are typically biological in nature (e.g., center of fish population distribution), are mediated by physical and chemical changes, and generally respond on a slower time scale (e.g., days, months, and seasons).

The HBMP design stakeholder group deliberated on critical and desirable indicators over the course of several workshops, applied the criteria described above, and generated a list of potential indicators for each of the three identified monitoring elements: hydrology/water quality, biota, and habitat. This list was ultimately reduced to a final recommended suite of critical indicators for each monitoring element (see PBS&J, 2000) that is summarized in the following sections.

2.4. Reporting Units and Spatial Strata

The spatial and temporal extents, statistically often referred to as the *target population*, of the sampling program were defined during the development of the HBMP.

The potentially affected waterbodies or portions of waterbodies were identified based on geographic areas of concern; these were defined as spatial "reporting units" for purposes of program design and monitoring for withdrawal-related changes on an annual basis.

HBMP spatial reporting units include:

- Lower Hillsborough River – Figure 2.4.1
- Tampa Bypass Canal/Palm River - Figure 2.4.2
- McKay Bay – Figure 2.4.3
- Lower Alafia River – Figure 2.4.4
- Hillsborough Bay – Figure 2.4.5

HBMP sampling is conducted in each of the four primary reporting units: the lower Hillsborough River, the Tampa Bypass Canal/Palm River, McKay Bay, and the lower Alafia River.

For the fifth reporting unit, Hillsborough Bay, the HBMP design stakeholder group concluded that this reporting unit could be affected by the permitted water supply projects, but that additional sampling in Hillsborough Bay as a component of the HBMP was not warranted for two reasons. First, impacts from Tampa Bay Water withdrawals should be detected in the other reporting units before being detected in Hillsborough Bay. Second, the data gathered from existing monitoring programs can be used to characterize the status of this reporting unit.

HBMP data collection sites in Hillsborough Bay are located near the mouth of each primary reporting unit. The Environmental Protection Commission of Hillsborough County (EPCHC) and the FWRI have long-term monitoring programs in Hillsborough Bay that are independent of the HBMP. In Water Year 2005, the Fisheries Independent Monitoring Program of the Fish and Wildlife Research Institute (FWRI) also began HBMP-specific sampling in Hillsborough Bay at the mouth of the Alafia River. Results from these programs comprise the majority of the data evaluated by the HBMP for Hillsborough Bay reporting unit.

2.5. Spatial Randomization

To develop the HBMP stratified random sampling design, a randomized method for choosing monthly sampling sites is used for each of the spatial strata within each reporting unit. The centerlines of the linear reporting units were generated using an ARCINFO function that interpolates intermediate topographic contours. The function used the riverbanks as contours and interpolated the centerlines as intermediate contours between the banks. The centerlines were then divided into 1-meter long segments, and each of these was defined as a potential sampling station and named according to its distance from the river mouth and the strata in which it was located.

HBMP monthly sampling stations for the linear reporting units are selected by stratum. Each station in the stratum is assigned a unique consecutive whole number. A series of random numbers is then created using the SAS “ranuni()” statement. These random numbers are matched with the numbers assigned to the stations, and the corresponding stations are selected. Lists of primary and alternate stations by stratum are provided to the field staff. In the event that a primary station cannot be sampled, field staff must choose the first alternate station (not the closest station). If an alternate station cannot be sampled, field staff must choose the next alternate station in the sequence.

A “right”, “left”, or “center” (“shallow right”, “shallow left”, or “deep” in the Palm River) designation is also chosen in the monthly sample selection process. A “left” designation instructs the field staff to take a sample on the left 33% of the river (with left defined as the left side looking upstream). A “center” designation instructs the crew to sample in the center 33% of the river and a “right” designation in the right 33%. The designations are the same for the Palm River except that the “shallow” stations are sampled in water less than 2 meters deep. The lateral positions are randomly selected using the SAS “ranuni()” statement. Each portion of a river has

an equal chance of being selected for any given station. The depth strata of the Palm River are treated as substrata. Lateral position is not randomly selected in the deep Palm River substrata. The “left” or “right” lateral positions are randomly selected in the Palm River shallow strata.

Stations for water quality, benthos, and fish sampling are randomly selected for each monthly sampling. Stations for plankton sampling were randomly selected one time at the beginning of the program.

McKay Bay monthly stations are grouped by hexagon or cell. Initially a cell is randomly selected for sampling. Then the station within the selected cell is selected in a manner consistent with the technique described above for the linear reporting units. Lists of the primary and alternate stations are provided to the field staff. There is only one primary station in each cell. If that station cannot be sampled, field staff must select the first alternate station. If an alternate station cannot be sampled, crews must select the next alternate station in that cell. There are no lateral sample station designations in McKay Bay.

McKay Bay cells are selected using a method weighted for the number of stations in each cell. Each of the McKay Bay cells is the same size, but some of the cells on the edge of the bay overlap land areas. These overlap areas do not constitute valid stations. McKay Bay cells are selected using a weighted formula in SAS. Each cell is assigned a sequential percentage of the values from 0 to 1 in accordance with the proportion of the total stations in McKay Bay located in that cell. For instance, if Cell 1 contains 15% of the total stations it would be assigned values from 0.00001 to 0.15000 in the formula. If Cell 2 contained 5% of the stations in McKay Bay, it would be assigned values from 0.15001 to 0.20000 in the formula. Though the water quality, benthos, fish, and plankton efforts may sample the same cell during a given month, a single sampling element is never sampled twice within one cell in a given month.

2.6. Temporal Strata

Temporal strata are specific to each of the four reporting units. In general, these strata were defined to ensure that the key within-year sources of variation were taken into account. Specifically, two sources of within-year variation were considered critical. One source dealt with the intra-annual variation in flows due to the seasonal differences in rainfall. Typically, flows are higher in the normal wet season period (July through September) when compared to flows observed in the dry season (October through June). Flows in the months of April and May in particular can be extremely low due to prolonged periods of low rainfall. The second within-year source of expected variation in flows would be the manifestation of the permitted withdrawal schedules. Since the withdrawal schedules vary as a function of ambient flow, the reductions in freshwater flow due to the withdrawals will not be consistent throughout the year. Based on historical flow conditions, the greatest daily withdrawals will typically occur during the months of July through September.

Two other sources of temporal variation, tides and diel variability, were considered during the development of the sampling program but were determined to be adequately addressed to meet HBMP objectives based on other sampling criteria and constraints.

2.6.1. Lower Hillsborough River

The general temporal sampling strategy for the lower Hillsborough River ensures that an adequate sample size is available for drawing inferences about river-wide status on an annual or seasonal basis. A temporally even sampling effort exists for water quality, fish, and plankton sampling. By comparison, the benthic sampling program currently includes two different sampling intensities. Benthic sampling effort in both the wet season (i.e., July through September) and in the late dry season (April through June) is greater than that during the periods of October through December and January through March. Thus, the lower Hillsborough River sampling strategy for benthos is on a wet season/dry season basis.

In addition, continuous monitoring (every 15 minutes) of conductivity and temperature is conducted at three permanent fixed locations (Sligh Ave., Columbus Ave., and a third station located between Sligh and Columbus). These stations provide information on short-term responses in water quality to changes in freshwater flow. Rainfall and flow measurements are determined on a daily basis. Vegetation sampling consists of aerial photography and shoreline surveys conducted every three years between October and December.

2.6.2. TBC/Palm River

The temporal sampling strategy for the TBC/Palm River focuses on the expected differences in river status that are likely to occur between the wet and dry seasons. Sampling for benthos and water quality during the wet season, when mean daily withdrawals will be largest, is more intense than during the dry season. To this end, there are two temporal sampling strata for both water quality and benthos, with adequate sampling intensity for inferences to be made regarding the status of water quality or benthos in the river for both the wet and dry seasons. Equivalent sampling intensities are employed across all months of the year for zooplankton sampling. Based on stakeholder consensus and District approval, fish sampling in the TBC/Palm River was discontinued in Water Year 2009 (see Appendix A).

Continuous monitoring (every 15 minutes) of conductivity and temperature is conducted at the Maydell Drive recorder. This monitoring provides information on short-term responses in water quality to changes in freshwater flow. Rainfall and flow measurements are collected on a daily basis. Vegetation sampling consists of aerial photography and shoreline surveys conducted every three years during the months of October through December.

2.6.3. McKay Bay

The temporal sampling strategy for McKay Bay closely follows that for the TBC/Palm River and focuses on the expected differences in the status of McKay Bay between the wet and dry seasons. Continuous monitoring (every 15 minutes) of conductivity and temperature is conducted at the 22nd Street Causeway station. Sampling of benthos and water quality is more intense during the wet season, when mean daily withdrawals are expected to be greatest based on historical flow conditions. Equivalent sampling intensities are employed across all months for both fish and plankton sampling.

The sampling schedule is based on temporal randomization around a selected day within each month. This method provides estimates of within-temporal stratum variability, increases the power of any tests of significance, and also best represents the range of flow conditions expected.

2.6.4. Lower Alafia River

The temporal sampling strategy for the lower Alafia River is very similar to that defined for the lower Hillsborough River. Equal sampling intensities are employed across all months for water quality, benthos, fish, and plankton sampling. The sampling intensity is meant to be sufficient to allow meaningful river-wide inferences regarding each of these HBMP elements to be drawn on a quarterly basis. An additional fish sampling effort occurs once annually in the freshwater stratum.

During the HBMP design process, stakeholders recommended that an inset stratum for benthic sampling be specifically addressed, extending approximately 1 km upstream and 1 km downstream of the freshwater interface based on an analysis of pre-operational water quality data. Additional benthic sampling is currently conducted in the inset stratum during the months of June through August. This sampling was initially designed to be sufficiently intense to allow inferences to be drawn about the status of this stratum during the wet season.

Continuous monitoring (every 15 minutes) of conductivity and temperature is conducted at one fixed station currently located on the River south of Buckhorn Creek. In addition, the USGS collects data from two additional fixed sites on the Alafia River. These data provide information on short term responses in water quality to changes in freshwater flow. The frequency of rainfall and flow measurements is daily. Vegetation sampling consists of aerial photography and shoreline surveys conducted every three years during the October through December period. Submerged aquatic vegetation is currently monitored every five years in two strata.

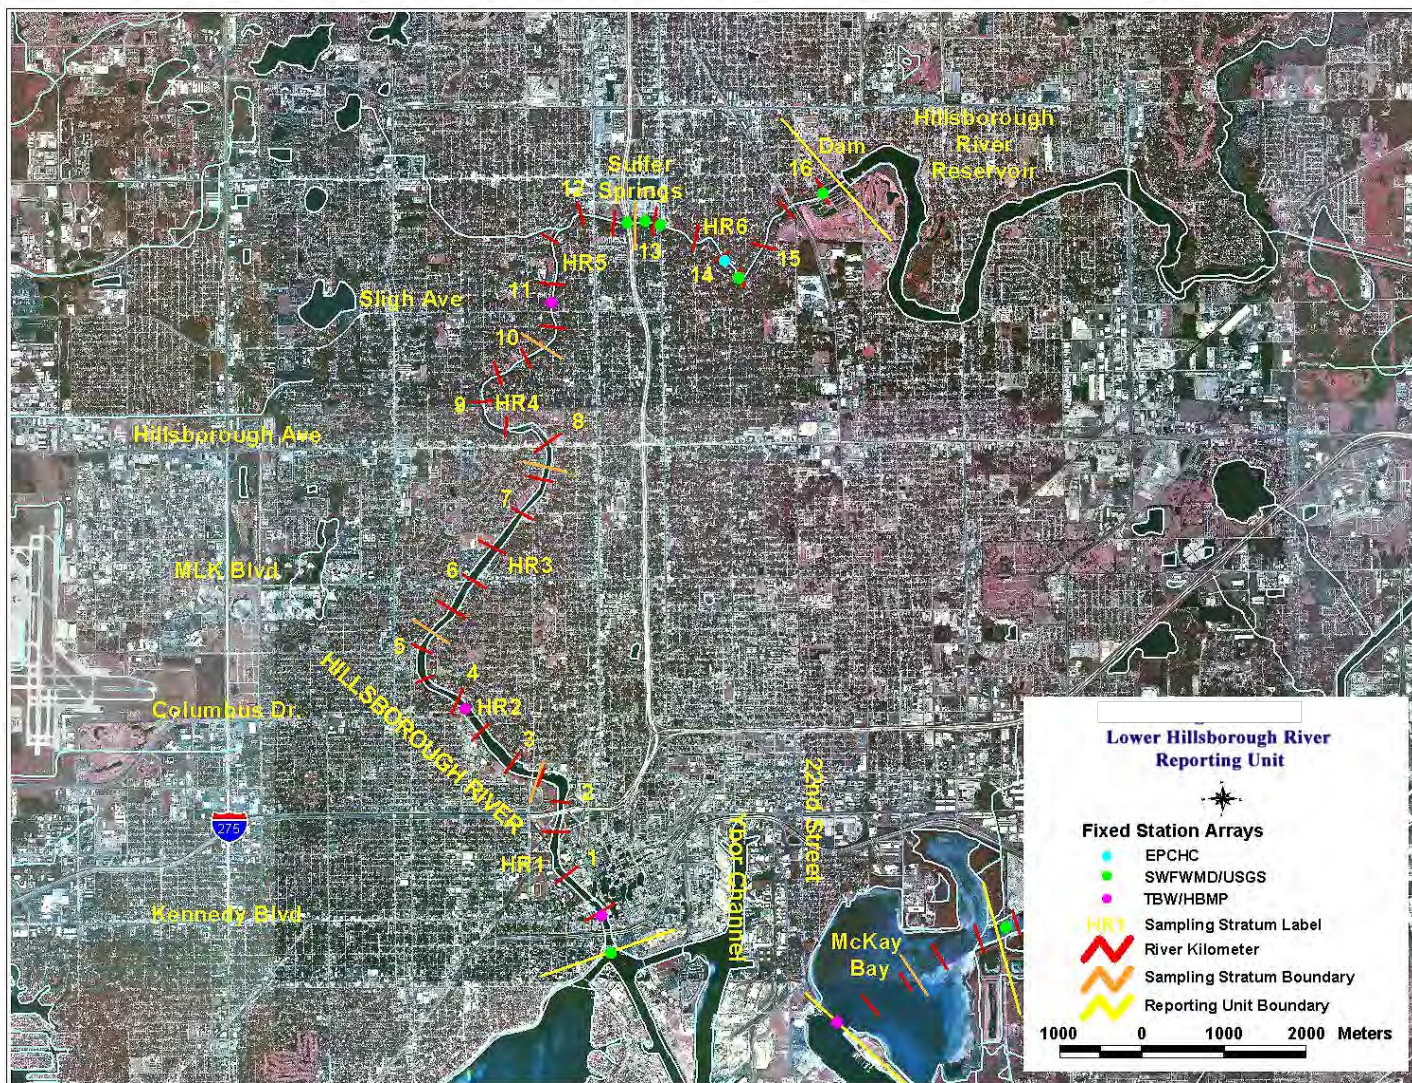


Figure 2.4.1. Lower Hillsborough River Reporting Unit

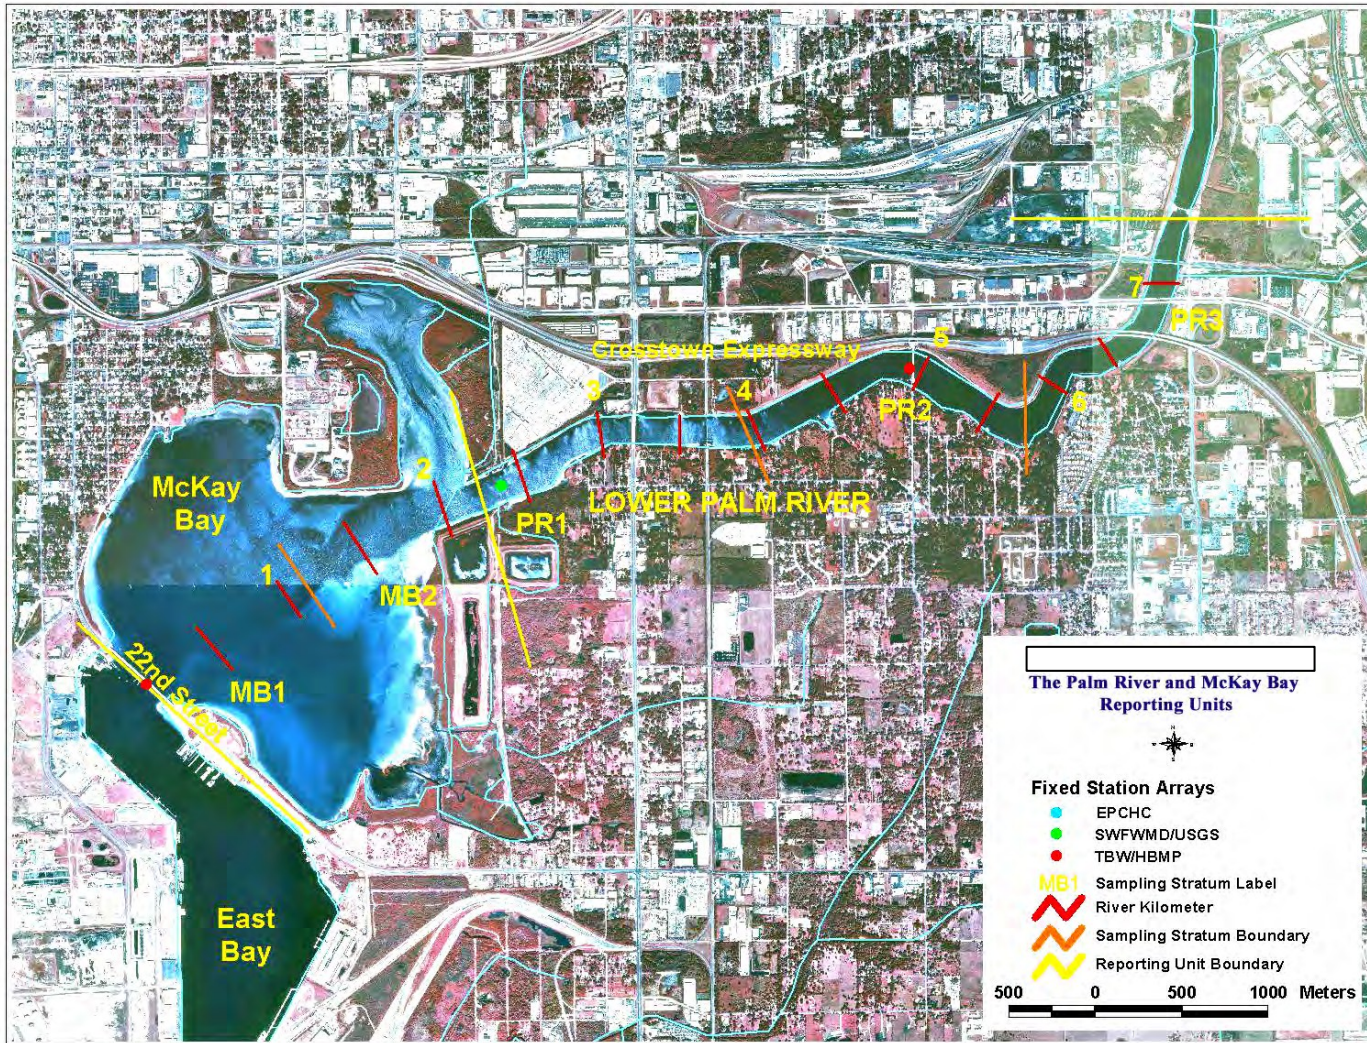


Figure 2.4.2. The Palm River and McKay Bay Reporting Units

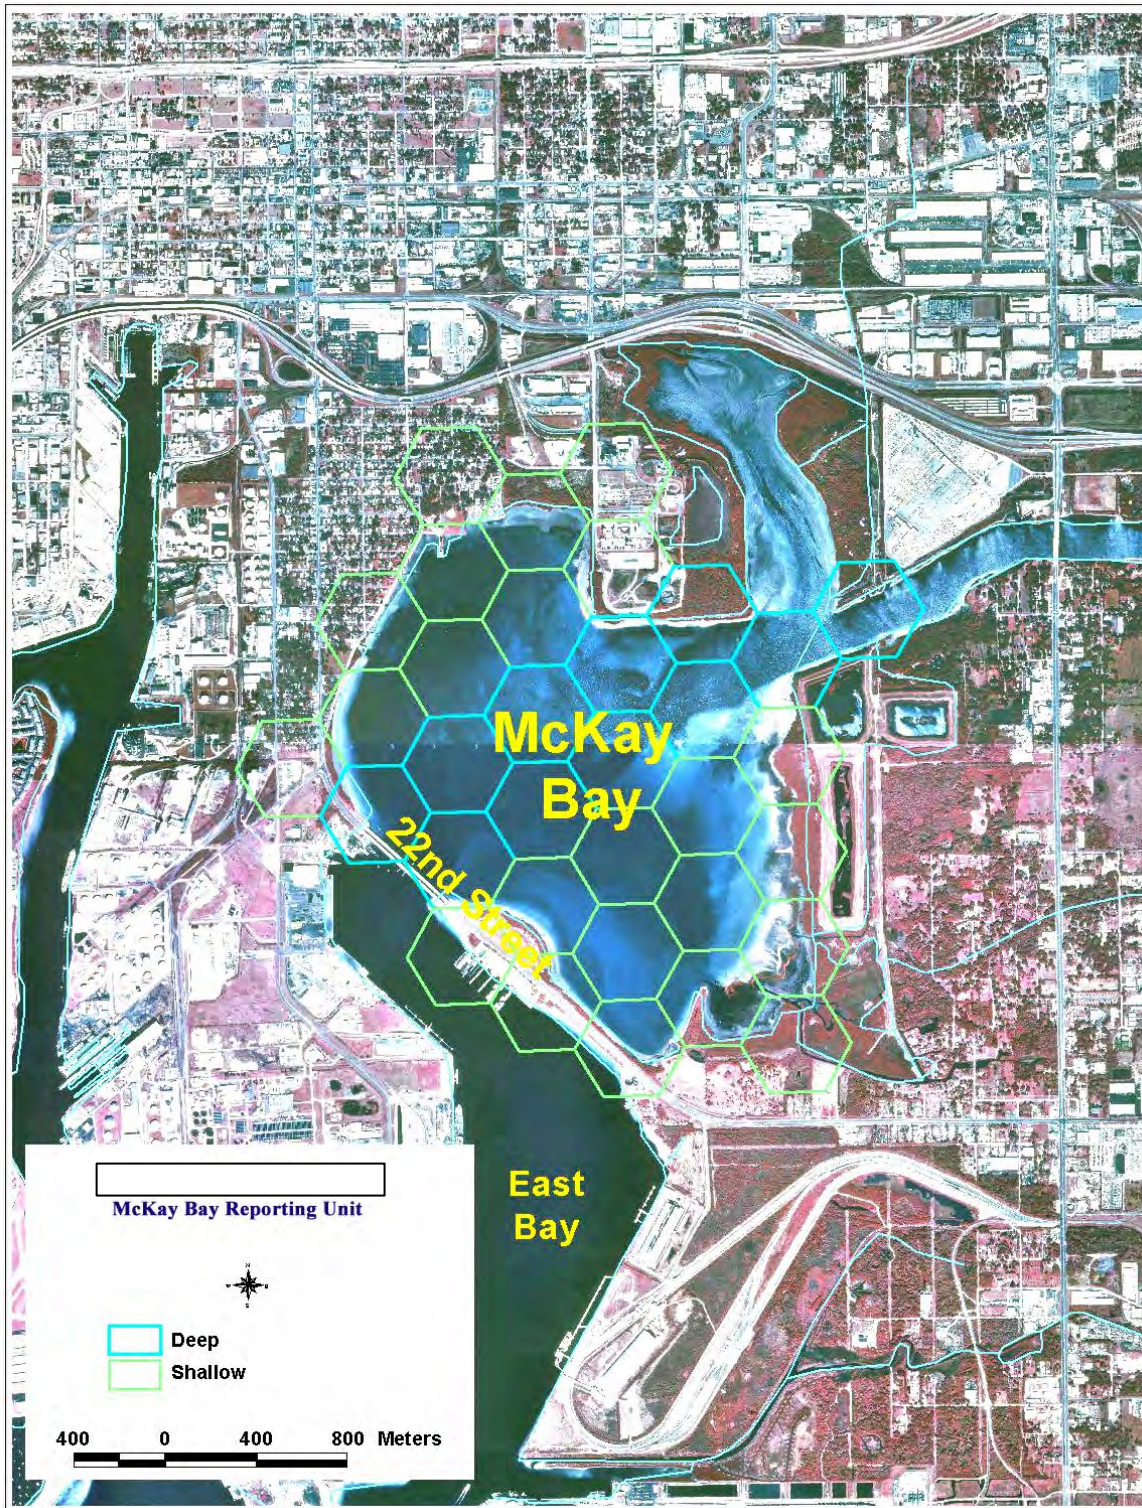


Figure 2.4.3. McKay Bay Reporting Unit

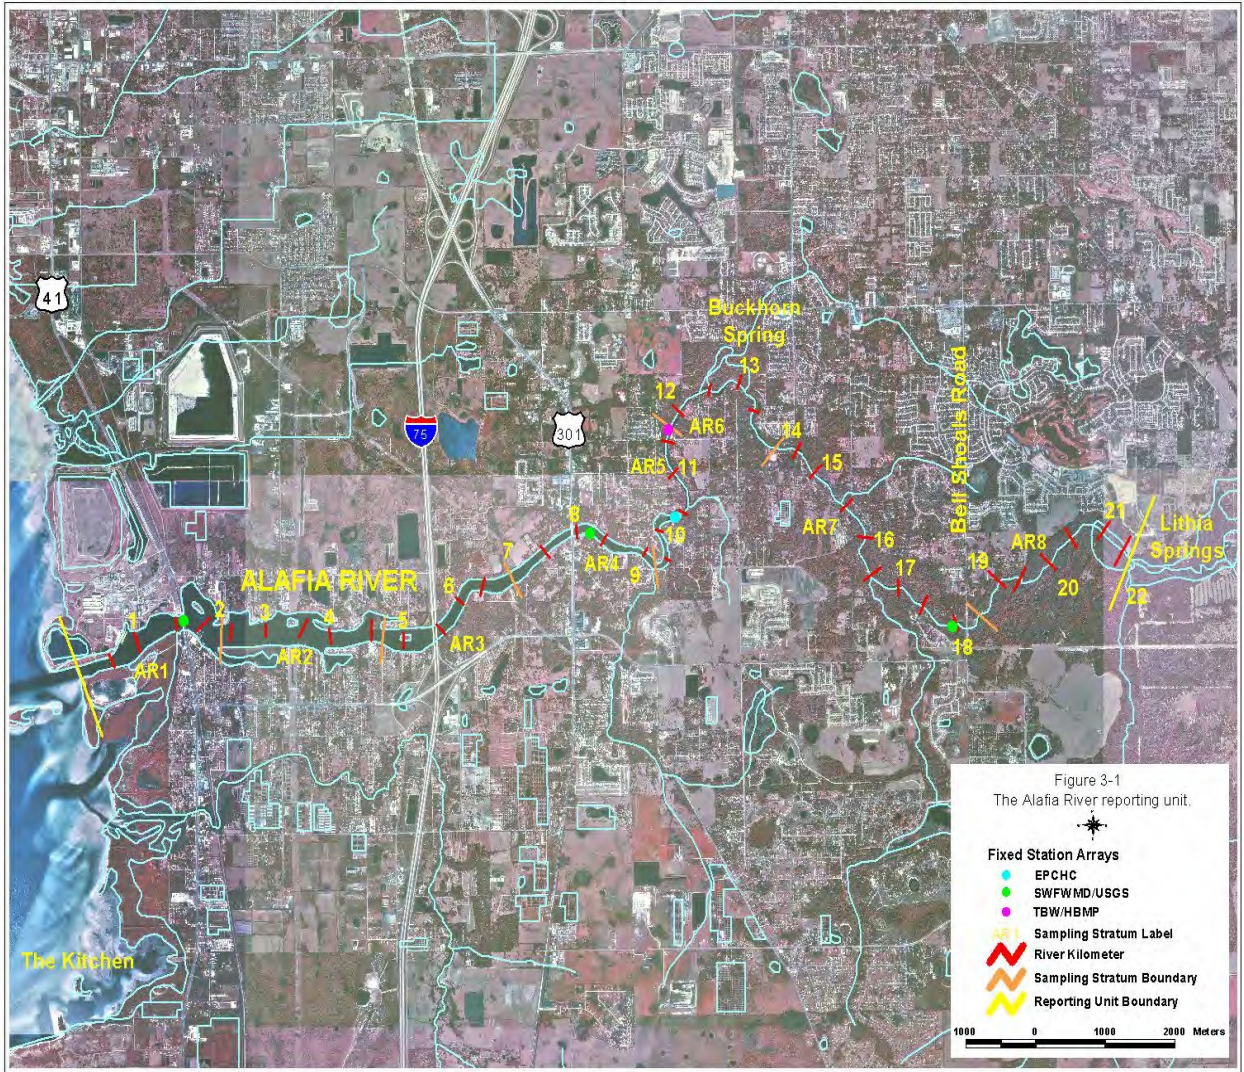


Figure 2.4.4. The Alafia River Reporting Unit



Figure 2.4.5. Hillsborough Bay Reporting Unit

3.0 Tampa Bypass Canal/Hillsborough River HBMP

3.1. Introduction

This section describes the special permit conditions, flow, water quality, and biological data collection efforts in the lower Hillsborough River, Tampa Bypass Canal (TBC), and McKay Bay conducted under the HBMP. The sampling programs for these reporting units are summarized in Tables 3.1.1 through 3.1.3 at the end of this section. Modifications to the initial HBMP sampling design and the rationale for these modifications are provided in Appendix A.

Additional information and specific procedures for sample collection and analysis are provided in the HBMP Quality Assurance and Quality Control Plan-Version 2.1 (PBS&J, 2008).

3.2. Lower Hillsborough River, Tampa Bypass Canal and McKay Bay Reporting Units

The Lower Hillsborough River (HR) reporting unit (Figure 2.4.1) extends from the mouth of the river at Platt Street to the City of Tampa Dam, covering a distance of 16.34 river kilometers. This spatial reporting unit was divided into six strata, five of equal length (2.55 km) below Sulphur Springs, and one of 3.61 km in length from Sulphur Springs upstream to the dam. These strata are used for all of the HBMP elements (i.e., water quality, benthos, adult and juvenile fish, ichthyoplankton and vegetation).

The TBC/Palm River reporting unit (Figure 2.4.2) extends from the mouth upstream to Structure S-160. This spatial reporting unit is divided into 3 strata of equal length (1.75 km). In addition to these longitudinal strata, it was also recognized during HBMP design that significant variation in both water quality and benthos might exist due to differences in depth. Therefore, both shallow and deep water substrata within each longitudinal stratum were defined in the Palm River for both water quality and benthos monitoring elements.

The McKay Bay reporting unit (Figure 2.4.3) extends from the 22nd Street Causeway to the mouth of the TBC. This spatial reporting unit was divided into 2 strata: 1) the channel that runs approximately along the centerline of the Bay; and 2) the shallow remainder of the Bay. The channel portion was further divided into 2 strata of equal length (1.1 km). Sample selection for water quality and benthic sampling locations is based on a hexagonal grid framework, similar to that used by the Environmental Protection Commission of Hillsborough County (EPCHC), except using a finer grid scale of approximately 0.2 km². These hexagons were then divided into a 1-m² grid and potential sample stations established at the 1-m² grid nodes. The hexagons, grids, and stations were generated by Janicki Environmental (PBS&J, 2000).

3.3. Lower Hillsborough River and Tampa Bypass Canal Permit Conditions

Water Use Permit 20011796.002 for the Tampa Bypass Canal (TBC)/Hillsborough River Water Supply Projects authorizes Tampa Bay Water to divert water from the Hillsborough River and withdraw water from Tampa Bypass Canal according to the schedule provided in the permit.

This permit requires that Tampa Bay Water continue to implement the approved TBC/Hillsborough River HBMP in order to address the following objectives:

- Use baseline conditions to compare the effects of the permitted water use upon streamflow rates, salinity distributions, and selected water quality and biologic variables within the lower Hillsborough River below Tampa Dam, TBC, Palm River, and McKay Bay
- Monitor diversions from the Hillsborough River and withdrawals from the TBC at the withdrawal points and evaluate streamflow data for the lower Hillsborough River at the Tampa Dam, and the TBC at the District's Structures 160 and 162
- Evaluate the ecological relationships of the lower Hillsborough River below Tampa Dam, TBC, Palm River, and McKay Bay to freshwater flows
- Monitor selected water quality and biologic variables in order to determine if the ecological characteristics of the lower Hillsborough River below Tampa Dam, TBC, Palm River, and McKay Bay relate to freshwater flow change over time
- Determine the relative effect of permitted diversions and withdrawals on any ecologic changes that may occur in the lower Hillsborough River below Tampa Dam, TBC, Palm River, and McKay Bay
- Determine if these withdrawals cause or significantly contribute to any unacceptable adverse environmental impacts to the natural resources of the lower Hillsborough River below Tampa Dam, TBC, Palm River, and McKay Bay exhibit as a result of changes in freshwater flows. The HBMP shall identify criteria that will be used to determine unacceptable adverse environmental impacts to the resources
- Coordinate with appropriate agencies that have or are currently collecting data that can be incorporated into the HBMP to avoid duplication of effort and to facilitate the most efficient use of resources.

3.4. Sampling Site Selection

All but one of the monthly sample sites (stations) for water quality, fish, benthos, and plankton are randomly selected. There is a fixed water quality sampling station at the mouth of the Hillsborough River and East Bay. This station is collocated with EPCHC water quality sampling Station 52. Sampling stations for water quality, fish, and benthos are randomly selected each month. Sampling stations for plankton were randomly selected at the beginning of the HBMP and remain fixed.

Sampling stations for the Hillsborough River and TBC are identified by stratum and location relative to the mouth of the river. Thus, the station in Hillsborough River Stratum 1, 1000 meters from the mouth of the river, is identified as "HR101000". The prefix "HR1" designates the river and stratum and the suffix "01000" identifies the distance from the mouth of the river. The "HR"

and “PR” designations identify Hillsborough and Palm River stations, respectively. All potential stations and their corresponding latitude and longitude have been determined and are listed in the project database. Stations are chosen in each stratum by randomly selecting from the list of potential stations.

Plankton sampling stations in McKay Bay are identified by the “MB” prefix and are oriented on a centerline that begins at the 22nd Street Causeway Bridge and ends at the downstream terminus of the TBC centerline. Plankton sampling in McKay Bay occurs in two strata. The naming convention for McKay Bay plankton stations follows that of the rivers with the distance designation representing meters from the 22nd Street Causeway. The TBC stations for water quality, fish, benthos, and plankton are also defined in meters from the 22nd Street Causeway.

In addition to the station location along the river’s length, the location relative to the river’s width (left, middle, or right) is also randomly selected for water quality, fish, and benthos sampling. Finally, the starting point of a day’s sample collection (e.g. river mouth or upstream boundary) is randomly selected each month for water quality.

River width and starting point selection parameters are not used for water quality, fish, or benthos sampling in McKay Bay, as the McKay Bay sampling design is not based upon linear stratification. For sampling purposes, McKay Bay has been divided into hexagons, which are further partitioned into 1-meter cells. Each potential sample station is located within a single grid cell. Stations are selected by randomly selecting a hexagon, then randomly selecting a grid cell within the hexagon. The prefix “M” and a unique suffix number that identifies the hexagon and grid cell identify McKay Bay stations.

The week in which sampling is conducted for each month is randomly selected for water quality and fish. Plankton sampling dates are chosen based upon the appropriate correspondence of tide stage with time of day. The Environmental Protection Commission of Hillsborough County (EPCHC) performs water quality and benthos sampling in Hillsborough Bay at fixed sampling stations during fixed weeks of the month or a late summer/early fall index period.

3.5. Hydrology / Water Quality

Current data collection activities for the hydrology/water quality element of the TBC/Hillsborough River HBMP are described briefly below. Specific procedures for sample collection and analysis are provided in the HBMP Quality Assurance and Quality Control Plan-Version 2.1 (PBS&J, 2008).

River flow and rainfall measurements are obtained from Tampa Bay Water maintained equipment or equipment maintained and operated by USGS. Salinity data are obtained from HBMP continuous water quality recording stations installed specifically for this project; these stations were installed in the early part of Water Year 2001.

Water quality samples and measurements are taken monthly in each of the three reporting units, lower Hillsborough River, TBC, and McKay Bay. Water quality sampling consists of a water column profile and an associated grab sample. The water column profiles measure temperature,

specific conductance, pH, salinity (calculated from specific conductance), and dissolved oxygen. These measurements are typically made at the water column surface, bottom, and 0.5 meter increments from the surface. The grab samples are analyzed by a subcontracted laboratory for parameters specific to each reporting unit. Sampling is typically conducted over a two- to three-day period. An increased number of samples are taken during the summer wet-season as shown in the HBMP sampling summary tables below. Hydrologic and water quality parameters measured in the lower Hillsborough River, TBC, and McKay Bay are shown in Table 3.5.1. In addition, the EPCHC collects water quality samples once monthly at fixed stations in Hillsborough Bay. This effort measures all water quality parameters included in the HBMP.

As described above, the HBMP maintains one continuous water quality recorder in the TBC, one in McKay Bay, and three in the Hillsborough River (Sligh Ave., Columbus Ave., and between Sligh and Columbus). These recorders were installed in Water Year 2001 as part of the HBMP and are listed in the sampling summary tables (Tables 3.7.1-3.7.3). In addition, the USGS maintains several long-term real-time water quality recorders that are used for the HBMP.

Table 3.5.1. Hydrologic and water quality parameters measured in the three reporting units.

Lower Hillsborough River	Tampa Bypass Canal Lower Palm River	McKay Bay
stream flow	stream flow	stream flow
surface water elevation	surface water elevation	surface water elevation
salinity	salinity	salinity
specific conductance	specific conductance	specific conductance
temperature	temperature	temperature
pH	pH	pH
dissolved oxygen	dissolved oxygen	dissolved oxygen
chlorophyll <i>a</i>	chlorophyll <i>a</i>	chlorophyll <i>a</i>
-----	color	color
orthophosphorus*	orthophosphorus*	orthophosphorus*
total phosphorus*	total phosphorus*	total phosphorus*
ammonia/ammonium *	ammonia/ammonium *	ammonia/ammonium *
nitrate+nitrite*	nitrate+nitrite*	nitrate+nitrite*
total Kjeldahl nitrogen*	total Kjeldahl nitrogen*	total Kjeldahl nitrogen*
total nitrogen*	total nitrogen*	total nitrogen*

*Sampling for these parameters is not specified or required in the original or the current HBMP design. These parameters have been collected during certain water years for other Tampa Bay Water projects.

3.6. Biota

Current data collection activities for the biota element of the TBC/Hillsborough River HBMP (benthic macroinvertebrates, ichthyoplankton and other zooplankton, and fish) are described

briefly below. Specific procedures for sample collection and analysis are provided in the HBMP Quality Assurance and Quality Control Plan-Version 2.1 (PBS&J, 2008).

3.6.1. Benthic Macroinvertebrates

Benthic macroinvertebrate samples are also taken monthly in each of the three reporting units. Sampling is typically conducted over a three- to four-day period. A greater number of samples are taken during the summer wet-season. Hillsborough River samples are archived in an unsorted condition in April, May, June, October, November, and December. Samples during these months were not included in the draft HBMP design. During its review of the draft HBMP design, SWFWMD requested that samples be collected during these months, but archived for potential future analysis (see Appendix A). Samples for the remainder of the year are sorted and analyzed.

The sample collection and analysis techniques of the HBMP and the EPCHC programs are the same. The EPCHC benthos-sampling program includes Hillsborough Bay. EPCHC samples once per year during a late summer/early fall index period.

Water column casts or profiles and Secchi-depth measurements are performed at each station. Sediment samples are also taken at each station to be analyzed for percent fines and organic matter content. Benthic macroinvertebrate samples are sieved and stored for later sorting and analyses by the subcontracted invertebrate taxonomy laboratory.

3.6.2. Ichthyoplankton and other Zooplankton

Plankton collections are made monthly in each reporting unit by University of South Florida (USF) staff. The sampled locations within each reporting unit were selected using a one-time stratified-random approach as described above.

Dates of sampling are chosen to correspond with the occurrence of night-time flood tides. Night-time zooplankton catches are known to be generally larger than daytime catches. This phenomenon was confirmed during preliminary sampling of the lower Alafia River prior to 2000. Similarly, existing data indicate that, during flood tides, the estuarine water column tends to contain more organisms that are moving upstream or are trying to maintain position within the estuary, whereas ebb tidal waters tend to contain more organisms that are in the process of leaving the estuary. Night-time flood tides were therefore chosen as the standard conditions for zooplankton sampling. A water column profile is performed at the end of each tow.

3.6.3. Fish

Fish sampling is conducted once monthly in each reporting unit except the TBC by Florida Fish and Wildlife Research Institute (FWRI) staff. The sampling effort in each stratum typically consists of utilizing two 21-m seines and one 6.1-m otter trawl, though some strata in the Hillsborough River are not sampled with trawls. Most of the animals traditionally sampled by the FWRI Fisheries Independent Monitoring Program are included in this effort. These include all fishes, blue crabs, stone crabs, horseshoe crabs and penaeid shrimp. A water profile is performed at each station.

3.7. Habitat / Vegetation

Current data collection activities for the habitat/vegetation element of the TBC/Hillsborough River HBMP are described briefly below. Specific procedures for sample collection and analysis are provided in the HBMP Quality Assurance and Quality Control Plan-Version 2.1 (PBS&J, 2008).

Vegetation sampling consists of interpretation of aerial photography and shoreline surveys conducted every three years during the October through December period. The boundaries of floodplain vegetation associations delineated during previous HBMP mapping events are plotted on false-color infrared aerial photographs provided by Tampa Bay Water. Paper and/or electronic versions of the photographs and boundaries are used in the field to map changes in floodplain vegetation. These photographs are supplemented with other aerial photographs if necessary. The observed vegetation-association boundaries are compared with the previous event's boundary to determine any shifts. Changes in vegetation boundaries are made by creating a copy of the previous event's coverage and editing only those polygons with changed boundaries or shapes. This procedure is designed to minimize observer bias.

If changes are identified on paper maps, the resulting polygons are digitized to create a GIS coverage for each reporting unit. Inter-annual changes in the area and extent of major vegetation associations in the reporting units are calculated by comparing the association boundaries and areas over time. These vegetation association polygons are also used to calculate linear estimates of vegetation shoreline extents. Estimation of the first and last occurrence of vegetation community indicator species (e.g., black needlerush (*Juncus roemerianus*)) for each monitoring event is based on the population occurrence of each species rather than the occurrence of individual plants of each species.

**Table 3.1.1
Sampling Program Summary for the Lower Hillsborough River Reporting Unit**

Element	Spatial Strata	Month												Total
		Jan.	Feb.	Mar.	Apr.	May	Jun.	Jul.	Aug.	Sept.	Oct.	Nov.	Dec.	
Water Quality	6 strata	1/stratum	1/stratum	1/stratum	1/stratum	1/stratum	1/stratum	1/stratum	1/stratum	1/stratum	1/stratum	1/stratum	1/stratum	72
	1 fixed bay station	1/station	1/station	1/station	1/station	1/station	1/station	1/station	1/station	1/station	1/station	1/station	1/station	12
Benthos	6 strata	2/stratum	2/stratum	2/stratum	2/stratum	2/stratum	2/stratum	2/stratum	2/stratum	2/stratum	2/stratum	2/stratum	2/stratum	144 ¹
Fish	Seine samples in 6 longitudinal strata (HR1 – HR6)	2 seines/stratum	2 seines/stratum	2 seines/stratum	2 seines/stratum	2 seines/stratum	2 seines/stratum	2 seines/stratum	2 seines/stratum	2 seines/stratum	2 seines/stratum	2 seines/stratum	2 seines/stratum	144 seines
	Trawl samples in 3 longitudinal strata (HR1 - HR3)	2 trawl/stratum	2 trawl/stratum	2 trawl/stratum	2 trawl/stratum	2 trawl/stratum	2 trawl/stratum	2 trawl/stratum	2 trawl/stratum	2 trawl/stratum	2 trawl/stratum	2 trawl/stratum	2 trawl/stratum	72 trawls
Ichthyoplankton and other Zooplankton	6 strata	2 hauls/stratum	2 hauls/stratum	2 hauls/stratum	2 hauls/stratum	2 hauls/Stratum	2 hauls/stratum	2 hauls/stratum	2 hauls/stratum	2 hauls/stratum	2 hauls/stratum	2 hauls/stratum	2 hauls/stratum	144 hauls
Hydrology/ Water Quality	Temperature, conductivity and salinity (bottom and surface) at Sligh Ave., Columbus Ave., and a third station located between Sligh and Columbus													
Vegetation/Habitat	Entire reporting unit											polygon mapping shoreline survey ²		1 1

¹ Only samples collected from January through March, and July through September (72 samples a year), are processed; the remaining samples are preserved and archived after sieving but before sorting and other analyses. Sediment samples are not collected for the archived samples.

² Conducted once every three years (Fall 2011 (WY 2012), Fall 2014 (WY 2015), etc.).

**Table 3.1.2
Sampling Program Summary for the TBC/Palm River Reporting Unit**

Element	Spatial Strata	Month												Total
		Jan.	Feb.	Mar.	Apr.	May	Jun.	Jul.	Aug.	Sept.	Oct.	Nov.	Dec.	
Water Quality	3 longitudinal strata (PR1 - PR3,) with Deep channel & shallow substrata	1 deep & 1 shallow/stratum	1 deep & 1 shallow/stratum	1 deep & 1 shallow/stratum	1 deep & 1 shallow/stratum	1 deep & 1 shallow/stratum	1 deep & 1 shallow/stratum	2 deep & 2 shallow/stratum	2 deep & 2 shallow/stratum	2 deep & 2 shallow/stratum	1 deep & 1 shallow/stratum	1 deep & 1 shallow/stratum	1 deep & 1 shallow/stratum	90
	1 Fixed Station on upstream side of S-160	1	1	1	1	1	1	1	1	1	1	1	1	12
Benthos	1 Stratum (PR1 downstream of US41) with Deep channel / shallow substrata	1 Deep 1 Shallow		1 Deep 1 Shallow		1 Deep 1 Shallow		1 Deep 1 Shallow	1 Deep 1 Shallow	1 Deep 1 Shallow		1 Deep 1 Shallow		14
Ichthyoplankton and other Zooplankton	1 Stratum (PR1 downstream of US41) in deep center channel	2 hauls/stratum	2 hauls/Stratum	2 hauls/stratum	2 hauls/stratum	2 hauls/Stratum	2 hauls/stratum	2 hauls/stratum	2 hauls/stratum	2 hauls/stratum	2 hauls/stratum	2 hauls/stratum	2 hauls/stratum	24 hauls
Hydrology/ Water Quality	Maydell Drive (temperature, conductivity, and salinity @ surface and bottom).													
Vegetation/Habitat	Entire reporting unit											polygon mapping ¹ shoreline survey ¹		1 1

¹ Conducted once every three years (Fall 2011 (WY 2012), Fall 2014 (WY 2015), etc.).

**Table 3.1.3
Sampling Program Summary for the McKay Bay Reporting Unit**

Element	Spatial Strata	Month												Total
		Jan.	Feb.	Mar.	Apr.	May	Jun.	Jul.	Aug.	Sept.	Oct.	Nov.	Dec.	
Water Quality	34 cells	3	4	3	4	3	3	10	10	10	3	4	3	60
Benthos	34 cells	3	4	3	4	3	3	10	10	10	3	4	3	60
Fish	1 shallow (seine: 26 cells) and 1 deep (trawl: 18 cells) strata	1 seine in each of 10 cells	1 seine in each of 10 cells	1 seine in each of 10 cells	1 seine in each of 10 cells	1 seine in each of 10 cells	1 seine in each of 10 cells	1 seine in each of 10 cells	1 seine in each of 10 cells	1 seine in each of 10 cells	1 seine in each of 10 cells	1 seine in each of 10 cells	1 seine in each of 10 cells	120 seines
		1 trawl in each of 4 cells	1 trawl in each of 4 cells	1 trawl in each of 4 cells	1 trawl in each of 4 cells	1 trawl in each of 4 cells	1 trawl in each of 4 cells	1 trawl in each of 4 cells	1 trawl in each of 4 cells	1 trawl in each of 4 cells	1 trawl in each of 4 cells	1 trawl in each of 4 cells	1 trawl in each of 4 cells	48 trawls
Ichthyoplankton and other Zooplankton	6 cells – fixed location stations - shallow	1 haul/ cell	1 haul/ cell	1 haul/ cell	1 haul/ cell	1 haul/ cell	1 haul/ cell	1 haul/ cell	1 haul/ cell	1 haul/ cell	1 haul/ cell	1 haul/ cell	1 haul/ cell	72 hauls
	2 strata – fixed location stations – deep channel	2 hauls/ stratum	2 hauls/ Stratum	2 hauls/ stratum	2 hauls/ stratum	2 haul/s stratum	2 hauls/ stratum	2 hauls/ stratum	2 hauls/ stratum	2 hauls/ stratum	2 hauls/ stratum	2 hauls/ stratum	2 hauls/ stratum	48 hauls
Hydrology/ Water Quality	22 nd Street Causeway (temperature, conductivity, and salinity @ surface and bottom).													
Vegetation/Habitat	Entire reporting unit											polygon mapping ¹		1

¹ Conducted once every three years (Fall 2011 (WY 2012), Fall 2014 (WY 2015), etc.).

4.0 Alafia River HBMP

4.1 Introduction

This section described the flow, water quality, and biological data collection efforts in the lower Alafia River conducted under the HBMP. The sampling program for this reporting unit is summarized in Table 4.1.1 at the end of this section. Modifications to the initial sampling design and the rationale for these modifications are provided in Appendix A.

Additional information and specific procedures for sample collection and analysis are provided in the HBMP Quality Assurance and Quality Control Plan-Version 2.1 (PBS&J, 2008).

4.2 Lower Alafia River Reporting Unit

The current lower Alafia River (AR) spatial reporting unit (Figure 2.4.4) is about 18.5 kilometers long. The estuarine portion of the river extends from the mouth to approximately river kilometer 14 (Rkm 14). This estuarine portion of the river was divided into 6 strata of equal length (2.33 km). The remaining 4.5 kilometers of the reporting unit, from kilometer 14 to kilometer 18.5 slightly upstream of Bell Shoals Road, is generally considered to be a freshwater system. An additional freshwater segment, upstream of the intake (stratum AR8, Rkm 18.5 to 21.0) was removed from the original HBMP design because the sampling methods required in this stratum were not compatible with those used in the other strata, and potential impacts related to withdrawals are most likely to be observed downstream of Tampa Bay Water's intake near Bell Shoals Road.

These strata are used for all of the HBMP study elements. An additional inset stratum for benthos sampling was defined in consultation with Hillsborough County and the SWFWMD. This stratum extends approximately 1 km upstream (Rkm 13) and 1 km downstream (Rkm 7) of the freshwater interface and includes additional sampling for portions of Strata AR4 and AR6 and all of AR5.

4.3 Alafia River Permit Conditions

Water Use Permit 2011794.01 for the Alafia River authorizes Tampa Bay Water to withdraw water from the Alafia River at Bell Shoals Road according to the schedule provided in the permit.

The original water use permit (Permit 2011794.00) required Tampa Bay Water to develop and implement an HBMP) for the Alafia River. The permit specified that the HBMP address the following objectives:

- Establish baseline conditions prior to permitted use for streamflow rates, salinity distributions, and selected water quality and biological variables within the Alafia River and its estuary

- Monitor withdrawals from the Alafia River at the withdrawal point and evaluate streamflow data for the river at all applicable locations
- Evaluate the ecological relationships of the Alafia River and its estuary to freshwater flows
- Monitor selected water quality and biological variables in order to determine if the ecological characteristics of the river and its estuary related to freshwater flow change over time
- Determine the relative effect of permitted withdrawals from the Alafia River on any ecologic changes that may occur in the river and its estuary
- Determine if these withdrawals cause or significantly contribute to any unacceptable environmental impacts that the river and its estuary exhibit as a result of changes in freshwater flows
- Coordinate with appropriate agencies that have or are currently collecting data that can be incorporated into the HBMP to avoid duplication of effort and to facilitate the most efficient use of resources.

4.4. Sampling Site Selection

All but one of the monthly sample sites (stations) for water quality, fish, benthos, and plankton are randomly selected. There is a fixed water quality sampling station at the mouth of the Alafia River. This station corresponds to EPCHC water quality Station 8. Sampling stations for water quality, fish, and benthos are randomly selected each month. Sampling stations for plankton and for fixed-station vegetation monitoring were randomly selected at the beginning of the HBMP and remain fixed.

Sampling stations for the Alafia River are identified by stratum and location relative to the mouth of the river. Thus, the station in Alafia River Stratum 1, 1000 meters from the mouth of the river, is identified as “AR101000”. The prefix “AR1” designates the river and stratum and the suffix “01000” identifies the distance from the mouth of the river. All potential stations and their corresponding latitude and longitude have been determined and are listed in the project database. Stations are chosen in each stratum by randomly selecting from the list of potential stations.

In addition to the station location along the river’s length, the location relative to the river’s width (left, middle or right) is also randomly selected for water quality, fish and benthos sampling. Finally, the starting point of a day’s sample collection (e.g., river mouth or upstream boundary) is randomly selected each month for water quality. The week in which sampling is conducted for each month is randomly selected for water quality and fish. Plankton sampling dates are chosen based upon the appropriate correspondence of tide stage with time of day.

4.5. Hydrology / Water Quality

Current data collection activities for the hydrology/water quality element of the Alafia River HBMP are described briefly below. Specific procedures for sample collection and analysis are provided in the HBMP Quality Assurance and Quality Control Plan-Version 2.1 (PBS&J, 2008).

River flow and rainfall measurements are obtained from Tampa Bay Water maintained equipment or equipment maintained and operated by the USGS. Salinity data are obtained from the HBMP continuous water quality recording station installed on the Alafia River downstream of Buckhorn Creek; this station was installed in the early part of Water Year 2001.

Water quality samples and measurements are taken once a month. Water quality sampling consists of a water column profile and an associated grab sample. The water column profiles measure temperature, specific conductance, pH, salinity (calculated from specific conductance), and dissolved oxygen. These measurements are typically made at the water column surface, at the bottom, and at 0.5 meter increments from the surface. The grab samples are analyzed by a subcontracted laboratory for the parameters listed in Table 4.6.1. Sampling is typically conducted over a two-day period.

Table 4.5.1. Hydrologic and water quality parameters measured in the Alafia River.

Lower Alafia River
stream flow
surface water elevation
salinity
specific conductance
temperature
pH
dissolved oxygen
chlorophyll <i>a</i>
color
total suspended solids
orthophosphorus* total
phosphorus*
ammonia/ammonium*
nitrate+nitrite*
total Kjeldahl nitrogen*
total nitrogen*

*Sampling for these parameters is not specified or required in the original or the current HBMP design. These parameters have been collected during certain water years for other Tampa Bay Water projects.

4.6. Biota

Current data collection activities for the biota element of the Alafia River HBMP (benthic macroinvertebrates, ichthyoplankton and other zooplankton, and fish) are described briefly below. Specific procedures for sample collection and analysis are provided in the HBMP Quality Assurance and Quality Control Plan-Version 2.1 (PBS&J, 2008).

4.6.1. Benthic Macroinvertebrates

Benthic macroinvertebrate samples are also taken once monthly in the Alafia River reporting unit. Sampling is typically conducted over a three- to four-day period. A greater number of samples are taken during the summer wet-season in an index stratum in the middle of the Alafia River. Early modeling efforts and subsequent analyses suggested that were salinity changes to occur as a result of Tampa Bay Water operations, they would most likely occur in this stratum.

Water column casts or profiles and Secchi-depth measurements are performed at each station. Sediment samples are also taken at each station to be analyzed for percent fines and organic matter content. Benthic macroinvertebrate samples are sieved and stored for later sorting and analyses by the subcontract invertebrate taxonomy laboratory.

4.6.2. Ichthyoplankton and other Zooplankton

Plankton collections are made monthly in the reporting unit by University of South Florida (USF) staff. The sampled locations within the reporting unit were selected using a one-time stratified-random approach as described above. Dates of sampling are chosen to correspond with the occurrence of night-time flood tides. Night-time zooplankton catches are known to be generally larger than daytime catches. This phenomenon was confirmed during preliminary sampling of the lower Alafia River. Similarly, existing data indicate that, during flood tides, the estuarine water column tends to contain more organisms that are moving upstream or are trying to maintain position within the estuary, whereas ebb tidal waters tend to contain more organisms that are in the process of leaving the estuary. Night-time flood tides were therefore chosen as the standard conditions for zooplankton sampling. A water column profile is performed at the end of each tow.

4.6.3. Fish

Fish sampling is conducted once monthly by Fish and Wildlife Research Institute (FWRI) staff. The sampling effort in each stratum typically consists of utilizing two 21-m seines and one 6.1-m otter trawl. The upper and lower-most strata of the Alafia River are not sampled using trawls. Additional Alafia River associated fish sampling occurs in Hillsborough Bay at the mouth of the Alafia River. This additional sampling effort was initiated in Water Year 2005 to assess fish populations that leave the Alafia River during periods of high flow (see Appendix A). Most of the animals traditionally sampled by the FWRI Fisheries Independent Monitoring Program are included in this effort. These include all fishes, blue crabs, stone crabs, horseshoe crabs, grass shrimp and penaeid shrimp. A water column profile and Secchi depth measurements are performed at each station.

4.7. Habitat / Vegetation

Current data collection activities for the habitat/vegetation element of the Alafia River HBMP are described briefly below. Specific procedures for sample collection and analysis are provided in the HBMP Quality Assurance and Quality Control Plan-Version 2.1 (PBS&J, 2008).

Riverine vegetation is mapped once every three years during the Fall index period (September through December). The boundaries of floodplain vegetation associations delineated during previous HBMP mapping events are plotted on false-color infrared aerial photographs provided by Tampa Bay Water. Paper and/or electronic versions of the photographs and boundaries are used in the field to map changes in floodplain vegetation. These photographs are supplemented with other aerial photographs if necessary. Vegetation is usually mapped by field staff in boats. The observed vegetation-association boundaries are compared with the previous event's boundary to determine shifts. Changes in vegetation boundaries are made by creating a copy of the previous event's coverage and editing only those polygons with changed boundaries or shapes. This procedure is designed to minimize observer bias.

If changes are made on paper maps, the resulting polygons are digitized to create a GIS coverage for each reporting unit. Inter-annual changes in the area and extent of major vegetation associations in the reporting units are calculated by comparing the association boundaries and areas over time. These vegetation association polygons are also used to calculate linear estimates of vegetation shoreline extents. Estimation of the first and last occurrence of vegetation community indicator species (e.g., black needlerush (*Juncus roemerianus*)) for each monitoring event is based on the population occurrence of each species rather than the occurrence of individual plants of each species.

Submerged aquatic vegetation (SAV) is surveyed once every five years. Sampling is conducted once during the SAV growing season. SAV is surveyed in two reporting units defined as the marine/brackish transitional area, and the brackish/fresh transitional area. These reporting units were identified by documenting the existing first and last occurrence of black needlerush (*Juncus roemerianus*). The mid-points of the marine/brackish and the brackish/fresh reporting units are defined as the observed downstream and upstream last occurrence of *Juncus*, respectively. The respective reporting units extend 2 km upstream and 2 km downstream from these two mid-points, therefore, both the marine/brackish and the brackish/fresh reporting units are 4 river km in length. Each reporting is divided into four spatial strata, each 1 km in length.

Under the original SAV sampling protocol, SAV was assessed at randomly-selected sampling locations in each stratum, on both the left and right sides of the river channel centerline. A revised sampling protocol has been implemented using underwater cameras. Under the revised protocol, a two transects (one on each side of the river) are surveyed for SAV along the entire 8-kilometer combined extent of the marine/brackish and brackish/fresh reporting units. The transects are surveyed by towing an underwater camera transmitting to a surface video screen. The transects are defined as the area between the side of the river channel and the water depth of two meters or less. Staff performing the survey documents the latitude and longitude of each SAV occurrence. These latitude and longitudes are converted to decimal river kilometers for reporting purposes.

In the event the video camera protocol cannot be implemented, SAV is sampling according to the original protocol. Under the original sampling protocol, a total of 36 randomly selected samples per reporting unit are collected using divers. These consist of eight samples per stratum (four samples on each side of the river). The relative percent cover of SAV plant species within a 1 m² quadrat is assessed at each sample location. The SAV sample locations are randomly selected for each event.

**Table 4.1.1
Sampling Program Summary for the Lower Alafia River Reporting Unit**

Element	Spatial Strata	Month												Total
		Jan.	Feb.	Mar.	Apr.	May	Jun.	Jul.	Aug.	Sept.	Oct.	Nov.	Dec.	
Water Quality	6 estuarine strata	2/stratum	2/stratum	2/stratum	2/stratum	2/stratum	2/stratum	2/stratum	2/stratum	2/stratum	2/stratum	2/stratum	2/stratum	144
	1 fixed bay station	1 station	1 station	1 station	1 station	1 station	1 station	1 station	1 station	1 station	1 station	1 station	1 station	12
	1 freshwater stratum (AR7)	2/stratum	3/stratum	2/stratum	3/stratum	2/stratum	3/stratum	2/stratum	3/stratum	2/stratum	3/stratum	2/stratum	3/stratum	30
Benthos	6 estuarine strata	2/stratum	2/stratum	2/stratum	2/stratum	2/stratum	2/stratum	2/stratum	2/stratum	2/stratum	2/stratum	2/stratum	2/stratum	144
	1 inset stratum						7/stratum	6/stratum	7/stratum					20
	1 freshwater stratum (AR7)	3/stratum	3/stratum	3/stratum	3/stratum	3/stratum	3/stratum	3/stratum	3/stratum	3/stratum	3/stratum	3/stratum	3/stratum	36
Fish	6 longitudinal, estuarine strata (AR1 – AR6) with shallow samples	2 seines/stratum	2 seines/stratum	2 seines/stratum	2 seines/stratum	2 seines/stratum	2 seines/stratum	2 seines/stratum	2 seines/stratum	2 seines/stratum	2 seines/stratum	2 seines/stratum	2 seines/stratum	144 seines
	3 longitudinal, estuarine strata (AR1 – AR3) with deep samples	2 trawl/stratum	2 trawl/stratum	2 trawl/stratum	2 trawl/stratum	2 trawl/stratum	2 trawl/stratum	2 trawl/stratum	2 trawl/stratum	2 trawl/stratum	2 trawl/stratum	2 trawl/stratum	2 trawl/stratum	72 trawls
	1 freshwater stratum (AR7) with shoreline seines										10 seines/stratum			10 seines
	1 bay stratum (AR0) outside river mouth	2 shoreline seines 2 offshore seines 3 trawls	2 shoreline seines 2 offshore seines 3 trawls	2 shoreline seines 2 offshore seines 3 trawls	2 shoreline seines 2 offshore seines 3 trawls	2 shoreline seines 2 offshore seines 3 trawls	2 shoreline seines 2 offshore seines 3 trawls	2 shoreline seines 2 offshore seines 3 trawls	2 shoreline seines 2 offshore seines 3 trawls	2 shoreline seines 2 offshore seines 3 trawls	2 shoreline seines 2 offshore seines 3 trawls	2 shoreline seines 2 offshore seines 3 trawls	2 shoreline seines 2 offshore seines 3 trawls	24 shoreline seines 24 offshore seines 36 trawls
Ichthyoplankton and other Zooplankton	6 estuarine (AR1 – AR6)	2 hauls/stratum	2 hauls/stratum	2 hauls/stratum	2 hauls/stratum	2 hauls/stratum	2 hauls/stratum	2 hauls/stratum	2 hauls/stratum	2 hauls/stratum	2 hauls/stratum	2 hauls/stratum	2 hauls/stratum	144 hauls
Hydrology/ Water Quality	Temperature, conductivity and salinity (bottom and surface) at a site to near Buckhorn Creek.													
Vegetation/Habitat	Entire reporting unit													1
	One 8-km stratum												Polygon mapping & shoreline survey ¹ SAV survey ²	1

¹ Conducted once every three years (Fall 2011 (WY 2012), Fall 2014 (WY 2015), etc.).

² Conducted once every five years (WY 2011, WY2016, etc.).



5.0 HBMP Data Quality and Management

Data quality and effective data management are critical components of all monitoring programs. Given the complexity of the HBMP, meeting data quality and management objectives is crucial for effective and accurate data collection and interpretation. HBMP data management activities including data collection, handling, evaluation, verification, validation, and reporting are described briefly in this section. The HBMP organizational chart is shown in Figure 5.1.1.

Additional information and specific procedures for sample collection and analysis are provided in the HBMP Quality Assurance and Quality Control Plan-Version 2.1 (PBS&J, 2008).

5.1. Data Quality Objectives

An important goal of the HBMP is the development of data quality objectives (DQOs) that are integrated with environmental data collection activities. Data quality objectives are statements that describe in precise quantitative terms the level of uncertainty that can be associated with collected environmental data, and as such provide insight into the level of certainty that can be applied without compromising the intended use of the data. Use of data quality objectives also provides statistical criteria that can aid the design of sampling strategy elements, balancing costs, and/or resource constraints.

Typically, DQOs are best developed by those identified as potential users of the data. In the absence of specific decision criteria, and the wide variety of potential uses to which the HBMP data may eventually be applied, the initial set of target DQOs are based on professional judgment, and are intended only to provide a starting point for a long-term, iterative DQO process. Consequently, these preliminary DQOs do not necessarily constitute definitive rules for accepting or rejecting results, but rather provide guidelines for continued improvement. Several iterations of the DQO process may be required as potential HBMP data users further define their specific needs.

During the collection of data under the HBMP, it is extremely important to both control and determine measurement error to the greatest extent possible. Measurement quality objectives (MQOs) are established for each sampling field method and laboratory analysis procedure. MQOs essentially represent data quality objectives based on internal and external controls (variability) associated with each type of data measurement. As such, they can be used to establish criteria for data acceptability until reliable error bounds are established for each measured response variable. As data are accumulated during the HBMP, error rates associated with each measurement are established and refinement of the initial target DQOs can be accomplished to determine the need for modifications to the sampling design and/or quality assurance/quality control (QA/QC) plan.

Initial measurements of data quality objectives for each of the various parameters can be expressed in terms of goals for accuracy, precision and completeness. These preliminary MQOs are based on estimates of the anticipated data quality, including the instrument manufacturer's specifications, sampler experience, and/or data collected during other similar studies. In general,

DQOs or MQOs are used to establish five aspects of data quality: representativeness, completeness, comparability, accuracy and precision. The MQOs are used along with both field and laboratory measurements to develop quality control criteria and to set the bounds of acceptable measurement error.

5.1.1. Representativeness

Representativeness is defined as “the degree to which the data accurately and precisely represent a characteristic of a population parameter, variation of a property, a process characteristic, or an operational condition” (Stanley and Verner, 1985). The concept of representativeness within the context of the biological monitoring program refers to the ability of the sampling effort to accurately and precisely characterize the selected environmental indicators effectively both temporally and spatially.

The design of the sampling program and the location of sampling sites provide the primary focus for defining the “representativeness” of population estimates for each reporting unit and strata. The HBMP employs a probability sampling approach that samples resources in proportion to their abundance and distribution to obtain unbiased estimates of resource characteristics and variability. The probability sampling approach applies systematic sampling to facilitate characterizations of spatial patterns and to encourage geographic coverage.

Once unbiased quantitative information on the kinds, extent, condition and distribution of resources and associated estimates of uncertainty are known, a baseline of the status of existing conditions is established. This baseline information is used to develop criteria for identifying “representativeness”, the processes and magnitude of change associated with natural variation, and changes observed over time.

The data quality attribute of “representativeness” applies not only to the overall sampling design, but also to individual measurements and samples obtained during all temporal and spatial aspects of the monitoring effort. Holding time requirements for different types of samples ensure that analytical results are representative of conditions at the time of sampling; these requirements are specified for individual indicators. In addition, the use of QA/QC samples, which are similar in composition to samples being measured, provides estimates of precision and bias that are representative of sample measurements. Therefore, as a general program objective, the types of QA samples (i.e., performance evaluation material) used to assess the quality of analytical data will be as representative as possible of the natural samples collected during the project with respect to both composition and concentration.

5.1.2. Completeness

Completeness is defined as “a measure of the amount of data collected from a measurement process compared to the amount that was expected to be obtained under the conditions of measurement” (Stanley and Verner, 1985). All study elements within the HBMP have established completeness goals of 100% for each of the various indicators being measured. However, given the probability-based sampling design being employed, failure to achieve this

goal will not preclude the within-year or between-year assessment of ecosystem condition. The major consequence of having less than 100% complete data from all expected stations is a relatively minor loss of statistical power in the areal estimate of condition. The 100% completeness goal is established in an attempt to derive the maximum statistical power from the present sampling design. Based on the experience of other monitoring programs, failure to achieve this goal usually results from the field staff's inability to sample at some stations due to logistical barriers such as insufficient depth, impenetrable substrate, or adverse weather conditions. In the limited number of instances where these conditions may be encountered, extensive efforts will be made to re-locate the station or re-sample the station at a later date. In this way, the field personnel must always strive to achieve the 100% completeness goal. In addition, established protocols for tracking samples during shipment and laboratory processing will be followed to minimize data loss following successful sample collection.

5.1.3. Comparability

Comparability is defined as “the confidence with which one data set can be compared to another” (Stanley and Verner, 1985). Comparability of reporting units and calculations, database management processes, and interpretative procedures must be assured if the overall goals of the HBMP monitoring program are to be realized. A goal of the HBMP program is to generate extensive documentation to ensure that all future efforts can be made comparable. All field and laboratory methods are described in detail and available to all field personnel and analytical laboratory staff. In addition, the comparability of laboratory measurements will be established and monitored through duplicates and/or the use of field split and duplicate performance evaluation samples. The sampling design for each of the HBMP study elements has been made flexible enough to allow for analytical adjustments, if necessary, to ensure data comparability.

5.1.4. Accuracy and Precision

The term “accuracy”, is used synonymously with the term bias within this QA/QC plan, and is defined as the difference between a measured value and the true or expected value.

Precision, by comparison, is defined as the degree of mutual agreement among individual repeated measurements. Collectively, accuracy and precision can provide an estimate of the total error or uncertainty associated with any individual measured value (Kirchner, 1983; Hunt and Wilson, 1986; Taylor, 1987). Measurement quality objectives for the various indicators are expressed separately as goals for both accuracy and precision. Accuracy and precision goals may not be definable for all parameters due to the nature of the measurement type. In order to evaluate the MQOs for accuracy and precision, various QA/QC samples will be collected and analyzed for most data collection activities.

5.2. Data Precision and Accuracy

General considerations for ensuring the precision and accuracy of field measurements and analytical laboratory results are described briefly below. Specific procedures are provided in the HBMP Quality Assurance and Quality Control Plan-Version 2.1 (PBS&J, 2008).

5.2.1. Field Measurements

Duplicate sets of field measurements are to be taken once per reporting unit per sampling day. These values (i.e., temperature, pH, DO, conductivity) will be documented as duplicates in the field notebooks and specifically used for determinations of instrument/sampling precision.

Measurements of accuracy will be based on QA/QC checks of standards at the end of each sampling event.

The precision of field measurements will be determined using the statistic “Relative Percent Difference” (RPD).

$$RPD = \{(|R1-R2|)/[(R1+R2)/2]\} \times 100$$

Where:

R1 = value of sample

R2 = value of sample duplicate

The RPD will be calculated for each duplicated pair of observations. The average or mean RPD is calculated by the formula:

$$\text{Mean}_{RPD} = \text{Sum (RPDs)} / n$$

where n = number of duplicate pairs

The standard deviation of the mean will be used to quantify precision measurements. The standard deviation of the mean is calculated by:

$$s^2_{RPD} = [\text{Sum}(X_i^2) - (\text{Sum}(X_i)^2/n)] / (n-1)$$

Where:

X_i = each calculated RPD

n = number of duplicate pairs

Hence:

$$s_{RPD} = (S^2_{RPD})^{1/2}$$

The s_{RPD} will be calculated for the previous 20 duplicates for each *in situ* field parameter. Based on such duplicate pairs, control and warning limits for precision will be calculated. Standard protocol is to define the “Control Limit” as 2 times the s_{RPD} , with the “Warning Limit” as 3 times the s_{RPD} . Using these procedures, control and warning charts can be generated to flag observations that exceed either Warning and/or Control Limits.

5.2.2. Method Detection Limits

For Method Detection Limits (MDLs), reagent-grade water is used to prepare a laboratory standard in a concentration range 1 to 5 times the estimated MDL of the specific compound of interest. If the estimated MDL is found to be correct, then seven aliquots of the standard are analyzed using the complete analytical method. The following calculations are then used to determine the MDL, and the Practical Quantification Limit (PQL).

In accordance with EPA procedures listed in 40 CFR 136 Appendix B, the MDL and PQL are determined by the following:

where: SD = standard deviation of 7 replicate measurements

MDL = 3.14 times the SD

PQL = 12 times the SD

MDLs are required to be recalculated when there are substantial changes in either the instrumentation or technique used.

5.3. HBMP Data Management

General considerations for HBMP data management (data sources, database management, and data verification) are described briefly below. Specific procedures are provided in the HBMP Quality Assurance and Quality Control Plan-Version 2.1 (PBS&J, 2008).

5.3.1. Data Sources

The HBMP is comprised of a number of separate and unique sampling efforts being conducted by each of the various members of the Project Team (see Figure 5.1.1). Certain members of the Project Team have ongoing, standardized data handling processes and verification and data storage methodologies (Florida Fish and Wildlife Research Institute, Terra Environmental, and the University of South Florida). For this reason, the initial steps: 1) logging of field and laboratory records, 2) data checking steps, 3) data review; and 4) internal QA/QC documentation, will follow the existing established protocols and will address the particularly unique criteria of each of these study elements. Raw hard copy data will be permanently maintained, and after being visually form checked for errors, will be entered into electronic format using appropriate protocols and multiple levels (both visual and automated) of checks to assure that all data quality goals are satisfied.

Some of the data used by the HBMP are provided by external sources. Examples include daily river flows, withdrawal rates, rainfall, other meteorological data, aerial photos and GIS data that are obtained on a relatively routine basis. In addition, the majority of the data to be used in assessing the status of Hillsborough Bay will come from external sources, such as EPCHC, FWRI, and SWFWMD. The schedule for retrieval of data from other sources varies based on data availability from the data provider.

Data transfer formats will be defined in consultation with the data providers. Care will be taken to ensure that all data received will be appropriately documented, to the greatest extent possible. This documentation will include definitions of variables and variable codes, units of measure, methods, and spatial definition of samples (e.g., latitude and longitude of sampling point). When possible, cross-comparisons of these data and the data collected by the HBMP will be made as an additional quality assurance check.

Historical data from other sources will also be used in the analysis of the HBMP data. The HBMP data management process will support data retrieval and documentation from all of these

other sources to ensure the data from these sources are correctly linked with the primary HBMP data sources.

5.3.2. Database Management

The HBMP data are housed within a relational Microsoft Access database. Data for each reporting element (water quality, fish, plankton, etc.) are stored in a series of tables that are relational to each other and separate from the other reporting elements. Export of data from Access to other software applications such as Excel (or other spreadsheets), SAS, and HTML for Internet applications will be facilitated through the use of this standardized data application. The use of a relational database ensures that many different data types can be effectively linked using common variable names and values.

Data from each HBMP study element, as well as other outside sources (SWFWMD, USGS, EPCHC, etc.), will have appropriately organized primary keys in order to properly link the data tables and retain the relational integrity of the data. Examples of primary key variables include, but are not be limited to: sampling group, date, time, reporting unit, stratum/substratum, and station location (such as river kilometer). Typically, the data for a given HBMP program element will be aggregated by year and month within the data set.

The “condition field” of all HBMP data which has been entered, checked through at least two steps for errors, and received the application of any necessary reduction methodologies (dilutions, calculations of species numbers, etc.) will remain designated as “raw” until undergoing further steps in the data validation protocol.

5.3.3. Data Verification

Following the entry, logging, and checking of all “raw” data, error and range checking procedures for data verification purposes will be performed. During the verification process, specific data conditions will be noted using appropriate “data qualifier” designations. Standard DEP/EPA data qualifier codes will be used, as needed, in the appropriately identified database field. Only after all such appropriate levels of data validation have been completed, will the “condition field” within each specific data record be changed from “raw” to “verified”. Only the database manager and his/her designees will have read/write abilities at this level. All other database users will be provided with read-only access to data that has been listed as “raw” and is in the verification process. Any errors and/or other changes of data made between the “raw” and “verified” status must be fully explained in the appropriate “note field,” and a permanent written record of any such changes will be maintained by the QA/QC Officer.

Cross comparison of “verified” data from the different HBMP elements allows further, subsequent, “validation” of each specific data entry. Final review of the data in this Verified Data Set will also include any other cross comparisons, for example, between field and laboratory data, or between taxonomic experts. Only after final QA/QC review of each specific subset of data (monthly for water quality, quarterly for most other project study elements) will the QA/QC Officer update the “verified” status of the data to “validated”. Only under unusual circumstances will data not designated as “validated” be made available for general

dissemination. The QA/QC Officer, after final review with the appropriate specific project leaders, will be responsible for applying the final “data qualifier” and “data flags” within the database. These will be used to inform the end-users of the data of any problems that may have been found to exist in the data that could not be reconciled during the verification and validation checks of the data. In addition to the standard “data qualifiers”, three levels of “data flags” will be used in a separate data field. These include:

- **accepted** - this type of designation will be used to designate data that has successfully met all established QA/QC protocols, procedures and standards. *End users should encounter few, if any, difficulties utilizing data with this designation.*
- **rejected** - this designation will be used to indicate data that did not meet a significant element of the established QA/QC protocols, procedures or standards. Specific notes within the database will explain all such designations (i.e., chlorophyll *a* filters were not appropriately frozen and arrived at the Laboratory in an unacceptable condition). *End users should never use any data with such a designation.*
- **provisional** - such data was collected, passed almost all of the required QA/QC protocols, but failed some minor QA/QC procedure or standard. Such problems will be noted in the database (i.e., the water chemistry sample for color was analyzed 1 hour outside its required hold time). *Even though such values have a high probability of being representative of actual conditions, such data should probably be used with caution.*

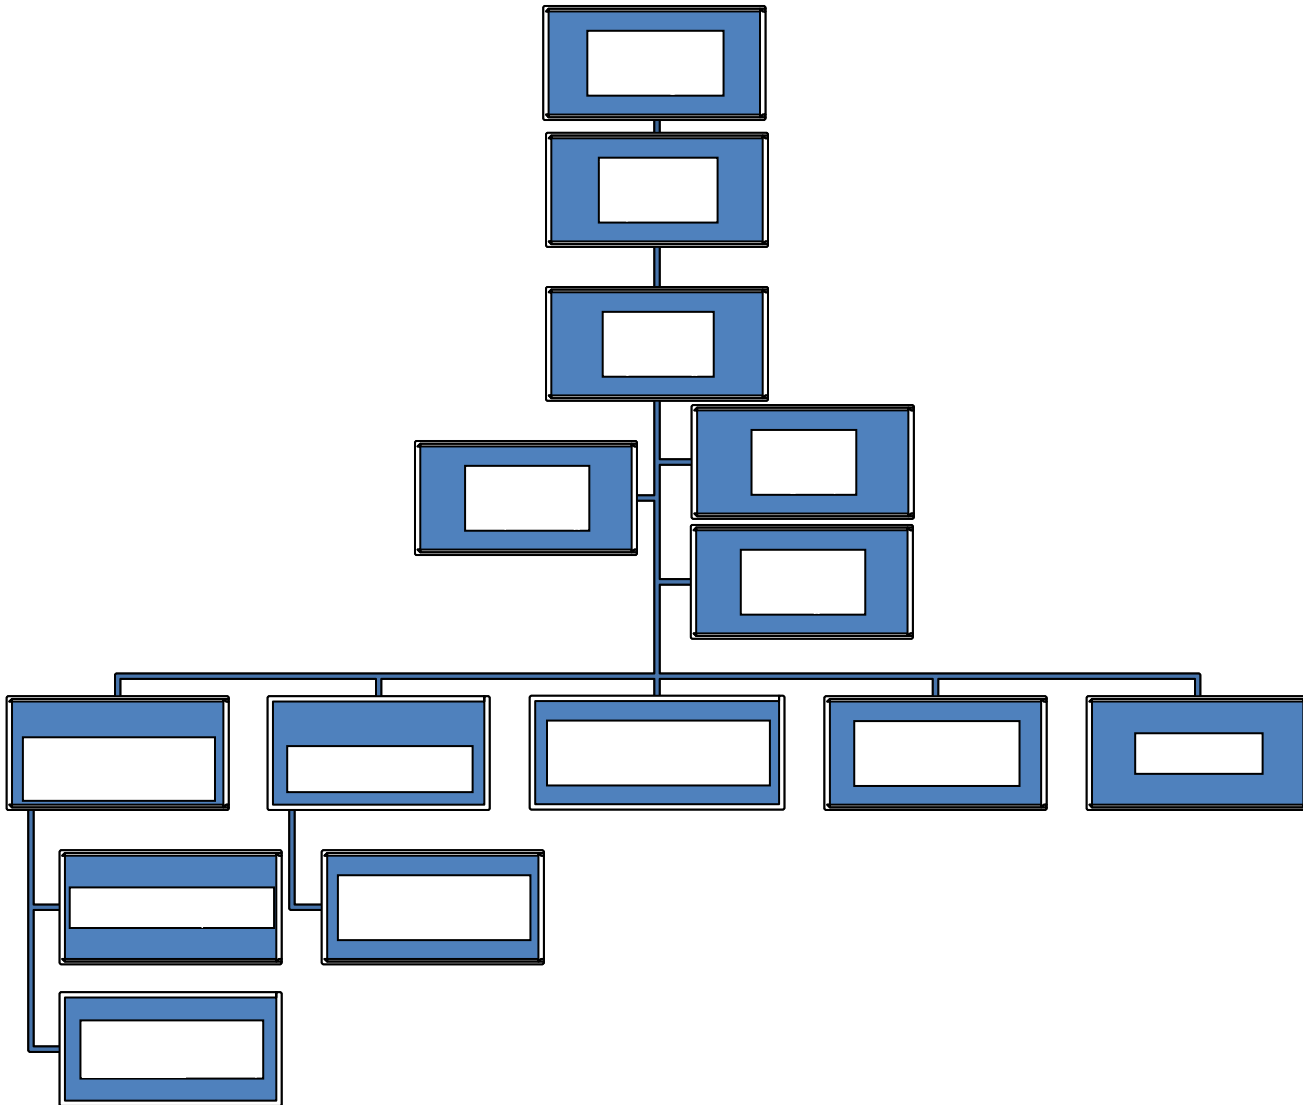


Figure 5.1.1. HBMP Organizational Chart

6.0 HBMP Reporting and Future Program Modifications

This section provides a brief summary of the HBMP reporting process and potential refinements to the program. The HBMP was intended to be routinely modified based on field conditions and the ongoing evaluation of HBMP data; recommendations are provided in HBMP reports and discussed at Annual Meetings. Previous modifications based on requests by the District and other stakeholders, logistical issues during implementation, and HBMP data evaluations are provided in Appendix A. All modifications approved by the District through July 2010 and incorporated into the program are provided in this section. It is anticipated that additional modifications will be made in the future to ensure cost-effective and appropriate monitoring relative to the objectives of the HBMP.

6.1. Reporting

The Southwest Florida Water Management District water use permits require that the HBMP results be submitted to SWFWMD in one of two report types: Annual Data Reports, and multi-year Interpretive Reports currently required once every five years for the TBC/Hillsborough River and once every three years for the Alafia River. General report requirements and methods used for data analysis are described briefly below.

6.1.1. TBC/Hillsborough River HBMP

Southwest Florida Water Management District (SWFWMD) Water Use Permit 2011796.002 for the Tampa Bypass Canal (TBC) and Hillsborough River requires that the HBMP results be submitted to SWFWMD annually in one of two types of reports. During most years, Tampa Bay Water is required to submit a HBMP Annual Report which includes all raw data collected by the HBMP for the preceding October 1st through September 30th water year. The permit requires an HBMP Annual Report in tabular form with text limited to an explanation of variable names and a description of any problems encountered or important observations made during the monitoring year. Once every five years (in July 2010, July 2015, July 2020, and July 2025), Tampa Bay Water is required submit a multi-year HBMP Interpretive Report.

The permit states the interpretive report will include comprehensive analyses of data collected by the HBMP and relevant data collected by other entities. These analyses are to be qualitative and/or quantitative and meant to evaluate the interactions of hydrologic conditions and withdrawals on streamflow, nutrient loading, salinity distributions, and the response of related water quality and biological variables in the lower Hillsborough River below the Tampa Dam, TBC, Palm River, and McKay Bay. The HBMP Interpretive Reports also include an appendix that provides tables of raw data collected by the HBMP during the previous water year thus fulfilling the requirement of the annual report for that year.

6.1.2. Alafia River HBMP

SWFWMD Water Use Permit 2011794.01 for the Alafia River states that HBMP reports will be submitted to the District according to the time frame established in the final approved HBMP plan. The periodic cycle for these reports will include yearly data reports and periodic

interpretive reports. The 1999 HBMP design (PBS&J, 2000) established a schedule for interpretive reports after Water Year 2003 and Water Year 2005 (July 2004 and 2006 respectively). A three year interval for interpretive reports (July 2009, July 2012, July 2015, etc.) was proposed during the Water Year 2006 annual meeting and subsequently approved by SWFWMD.

The Alafia River water use permit requires the submission of an annual data report of all raw data collected during the past water year. These reports are to be in tabular form with text limited to an explanation of variable names and a description of any problems encountered or important observations made during the monitoring year. The water use permit describes the required interpretive reports as including comprehensive analyses of all data collected to date that specifically address the objectives of the HBMP. It also states that qualitative and quantitative analyses shall be presented to evaluate the interactions of hydrologic conditions and withdrawals on streamflow, inundation of the river channel and its floodplain, nutrient loading, salinity distributions in the estuary, and the response of related water quality and biological variables. Like the Hillsborough/TBC interpretive reports, the Alafia River interpretive reports must also include an appendix that provides raw data collected by the HBMP during the previous water year in order to fulfill the requirement for the annual data report for that year.

6.2. Data Analysis

HBMP annual data reports and interpretive reports have used a number of methods to report and analyze data. Several of the most common are described briefly below.

6.2.1. Descriptive Statistics and Time Series

The HBMP has used descriptive statistics and descriptive time series to characterize all rainfall, hydrological, water quality and biological data. These data have also been compared to same day and lagged flow terms to ascertain relationships between these parameters and flow. Standard diversity measurements have been used to characterize and compare biological data. In addition, the first and last occurrences of organisms by distance up the river have been calculated and analyzed for particular groupings and other patterns.

6.2.2. HBMP Elements / Indicators

Since 2001, the HBMP has reviewed the characteristics and patterns of numerous physical, chemical, and biological parameters collected and/or analyzed by the HBMP, Minimum Flows Determination efforts, or similar programs in the HBMP study area. These programs have identified a subset of parameters/indicators that appear to be most useful in describing conditions and potential changes within the study area. These parameters shared certain characteristics. One of the most important characteristics was that the parameter/indicator was present and can be measured with sufficient frequency and/or in sufficient numbers to be statistically significant. The rivers and bays in the study area experience natural seasonal variations, so season absences of useful parameters are to be expected. However, parameters/indicators that are not present in sufficient frequency or numbers during at least part of the year have typically not been useful in

HBMP Reporting and Future Program Modifications

assessing status or trends within the rivers and bays of interest. HBMP parameters by monitoring element, potential effects of withdrawals, and SWFWMD MFL resources of concern are shown in Table 6.2.1.

HBMP Reporting and Future Program Modifications

Table 6.2.1 HBMP Elements/Indicators and SWFWMD MFL Resources of Concern

Element / Indicator	Potential Withdrawal Effects	MFL Resource of Concern/ Management Goals	Approved Design Modification ¹
Hydrology/Water Quality			
Salinity	↑ salinity	Maintain river bottom areas within appropriate salinity zones for the protection of benthic macro-invertebrate communities. Maintain suitable salinity regime for oysters	Added recorders/ fixed stations (2001)
Dissolved Oxygen	↑ or ↓ dissolved oxygen	Determine changes in low DO concentrations	Discontinued recorders (2004)
Chlorophyll-a	↑ or ↓ chlorophyll-a	Determine changes in distribution and probability of high chlorophyll-a	--
Specific Conductance	↑ specific conductance	--	--
Temperature	↑ or ↓ temperatures	--	--
pH	↑ pH values	--	--
Secchi Disk Depth	↑ or ↓ Secchi disk depth	--	--
Light Transmission	↑ or ↓ light transmission	--	--
Stream Flow	↓ streamflows	--	--
Water Level	↓ water elevations (upper river)	--	--
Color	↓ color	--	--
Total and Dissolved Organic Carbon	↓ TOC, ↓ DOC	--	Discontinued (2004)
Total Suspended Solids	↑ or ↓ TSS	--	--
Biotic Indicators			
Benthic Macroinvertebrates	Δ species composition, abundance, distribution; seasonal, archive, Alafia inset stratum	Maintain river bottom areas within appropriate salinity zones for the protection of benthic macroinvertebrate communities. Maintain suitable salinity regime for oysters	Redistributed sampling (2008)
Ichthyoplankton/ Zooplankton	Δ species composition, abundance, distribution	Protect nursery function by maintaining distribution and abundance of important fish and invertebrate taxa	Redistributed sampling (2008)
Adult/Juvenile Fishes	Δ species composition, abundance, distribution	Protect nursery function by maintaining distribution and abundance of important fish and invertebrate taxa	Added stratum Alafia River Delta (2005); redistributed sampling (2008)

HBMP Reporting and Future Program Modifications

Water-Dependent Birds	Δ species composition, abundance, distribution		Discontinued McKay Bay (2004); added Alafia Banks (2005-2008)
Habitat			
Emergent Vegetation	Δ species composition, abundance, distribution	Maintain surface isohaline locations within ranges that protect distribution of low-salinity shoreline vegetation communities	Eliminated Alafia fixed station (2008); reduced frequency (2004)
Submerged Vegetation	Δ species composition, abundance, distribution		Decreased frequency (2001)
Sediment Grain Size and Organic Matter			--
<u>Note</u> 1. Approved change from initial HBMP design (see Appendix A).			

6.2.3. HBMP Biotic Parameters of Interest

A large number of fish and invertebrate species in various life stages have been collected during the duration of the HBMP. Only a small number of these occur with sufficient frequency and abundance to allow for meaningful analyses. Even smaller subsets appear to have potential direct or indirect relationships to river flow. The species and groups that have been most informative in HBMP analyses to-date for the TBC/McKay Bay, the lower Hillsborough River and the lower Alafia River are listed in Tables 6.2.2-6.2.4.

HBMP Reporting and Future Program Modifications

Table 6.2.2 HBMP Key Biotic Indicators: TBC and McKay Bay

<p><u>Fish</u></p> <ul style="list-style-type: none">• <i>Anchoa mitchilli</i> (bay anchovy)• <i>Farfantepenaeus duorarum</i> (pink shrimp)• <i>Floridichthys carpio</i> (goldspotted killifish)• <i>Mugil cephalus</i> (striped mullet). <p><u>Plankton</u></p> <ul style="list-style-type: none">• <i>Anchoa mitchilli</i> juveniles (bay anchovy)• <i>Americamysis almyra</i> (opossum shrimp)• <i>Mnemiopsis mccradyi</i> (comb jelly)• decapod zoeae (crab larvae). <p><u>Benthos</u></p> <ul style="list-style-type: none">• <i>Laonereis culveri</i>• <i>Grandidierella bonnieroides</i>• <i>Mytilopsis leucophaea</i>• <i>Tagelus plebeius</i>• <i>Edotea triloba</i>.
--

Table 6.2.3 HBMP Key Biotic Indicators: Lower Hillsborough River

<p><u>Fish</u></p> <ul style="list-style-type: none">• <i>Anchoa mitchilli</i> (bay anchovy)• <i>Menidia</i> spp. (silversides)• <i>Microgobius gulosus</i> (clown goby)• <i>Trinectes maculatus</i> (hogchocker)• <i>Pseudotaxon</i> "freshwater obligates" (combined genera <i>Notropis</i> (shiners), <i>Lepomis</i> (sunfishes), <i>Notemigonus</i> (shiners), <i>Ameiurus</i> (catfishes), and <i>Labidesthes</i> (silversides))• <i>Palaemonetes pugio</i> (daggerblade grass shrimp). <p><u>Plankton</u></p> <ul style="list-style-type: none">• <i>Americamysis almyra</i> (opossum shrimp)• <i>Clytia</i> spp. (hydromedusa)• decapod zoeae (crab larvae)• <i>Mnemiopsis mccradyi</i> (comb jelly)• <i>Anchoa mitchilli</i> juvenile stage (bay anchovy)• <i>Trinectes maculatus</i> postflexion larvae (hogchoker). <p><u>Benthos</u></p> <ul style="list-style-type: none">• <i>Stenonineiris martini</i>• <i>Laonereis culveri</i>,• <i>Capitella capitata</i> species complex• <i>Corbicula fluminea</i>• <i>Grandidierella bonnieroides</i>.
--

HBMP Reporting and Future Program Modifications

Table 6.2.4 HBMP Key Biotic Indicators: Lower Alafia River

<p><u>Fish</u></p> <ul style="list-style-type: none"> • <i>Anchoa mitchilli</i> (bay anchovy) • <i>Callinectes sapidus</i> (blue crab) • <i>Leiostomus xanthurus</i> (spot) • <i>Menidia</i> spp. (silversides) • <i>Sciaenops ocellatus</i> (red drum). <p><u>Plankton</u></p> <ul style="list-style-type: none"> • <i>Anchoa mitchilli</i> • <i>Brevoortia smithi</i> • <i>Cynoscion arenarius</i> • <i>Gobiesox strumosus</i> • <i>Trinectes maculatus</i> • Order Mysidacea (mysid shrimps) • <i>Americamysis almyra</i> • <i>Acartia tonsa</i> • <i>Edotea triloba</i> • <i>Mnemiopsis mccrady</i> • <i>Palaemonetes pugio</i>. <p><u>Benthos</u></p> <ul style="list-style-type: none"> • <i>Chironomus</i> spp. • <i>Corbicula fluminea</i> (Asian clam) • <i>Cyathura polita</i> (Isopoda) • <i>Edotea triloba</i> (Isopoda) • <i>Grandidierella bonnieroides</i> • <i>Laeonereis culveri</i> (Culver's sandworm) • <i>Mytilopsis leucophaeata</i> (dark false mussel) • <i>Polymesoda carolinae</i> (Carolina marsh clam) • <i>Polypedium halterale</i> group larvae (Diptera) • <i>Tagelus plebeius</i> (stout razor clam). 	
<p><u>Vegetation</u></p> <p>Mangrove Swamp</p> <p>Needlerush</p> <p>Needlerush/Leather Fern</p> <p>Wetland Hardwood Forest</p> <p>Mixed Herbaceous Wetland</p> <p>Cattail</p> <p>Brazilian Pepper</p> <p>Needlerush/Cattail</p> <p>Wetland Coniferous Forest</p> <p>Common Reed, Sawgrass, Cordgrass</p> <p>Popash/Willow</p>	

6.2.4. Center of Abundance

Center of abundance (COA) statistics describe the average position of occurrence for a given taxon over the sampling time period. For the linear riverine reporting units that are divided into spatial strata along a gradient, the COA can be described in terms of river kilometer (Rkm). Center of abundance was calculated by weighting the location of occurrence by the number of organisms of the given species collected at that location.

6.2.5. Abundance Weighted Salinity

Abundance weighted salinity (AWS) is a statistic that describes the salinity range in which a given taxon is found to be most abundant. Abundance weighted salinity weights the salinity at each sample collection site by the number or density of organisms of the given species collected at that location.

6.2.6. Dissolved Oxygen and Chlorophyll-a Thresholds and Exceedances

Water quality data collected by the HBMP to date have been used to develop logistic regression models to evaluate the potential effects of Tampa Bay Water withdrawals on water quality (dissolved oxygen and chlorophyll-a) within the HBMP reporting units. These models predict the probability of a sample being in exceedance of a threshold value. The exceedance thresholds used were obtained from independent scientific studies by the SWFWMD, the University of South Florida, and the Tampa Bay Estuary Program (TBEP). These studies were based on data from HBMP rivers and other tidal streams in southwest Florida. These models have been validated with additional data for successive interpretive reports.

6.2.7. Hydrodynamic Models

The HBMP has applied hydrodynamic models developed by the District for minimum flows analyses and other assessments of flow-related changes in estuarine systems. For HBMP analyses, these models have been applied to compare baseline and withdrawal scenarios. The first scenario uses actual, observed river flows that occurred downstream of the withdrawal locations to model daily conditions along the entire length of the reporting units during the periods in question. The second scenario adds the daily volumes of water diverted by Tampa Bay water to the observed river flows to “reconstruct” the flows that would have occurred in the absence of Tampa Bay Water operations. Modeled salinity conditions using observed flows have been compared to modeled salinity conditions using reconstructed flows to estimate the daily effect of Tampa Bay Water operations on water quality conditions and salinity regimes in the reporting units.

6.3. Potential Future Program Modifications

In an effort to improve the utility of information generated by the HBMP to detect potential effects of changes in flow on the five reporting units, several minor modifications to HBMP elements have been proposed. These were described in the Alafia River 2009 Year 10

Interpretive Report and the TBC/Hillsborough River 2010 Year 10 HBMP Interpretive Report, and discussed at the 2009 and 2010 HBMP Annual Meetings. The recommended modifications are summarized in the following sections.

6.3.1. Annual Reporting

As discussed at the 2010 HBMP Annual Meeting, current routine annual data reporting requires significant resources that may be better utilized. There was consensus that current HBMP reporting requirements be reviewed with the District and revised as appropriate.

6.3.2. Hydrology/Water Quality

The continuous salinity recording station below Buckhorn Springs on the Alafia River is located on a former speed zone sign piling that is becoming increasingly unstable. In Water Year 2008, the District gave approval to relocate this station just upstream or downstream of the current location. Suitable speed zone pilings are present just upstream of the Buckhorn Springs location. A long-term, EPCHC maintained continuous recorder location is also located just downstream of Buckhorn Springs. In the near future, this station may be relocated to the upstream location or data from the ECPHC station may be used for this HBMP data collection effort.

6.3.3. Benthic Macroinvertebrate Sampling (Special Studies)

Based on HBMP data collected to-date and numerous evaluations completed by Tampa Bay Water, the Southwest Florida Water Management District, the University of South Florida and others, the utility of the benthic program for detecting potential changes associated with Tampa Bay Water's permitted withdrawals has been limited. HBMP modifications that maintain or increase the ability of the benthic monitoring element to detect changes related to withdrawals for public supply while maintaining or reducing costs would be a valuable modification to the current program.

Suggested possible changes to the benthic invertebrate sampling element of the HBMP include:

- Concentrating benthic sampling effort in the Alafia River to improve statistical power
- Using seasonal index periods to characterize the benthos community as an alternative sampling strategy to the current design which requires year-round sampling
- Utilizing benthic taxa collected during sampling for the plankton element to characterize potential withdrawal-related changes in benthic indicators.

Each of these changes and supporting analyses are described briefly below. It is anticipated that the results of studies described below will be used in a re-evaluation of the entire benthos sampling program design that will be completed and presented at the 2011 or 2012 HBMP Annual Meeting.

6.3.3.1. Redirected Alafia River Sampling

As a result of statistical power analyses conducted in 2008, the Alafia River fish sampling program was modified after Water Year 2008. The power analyses concluded that the number of trawl samples in the upper river strata containing only one species or no individuals at all was making it difficult for the sampling program to detect statistically significant changes of a 15% magnitude. As a result, trawl sampling was concentrated in the mid to lower river strata where models predicted the most salinity fluctuations as a result of withdrawals. This was accomplished by discontinuing upstream trawl samples and increasing mid and lower strata trawl samples accordingly.

The power analyses also concluded that Alafia River samples with only a single species present or no benthic macroinvertebrates were reducing the benthic sampling program's ability to measure a statistically significant 15% change, suggesting that the Alafia River benthic program might be improved by concentrating sampling effort. Samples could be concentrated by shifting them out of the upper and lower strata into the middle strata where the greatest salinity changes are predicted. Samples could also be concentrated by shifting samples to certain "index period" months when withdrawals might have the greatest potential effect on benthic macroinvertebrates. The probability of collecting a benthic sample with just one species or with no organisms is greater in some months. This characteristic of the Alafia River will need to be taken into account if samples are concentrated in time and/or space.

6.3.3.2. Benthos Sampling Design Re-Evaluation

The results of preliminary analyses (Janicki Environmental, 2009) suggest that if the HBMP goal is to optimize the benthic element for statistical power to detect inter-annual differences in means for common community metrics, a sampling window incorporating months between December and May would yield the highest power in general. This time period tended to have higher CPUE, higher diversity and a lower frequency of null catches. This time period also coincides with recruitment windows for many estuarine dependent fish species of commercial and recreational value that prey on benthic taxa.

6.3.3.3. Compare Benthic and Zooplankton Samples

As discussed at the 2010 HBMP Annual Meeting, several macroinvertebrate groups collected in the plankton sampling effort are reported as grouped taxa and not identified to lower taxonomic levels. Many of these taxa also occur in the benthic samples.

It is possible that plankton sampling alone might be sufficient to provide information on that portion of the benthic community that is most susceptible to changes in flow and withdrawal. Alternatively, analyses may reveal that certain benthic taxa could be identified to a higher taxonomic level than currently utilized. These analyses could also determine if a coordinated plankton and benthic sampling program should be utilized.

For this special study, archived samples collected under the ichthyoplankton element would be selected, specific lumped taxa would be analyzed to lower taxonomic levels, and the occurrence

of macroinvertebrate taxa in the plankton and benthic samples would be evaluated relative to the objectives of the HBMP.

Field sampling of benthic populations would continue as specified under the current HBMP. However, these samples would be archived in alcohol for potential future sorting and taxonomic identification pending the results of additional analyses on archived plankton samples. It is anticipated that the results of these additional taxonomic analyses can be completed in time for presentation at the 2011 HBMP annual meeting.

6.3.4. Fish and Freshwater Inflows (SWFWMD Study)

The District has discussed re-evaluating existing fish versus river flow and salinity regressions using HBMP data collected since the original regressions were created five or more years ago. The District has recently initiated a new project to examine the applicability of using fish abundance and diversity to establish minimum flows and levels for southwest Florida coastal rivers. This study is meant to identify the strengths and weaknesses of the current approaches to establishing “fish-flow” relationships, identify confounding effects that may affect the relationships between fish and freshwater inflows, explore new techniques to identify effects of freshwater flows on fish populations, and identify new analytical tools.

This study will examine fish responses to changes in flow near the ranges typically observed during Tampa Bay Water operations. While the effects of changes in river flow on estuarine fish have been studied by a number of researchers, many of these efforts examined changes in flow much greater than those possible under the Tampa Bay Water operating regimes. Therefore, although not specifically performed for the HBMP, the results of this study may be important for re-evaluation of the HBMP fish and/or plankton sampling elements.

6.3.5. Habitat / Vegetation

Analysis of vegetation mapping data from Water Years 2003, 2006 and 2009 found very small changes in vegetation coverage. These changes could not be related to the relatively large natural changes in flow and salinity that occurred during this 6-year period. Changes in flow and salinity as a result of Tampa Bay Water operations are much smaller than those that occur as a result of natural variation in rainfall. If vegetation mapping cannot detect a change as a result of natural variations in flow, vegetation mapping is highly unlikely to be able to detect changes as a result of Tampa Bay Water operations. The next vegetation mapping event is not scheduled to occur until 2012, but the monitoring program may be better served by redirecting this effort towards additional direct measures of impact such as continuous water quality recorders. At a minimum, extending the vegetation mapping to a once per 6-year cycle is recommended.

7.0 HBMP Programmatic Criteria

As discussed in previous sections of this document, the overall purpose and scope of the HBMP extend beyond just data acquisition, analysis and reporting. The HBMP also incorporates programmatic criteria that have been included to ensure that the permitted withdrawals are consistent with District rules throughout the lifetime of the permits.

In the context of the HBMP, the term programmatic criteria refers to: 1) the criteria by which unacceptable environmental impacts are determined; and 2) the process by which appropriate management responses to detected conditions that constitute or could potentially lead to adverse environmental impact are determined and implemented. Important components of these criteria include established minimum flows and levels for lower Hillsborough River, Tampa Bypass Canal and Alafia River; specific HBMP objectives for each waterbody included as special conditions in WUPs for the Tampa Bypass Canal/Hillsborough River and Alafia River Water Supply Projects; and ongoing assessment of HBMP data to identify and evaluate any detected hydrobiological changes attributable to the permitted withdrawals, and appropriate management actions.

7.1. Background

In addition to other requirements, Water Use Permit (WUP) applicants must demonstrate that the proposed withdrawals meet the following Southwest Florida Water Management District (District or SWFWMD) conditions for issuance related to potential environmental impacts (40D-2.301, F.A.C.):

- (b) Will not cause quantity or quality changes that adversely impact the water resources, including both surface and groundwater*
- (c) Will not cause adverse environmental impacts to wetlands, lakes, streams, estuaries, fish and wildlife or other natural resources*
- (g) Will not significantly induce saline water intrusion.*


The District's Basis of Review for WUPs for withdrawals from natural streams (Section 4.2.c) also requires that the following specific performance standards be met:

- a. Flow rates shall not deviate from the normal rate and range of fluctuation to the extent that water quality, vegetation, and animal populations are adversely impacted in streams and estuaries.*
- b. Flow rates shall not be reduced from the existing level of flow to the extent that salinity distributions in tidal streams and estuaries are significantly altered as a result of withdrawals.*
- c. Flow rates shall not deviate from the normal rate and range of fluctuation to the extent that recreational use or aesthetic qualities of the water resource are adversely impacted.*

To provide ongoing reasonable assurance that District performance standards would be met, special conditions of the TBC/Hillsborough River and Alafia River project WUPs required the development and implementation of the HBMP as described in previous chapters of this document. General HBMP objectives are to collect data on the spatial and temporal

characteristics of environmental indicators including salinity regimes, water quality and biotic integrity (PBSJ, 2000).

Inherent in District rules is the recognition that surface water withdrawals are linked to potential changes in: 1) salinity patterns; 2) associated water quality constituents; and 3) biological communities. This potential linkage can be summarized conceptually as follows:

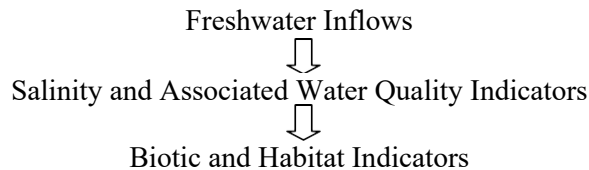

It should be noted, however, that while freshwater withdrawals may have a direct and instantaneous physical effect on salinity patterns, the effects of freshwater withdrawals on other water quality constituents and biological communities in particular, are typically indirect and complex. Such indirect impacts are mediated by physical and chemical changes or processes, and are typically manifested on longer time scales (e.g., days, months, seasons or years).

For example, a reduction in freshwater inflows may result in increased salinities within the geographic range of a population of a particular benthic organism; but if the changed salinity still remains within the salinity tolerance range of the organism, the abundance and distribution of the organism will likely not be affected. However, if that same change in salinity results in increased density stratification, which in turn leads to hypoxic conditions on the bottom, the abundance and distribution of the organism could be affected.

In addition to linkage between freshwater withdrawals and biological communities, the District performance standards also link adverse impact to:

- A significant deviation from natural or historic conditions
- A significant degradation of conditions necessary to support economically important activities such sport and commercial fishing, and water-dependent recreation and aesthetics.

7.2. Minimum Flows and Levels

At the time of initial HBMP development, limited standards or specific criteria were available for evaluating freshwater withdrawal-related changes to estuarine systems, or determining significant impacts to these systems. Since implementation of the HBMP in 2000, the District has developed and adopted Minimum Flows and Levels (MFLs) for the lower Hillsborough River, Tampa Bypass Canal and Alafia River as required by the Florida Legislature (SWFWMD 2004, 2006 and 2008). MFLs are based on technical evaluations that determine critical flows and the amount of water that can be withdrawn without causing unacceptable impacts to the ecology

of natural systems, recreational use or aesthetic qualities of these waterbodies (SWFWMD, 2008).

MFL documents prepared for each waterbody describe the purpose and background of the MFL, and provide descriptions of the physical and hydrologic characteristics of the waterbody and watershed, including river and spring flows, withdrawals, and river/channel morphology, sediments, and habitats. These documents also provide extensive analyses of freshwater inflows and relationships to important parameters and characteristics that were used to establish the MFLs, including:

- Tides and freshwater inflows and water levels and residence time, and results of hydrodynamic models developed for these estuarine systems
- Freshwater inflows and water quality constituents including salinity, dissolved oxygen, nutrients and chlorophyll-a
- Freshwater inflow and biological characteristics, including phytoplankton, benthic macroinvertebrates, mollusks, oysters, zooplankton and fishes.

MFL documents describe how these relationships were determined and used to examine the effects of reduced freshwater inflows on the hydrological and biological components of each system. For each system, baseline periods were identified and methods for evaluating flow reduction scenarios were selected. To determine minimum flow thresholds, resources of concern were identified along with appropriate identification of acceptable levels of change that do not result in unacceptable impacts to the ecology or other resources. Important considerations for the resources of concern included the following:

- Maintaining appropriate salinity zones for benthic macroinvertebrate communities, oysters, shoreline vegetation, and fish and invertebrates
- Minimizing the probability of hypoxia (dissolved oxygen concentrations <2.5 mg/L); specifically, examining the distribution and probability of low dissolved oxygen concentrations resulting from changes in flow
- Minimizing the probability of excessive chlorophyll-a concentrations, specifically examining the distribution and probability of high chlorophyll-a resulting from changes in flow.

Using the relationships between freshwater inflows and metrics for various resources of concern, the District identified water quality and biological resources of each waterbody that were particularly sensitive to flow reductions during periods of low flow. In addition to salinity changes during these periods, residence times typically increase in these waterbodies, potentially leading to large phytoplankton blooms, dissolved oxygen impacts and/or increases in abundance of non-desirable predators.

MFLs for the lower Hillsborough River, the Tampa Bypass Canal and the Alafia River were developed by the District based on the considerations described above over a multi-year process and have been adopted in District rules (40D-8, F.A.C.). Each of these is described briefly in the following sections.

7.2.1. TBC MFL

The Minimum Flow (MFL) for the Tampa Bypass Canal (TBC) was adopted in 2006. For the TBC, the District determined that establishment of an MFL was not appropriate due to designated flood control purpose and use of the TBC (SWFWMD, 2004), and an MFL of 0 cfs at Structure 160 was ultimately adopted. MFL analyses completed by the District evaluated relationships between flow and salinity, DO, and biota and concluded that no defensible technical basis exists for an MFL (SWFWMD, 2005). District technical analyses and conclusions for TBC MFL studies were confirmed by independent scientific per review (Powell et al., 2005).

In general, stratification is common in the TBC, but salinity was relatively insensitive to flow. Hypoxia was prevalent, but statistical analyses suggested that flow accounted for less than 50% of the variation in hypoxia. Overall, high flows in the TBC result in greater ecological effects than insufficient flows. High flows caused prolonged low salinity conditions, vertical stratification and hypoxia.

In addition to flood control and regional drinking water supply, the TBC is used to augment the Hillsborough River reservoir for the City of Tampa water supply and to meet requirements of the lower Hillsborough River MFL as discussed below.

7.2.2. Lower Hillsborough River MFL

The revised Minimum Flow (MFL) for the Lower Hillsborough River was established in November 2007. This MFL requires a 20 cfs (~13 mgd) flow at the base of the City of Tampa dam during the July 1 - March 31 time period and 24 cfs (~15.5 mgd) from April 1 - June 30, with an adjustment if there are lower than normal flows in the upper river.

In order to meet MFL requirements when water is not available to flow over the dam, a Recovery Strategy was adopted by the District along with the MFL identifying activities and milestones to be achieved in accordance with the time schedule specified (40D-80.073(8), F.A.C.). Sources of water to be used to meet the MFL include:

- Sulfur Springs discharge: 10 cfs (~6.46 mgd) to the base of the City of Tampa dam
- TBC pool: up to 7.1 mgd (~11 cfs) from the middle pool discharged to the Hillsborough River through S-161 and pumped to the base of the dam; up to 7.1 mgd from the middle pool to the dam through a pipeline to be constructed by 2013.
- Morris Bridge Sink Project: up to 3.9 mgd (~6.03 cfs) from Morris Bridge Sink to the TBC middle pool or 3.9 mgd from the TBC lower pool to the middle pool if available, then discharge to the Hillsborough River through S-161 and pumped to the base of the dam.

- The TBC middle pool and Morris Bridge Sink/TBC lower pool sources have specific operational and performance criteria identified as well as transmission pipeline construction components (40D-80.073(8), F.A.C.).

Additional potential MFL augmentation sources include Blue Sink based on cost/benefit and feasibility analyses to be completed, and other sources as identified in the future. Monitoring and evaluation for the MFL and Recovery Strategy are performed by the City of Tampa and the District with an annual implementation evaluation and report completed by the District.

The Lower Hillsborough River MFL was based on analyses presented in Lower Hillsborough River Low Flow Study Results and Minimum Flow Recommendation (SWFWMD, 2006). District technical analyses and conclusions for Lower Hillsborough River MFL studies were confirmed by independent scientific peer review (Montagna, et al., 2007).

The primary water quality and ecological condition affected by freshwater inflows at the base of the dam is salinity, although tides and other factors (e.g., stormwater, winds, and salinity in Tampa Bay) complicate this relationship. In addition to analyses of existing data and modeling, Lower Hillsborough River and related Sulphur Springs MFL studies included a series of experimental water releases conducted to evaluate the effect of changes in flow on water quality parameters. These studies concluded that the effect of flow changes (in the low flow range) on salinity generally decrease as a function of increasing distance from the dam and depth in the water column.

Principal components analysis (PCA) performed on biological sampling results identified four salinity ranges utilized by invertebrates. The findings for benthic macroinvertebrate community structure showed that a distinct group of these organisms occur in river habitats with salinity in the range of <5 ppt. However, there was a high degree of species overlap among adjacent salinity zones and few estuarine species were identified as requiring a single salinity zone. Because some invertebrate species are restricted to the lower salinity range, maintaining an essentially permanent area of the lower river with a salinity of <5 psu would provide habitat for those predominantly oligohaline and fresh water species, assuming other habitat requirements are also present.

The creation of a < 5 psu salinity zone was chosen as the principal ecological criterion on which to establish minimum flows for the LHR. Juvenile stages of important estuarine dependent fish species concentrate in oligohaline waters. Benefits (in terms of provision of low salinity habitat) accruing from fresh (or nearly fresh) water inputs at the dam are most pronounced near the dam, with the magnitude of the effect diminishing downstream. For a given discharge rate, the strongest effects are realized nearest the dam and decrease incrementally downstream.

7.2.3. Lower Alafia River MFL

The minimum flow (MFL) rule for the lower Alafia River was established in 2009. This MFL was defined as not more than a 19% reduction of daily flows with a low-flow threshold of 120

cfs. Similar to other MFLs in southwest Florida, the District used the percent-of-flow method for the Lower Alafia River to determine the amount of water that can be withdrawn without causing

unacceptable impacts to the ecology or other water resources (SWFWMD, 2008). District technical analyses and conclusions for Lower Alafia River MFL studies were confirmed by independent scientific peer review (Powell et al., 2008).

The Alafia River MFL document provides extensive analyses of freshwater inflows and relationships to important parameters and characteristics that were used to establish the MFL, including:

- Tides and freshwater inflows and water levels and residence time, including results of a hydrodynamic model developed for the lower river
- Freshwater inflows and water quality constituents including salinity, dissolved oxygen, nutrients, and chlorophyll-a
- Freshwater inflow and biological characteristics, specifically phytoplankton, benthic macroinvertebrates, mollusks, oysters, zooplankton, and fishes.

The MFL document describes how these relationships were determined and used to examine the effects of reduced freshwater inflows on the hydrological and biological components of the Lower Alafia River. First, a baseline period was identified and a method for developing flow reduction scenarios was selected. Second, resources of concern were identified along with appropriate identification of acceptable levels of change that do not result in unacceptable ecological impacts to habitat metrics.

The important considerations for the resources of concern included the following:

- Maintaining appropriate salinity zones for benthic macroinvertebrate communities, oysters, shoreline vegetation, and fish and invertebrates
- Minimizing the probability of hypoxia (dissolved oxygen concentrations <2.5 mg/L); specifically, the distribution and probability of low dissolved oxygen concentrations resulting from changes in flow
- Minimizing the probability of excessive chlorophyll-a concentrations; specifically, the distribution and probability of high chlorophyll-a resulting from changes in flow.

Using the relationships between freshwater inflows and the habitat metrics of the various resources of concern, the District found that the water quality and biological resources of the lower river were particularly sensitive to flow reductions during periods of low flow. During these periods, residence times increase within the lower river, potentially leading to large phytoplankton blooms and increases in abundance of non-desirable predators.

The effects of the MFL on metrics identified for the resources of concern were examined using hydrodynamic modeling and regression relationships between freshwater inflows and biological metrics. Regression models were used to predict changes in abundances of different life stages and size classes of fish and invertebrate species due to reduced freshwater inflows to the lower river. The results of these analyses indicated that the 19% reduction and the low-flow threshold would not result in unacceptable reductions in abundance, and most notably would not reduce the median abundance of juvenile red drum more than the 15% threshold identified.

Hydrodynamic modeling was used to examine changes in bottom areas of salinity zones important to benthic macroinvertebrates. Regression models were used to examine changes in surface isohalines that would affect wetland shorelines, and to predict shifts in geographic centers of abundance for key fish and invertebrate species. The combined results indicated that the minimum flows based on the abundance of key fish and invertebrate species would also prevent significant harm to the other resource characteristics. Logistic regression analyses were performed to predict the increased probability of low dissolved oxygen and high chlorophyll-a concentrations in response to reduced flows, indicating that the recommended minimum flows would not result in significant harm to the lower river, with only very small changes in probability of the occurrence of undesirable conditions.

7.3. WUP Requirements

To provide ongoing reasonable assurance that District performance standards would be met, special conditions of the TBC/Hillsborough River and Alafia River project WUPs required the development and implementation of the HBMP as described in previous chapters of this document. The general objectives of the HBMP are to collect data on the spatial and temporal characteristics of environmental indicators including salinity regimes, water quality and biotic integrity (PBSJ, 2000). Specific HBMP objectives related to ongoing compliance with District performance criteria are also provided in each WUP as listed in the following sections.

7.3.1. Tampa Bypass Canal Water Supply Project

Water Use Permit 20011796.002 for the Tampa Bypass Canal (TBC)/Hillsborough River Water Supply Project authorizes Tampa Bay Water to divert water from the Hillsborough River and withdraw water from Tampa Bypass Canal according to the schedule provided in the permit. This permit requires that Tampa Bay Water continue to implement the approved TBC/Hillsborough River HBMP in order to address the following objectives:

- Use baseline conditions to compare the effects of the permitted water use upon streamflow rates, salinity distributions, and selected water quality and biologic variables within the lower Hillsborough River below the Tampa Dam, TBC, Palm River and McKay Bay.
- Monitor diversions from the Hillsborough River and withdrawals from the TBC at the withdrawal points and evaluate streamflow data for the lower Hillsborough River at the Tampa Dam, and the TBC at the District's flood control Structures 160 and 162.

- Evaluate the ecological relationships of the lower Hillsborough River below the Tampa Dam, TBC, Palm River and McKay Bay to freshwater flows.
- Monitor selected water quality and biologic variables related to freshwater flow in order to determine if the ecological characteristics of the lower Hillsborough River below the Tampa Dam, TBC, Palm River and McKay Bay change over time.
- Determine the relative effect of permitted diversions and withdrawals on any ecologic changes that may occur in the lower Hillsborough River below the Tampa Dam, TBC, Palm River and McKay Bay.
- Determine if these withdrawals cause or significantly contribute to any unacceptable adverse environmental impacts to the natural resources of the lower Hillsborough River below the Tampa Dam, TBC, Palm River and McKay Bay due to changes in freshwater flows. The HBMP shall identify criteria that will be used to determine unacceptable adverse environmental impacts to the resources.
- Coordinate with appropriate agencies that have or are currently collecting data that can be incorporated into the HBMP to avoid duplication of effort and to facilitate the most efficient use of resources.

HBMP data collection activities that meet these objectives are described in Section 3.

7.3.2. Alafia River Water Supply Project

Water Use Permit 2011794.01 for the Alafia River authorizes Tampa Bay Water to withdraw water from the Alafia River at Bell Shoals Road according to the schedule provided in the permit. The original water use permit (Permit 2011794.00) required Tampa Bay Water to develop and implement an HBMP for the Alafia River. The permit specified that the HBMP address the following objectives:

- Establish baseline conditions prior to permitted use for streamflow rates, salinity distributions, and selected water quality and biological variables within the Alafia River and its estuary.
- Monitor withdrawals from the Alafia River at the withdrawal point and evaluate streamflow data for the river at all applicable locations.
- Evaluate the ecological relationships of the Alafia River and its estuary to freshwater flows.
- Monitor selected water quality and biological variables related to freshwater flow in order to determine if the ecological characteristics of the river and its estuary change over time.

- Determine the relative effect of permitted withdrawals from the Alafia River on any ecologic changes that may occur in the river and its estuary.
- Determine if these withdrawals cause or significantly contribute to any unacceptable environmental impacts that the river and its estuary exhibit as a result of changes in freshwater flows.
- Coordinate with appropriate agencies that have or are currently collecting data that can be incorporated into the HBMP to avoid duplication of effort and to facilitate the most efficient use of resources.

HBMP data collection activities to meet these objectives are described in Section 4.

7.4. HBMP Programmatic Criteria

Participants in the original HBMP design reached consensus that the HBMP would provide adequate data to detect potentially adverse hydrobiological changes in the HBMP reporting units. Participants also noted that the HBMP would need to determine if any observed hydrobiological changes were the result of natural variation or the permitted freshwater withdrawals. To address this need, it was concluded that HBMP data could also be used to support the enhancement of various predictive models that could be used to determine the incremental effects of the permitted withdrawals on any changes in freshwater inflows.

As required by specific conditions of the Water Use Permits, one of the goals of the HBMP design process was to identify criteria that will be used to determine unacceptable environmental impacts to the resources of concern. Given the above described considerations, the HBMP design group attempted to identify these criteria, as they specifically relate to the Tampa Bypass Canal and Alafia River Water Supply Projects. These criteria were described as follows:

A detected change, supported by statistical inference or a preponderance of evidence, from the pre-operational abundance, distribution, species composition, or species richness of biological communities of concern in the Lower Hillsborough River, Lower Palm River/TBC, McKay Bay, or Lower Alafia River reporting units that can be attributed to reductions in freshwater inflows caused by the permitted surface water withdrawals.

The above described criteria were recommended by the HBMP design group for use in determining what conditions might constitute an unacceptable environmental impact with respect to the permitted withdrawals. The HBMP design group noted that conditions meeting the above recommended criteria for unacceptable environmental impact could be detected, measured and described in many different ways. A few examples are discussed below:

- Significant dislocation of an ecologically significant species distribution - a "center of population" (either abundance or frequency) statistic has been used in the HBMP to

assess the distribution of adult and young fish, and benthos relative to river location. Other related measures of distribution dislocations may also be applicable for the HBMP.

- Elimination or reduced abundance of a "desirable" species - the elimination, or a significant reduction in the abundance, of a "desirable" (e.g., economically or ecologically important) species within a reporting unit would likely be considered an unacceptable environmental impact. Measures of species composition and abundance for critical biological indicators are included in the HBMP.
- Significant change in species richness or similar measure of community balance.
- Significantly increased abundance of an "undesirable" species that could consume or out-compete desirable species - the converse of the above described scenario. Measures of species composition and abundance for biological indicators are included in the HBMP. As introduced exotic or nuisance species often occur in ecosystems due to factors unrelated to stress caused by fresh water withdrawals, any significant increases in exotic or nuisance species would require additional evaluation.

Given the potentially infinite measures of unacceptable environmental impact, it was the general consensus of the HBMP design group that specific programmatic criteria or thresholds not be developed for every indicator. Rather, the HBMP design group recommended the application of a consensus-based process to evaluate whether unacceptable environmental impact has occurred, or is in the process of occurring (PBS&J, 2000).

The second HBMP interpretive analyses (PBS&J, 2006) summarized the assessment of unacceptable environmental impact as a series of ten progressive questions. These questions are:

1. What were the daily flows in each reporting unit during the study period, and how did these flows compare to the historical flow record?
2. What were the daily Tampa Bay Water withdrawals from each reporting unit during the study period, and how did these withdrawals affect daily flows?
3. What was the observed intra- and inter-annual variation in salinity in each reporting unit during the study period?
4. What portion of the observed intra- and inter-annual variation in salinity was attributable to Tampa Bay Water withdrawals?
5. How did observed changes in salinity attributable to changes in flow compare to the predicted salinity vs. flow relationships used during the WUP process?
6. What was the observed intra- and inter-annual variation in chlorophyll-a and dissolved oxygen in each reporting unit during the study period?

7. What portion of the observed intra- and inter-annual variation in chlorophyll-a and dissolved oxygen was attributable to Tampa Bay Water withdrawals?
8. What was the observed intra- and inter-annual variation in the species composition, abundance and spatial/temporal distribution of key biotic indicators in each reporting unit during the study period?
9. To what extent did variation in flow or flow-related variables (e.g., salinity) affect the intra- and inter-annual variation in the species composition, abundance and spatial/temporal distribution of key biotic indicators?
10. To what extent did the variation in flow or flow-related variables attributable to Tampa Bay Water withdrawals affect the intra- and inter-annual variation in the species composition, abundance and spatial/temporal distribution of key biotic indicators?

If observed changes in the intra- and inter-annual variation in the species composition, abundance and spatial/temporal distribution of key biotic indicators are identified as clearly attributable to Tampa Bay Water withdrawals, the next analytical step would be to determine if these changes constituted an unacceptable environmental impact.

7.5. HBMP Management Responses

The final step for reasonable assurance in meeting District standards involves the identification of appropriate management actions or remedial measures to be taken if adverse environmental impacts are detected, although no particular management actions are specifically identified. However, waiting until an adverse environmental impact has occurred to initiate appropriate management actions or remedial measures reduces the opportunity to adequately protect resources that may be at risk. Therefore, proactive resource management is needed to protect the resources of concern in the potentially affected water bodies.

The initial HBMP design included an appropriate sequence of management actions that should be initiated if conditions are observed that could potentially lead to, or are consistent with, the above described criteria for unacceptable environmental impact. The following management actions, listed sequentially in order of increasing intensity, are recommended for consideration under the HBMP:

- Data QA/QC Audit - This action would involve the performance of a concentrated QA/QC audit to determine if the detected change was the result of laboratory problems, data entry errors, violation of sampling protocols, etc.
- Data Comparison (Correlates) - This action would involve a review of data correlates (e.g., specific conductance is a correlate to salinity) to determine if there is more than one line of evidence reflecting the detected change.

- Determination of the magnitude and ecological importance of the detected change.
- Assessment of the degree of statistical certainty for an observed change to determine the likelihood that the observed change was due to chance alone (e.g., *alpha* error).
- Assessment based on combined results for magnitude of change and probability that the change is due to chance alone. If both the detected change and the degree of certainty are low, then a less intense management response would be appropriate including increased or directed sampling efforts. If the detected change is considered to be moderate or large and the degree of certainty is high (e.g., low *alpha*), then a more intense management response may be indicated. If the detected change is relatively large, but the degree of certainty is low (e.g., high *alpha*), then a less intense management response may be appropriate.
- HBMP Special Meeting - If the data review and comparison indicates that a detected change is not due to quality control problems and is reflected in multiple lines of evidence, the next step would involve convening a special HBMP meeting. The purpose of the meeting would be to discuss the data review and comparison findings with all HBMP participants to determine additional steps to refine the understanding of the magnitude and extent of the detected change. Additional data analyses or a redirected and focused sampling effort to better define the detected change would be recommended as appropriate.
- Redirected Sampling Effort - This action would involve conducting more focused supplemental sampling and/or additional studies (e.g., controlled withdrawal/flow experiments) in the affected reporting units with the objective of gaining a better understanding of the detected change. The additional data collected from this effort could then be subjected to previous steps as appropriate. This action would determine if detection of the change is repeatable under a more focused sampling program. Although this step could be valuable, it may not be necessary for a redirected sampling effort to be conducted for all hydrobiological changes detected by the HBMP.
- Modified Withdrawal Schedules - Modified freshwater withdrawal schedules could include provisional or temporary reductions in withdrawal rates, or modifications to the schedules such that greater withdrawals would occur during high flows, but lesser withdrawals would occur during low flows. Another alternative would be the development of an optimization schedule whereby the highest withdrawal rates would occur in the river source with the greatest harvestable flows at any given time. Given the regional need for additional water supplies, a permanent reduction in the total permitted withdrawal volumes would likely be viewed as the most intense response to detected adverse impact.

As noted, consideration and application of these recommended management actions would vary with the specific hydrobiological changes and statistical measures of certainty involved.

HBMP Programmatic Criteria

However, this approach meets the need for reasonable assurance as well as the overall objectives of the HBMP.

HBMP Programmatic Criteria

7-13

HBMP 2010 Update

Appendices

HBMP 2010 Update

APPENDIX A

Previously Authorized HBMP Design and Programmatic Modifications

Design of the Alafia River/Tampa Bypass Canal HBMP began in May 1999. The HBMP was designed in a series of workshops and subcommittee meetings attended by regulatory agency and local government representatives, and other stakeholders. A final HBMP design document was completed in late 1999 (PBS&J, 2000).

HBMP field sampling was initiated in April 2000, and continued implementation of the HBMP has been required under special conditions for the renewed and modified water use permits for these regional public water supply projects. The HBMP was intended to be routinely modified based on field conditions and the ongoing evaluation of HBMP data.

In the ten years since the acceptance of the final HBMP design by both the design group and the Tampa Bay Water Board, several minor modifications have been made to the HBMP. These modifications were in response to requests by the District and other stakeholders, logistical problems encountered during early implementation, and the sampling modifications identified based on evaluations of HBMP data.

Potential modifications to improve the monitoring program have been provided in HBMP annual and multi-year interpretative reports, and discussed at Annual HBMP Meetings. All modifications approved by the District through July 2010 and incorporated into the program are listed below.

1. Spatial Strata

Discontinued Sampling in Alafia River Stratum AR8

In 2000, Alafia River stratum AR8 was found to be inaccessible on nearly all tides. This portion of the river is also physically different than the lower river and would have required different benthic, fish, and plankton sampling methods than the lower river. As a result, stratum AR8 was deleted from the monitoring program with District approval after the first few months of program implementation. The sampling effort scheduled for AR8 was transferred to the other freshwater stratum (AR7), also with District approval.

2. Hydrology/Water Quality

Added Fixed-Location Water Quality Sample Stations

In Water Year 2001, three additional fixed-location water quality monitoring stations were added at the request of the District. One additional fixed-location water quality sampling station was added at the mouth of the Alafia River and one at the mouth of the Hillsborough River at existing EPCHC sampling sites. A third fixed station was added at the upstream side of the S160 dam. This station is only sampled when there is flow over S160. These stations were meant to describe upstream and downstream boundary inputs (by downstream flow or incoming tide) to the reporting units.

Discontinued Total Organic Carbon and Dissolved Organic Carbon

Total organic carbon and dissolved organic carbon sampling was discontinued in the Alafia River, TBC and McKay Bay at the end of Water Year 2004 (September 2004). There was consensus at the 2004 Annual Meeting to discontinue the sampling and analysis of TOC and DOC as part of the HBMP because the HBMP had generated a considerable amount of data for dissolved and total organic carbon in these systems and additional data was not necessary.

Discontinued Continuous Dissolved Oxygen Sensors

Dissolved oxygen (DO) probes on the Sligh Avenue and Columbus Avenue continuous recorder stations in the Hillsborough River reporting unit were deactivated during Water Year 2004. There was consensus at the 2004 Annual Meeting that DO measurements at these stations could be discontinued. This consensus was based on the belief that the data collected under long-term deployments of membrane-based, dissolved oxygen measurement equipment did not have the precision to detect the small changes predicted as a result of withdrawals.

3. Biota

Completed McKay Bay and TBC Oyster and Mollusk Surveys

Oyster and mollusk surveys were conducted in McKay Bay and the TBC as special studies completed in 2005 and 2008. These studies included a bathymetric and oyster bar survey (PBS&J, 2005), and mapped the distribution and assessed the health of oysters and other mollusks (Janicki Environmental, 2008).

Discontinued Avian Surveys near McKay, Added Avian Study near Alafia

There were significant variations in natural flow from 2000 to 2004 including some of the highest and lowest flow on record. However, there was no relationship between flow and bird observations collected during this period. Based on data collected from 2000 to 2004, HBMP annual meeting participants concluded that the ability to link changes in bird communities to flow and salinity changes associated with the surface water projects was tenuous at best. As a result, bird sampling in the ponds area was eliminated in Water Year 2005, and a redesigned Alafia area sampling was implemented.

Completed Avian Special Study at Alafia Banks

In Water Year 2005, surveys included quantification of foraging effort by select benthic feeding indicator species as part of an approved HBMP special study. No relationship between flow and bird populations were observed during this sampling, and all bird sampling in the Alafia Banks was discontinued at the end of Water Year 2008 with District approval. Since relationships between the large natural variations in Alafia River flow and bird populations could not be detected, it was determined that it would be difficult or impossible to detect variations in bird populations as a result of withdrawals.

Added Expanded Fish Sampling in Hillsborough Bay Adjacent to the Alafia River

The HBMP was designed to characterize baseline conditions, and detect hydrobiological changes, in the river estuaries of the Alafia, Hillsborough and Palm Rivers, and McKay Bay. Although Hillsborough Bay was a defined reporting unit in the HBMP, it was the consensus of the Focus Group that hydrobiological changes associated with the permitted withdrawals would first be detected in the rivers long before any potential cumulative impacts in Hillsborough Bay were realized. Therefore, the HBMP Focus Group did not recommend additional sampling of Hillsborough Bay. Rather, they concluded that data currently being routinely collected by others (e.g., EPCHC and FWRI) would likely be adequate to assess changes in water quality, benthos and fish communities in Hillsborough Bay.

At the 2004 Annual Meeting, FWRI staff pointed out that the FIM sampling effort was not intended to make annual inferences regarding fish population changes in Hillsborough Bay, and suggested that if it is desirable to make annual inferences regarding potential cumulative impacts on fish communities, the

sampling intensity of the FIM program would need to be increased. There was agreement among the meeting participants that the original assumptions regarding the initial detection of changes related to surface water withdrawals in the river estuaries still held true, but that the adequacy of sampling activities in Hillsborough Bay should be evaluated further. As a result of re-evaluating the adequacy of existing monitoring programs to address the issues of concern in Hillsborough Bay, additional fish sampling stations were added as a special study to the HBMP in Water Year 2005. The stations are located near the mouth of the Alafia River (referred to as the Alafia River Delta stratum).

After several years of data collection in the delta area, power analyses conducted by Janicki Environmental found that this sampling did not have sufficient power to detect a 25% change in community indices in the Alafia River Delta stratum. This sampling is divided into two spatial strata, an inner stratum at the mouth of the river, and an outer stratum more distant from the river. FWRI staff suggested that the power of this sampling could be improved by concentrating sampling in the inner stratum. This sampling program was redesigned to consist of seven samples per year, all of which are taken in the inner stratum. This recommendation was approved by the District and implemented at the beginning of Water Year 2009.

Redistributed Benthic and Fish Sampling Effort in the Alafia River, Hillsborough River, and Tampa Bypass Canal

Power analysis conducted by Janicki Environmental found that the relatively high number of catches with no organisms greatly reduced the analytical power of trawls in the upper Alafia River and Hillsborough River strata and the majority of the TBC. In order to address this issue, FWRI staff recommended that all fish trawl samples originally conducted in Alafia and Hillsborough Rivers strata 4 and 5 be shifted to downstream to strata 1, 2, and 3 (see Tables 3.7.1 and 4.7.1). FWRI staff believed shifting trawls to the downstream strata would improve the analytical power of sampling in the downstream strata. Seine sampling would remain unchanged and would still be conducted the upstream strata. This recommendation was approved by SWFWMD and implemented at the beginning of Water Year 2009.

The majority of the TBC is comprised of areas where large numbers of zero fish and benthic catches occur. As a result, fish sampling was stopped in the TBC beginning in Water Year 2009. Benthic sampling upstream of the US 41 bridge was stopped at the same time. The District believed that benthic habitat conditions in the short stretch of the TBC downstream of the US41 Bridge might be more indicative of McKay Bay than the TBC and requested that benthic sampling be continued below US41.

4. Habitat/Vegetation

Reduced Frequency of Alafia SAV Surveys

In October 2001, the District approved an additional program modification based on data collected during Water Year 2001. This modification changed the frequency of submerged aquatic vegetation surveys in the Alafia River from once per year to once every five years. This change was initiated after SAV was found in only one location (the mouth of a spring discharge) in the Alafia River during the first SAV sampling event. It was felt that annual monitoring was not warranted given the lack of SAV in baseline conditions.

Reduced Frequency of Vegetation Mapping

At the 2004 Annual Meeting, SWFWMD staff agreed that the required interval for vegetation polygon mapping could be lengthened and suggested that once every three years in concert with the submittal of

comprehensive interpretive reports would be appropriate. This change was initiated because no significant changes had been observed in the 2000, 2001, 2002, and 2003 mapping events even though there had been large natural variation in flow. The last mapping occurred in Water Year 2009. The next mapping is scheduled to occur in the Fall of Water Year 2012.

Discontinued Alafia Fixed-Station Vegetation Sampling

Fixed-station vegetation sampling on the Alafia River was discontinued at the end of Water Year 2008 with District approval. Analyses of data collected from 2001 to 2007 were unable to detect changes in vegetation as a result of the large variation of inter-annual flows during this period. As a result, it was unlikely that this monitoring could have detected changes as a result of Tampa Bay Water operations. This monitoring effort was confounded by the fact that vegetation in areas most likely to be influenced by salinity changes as a result of withdrawals consisted of narrow fringe marshes adjoining residential properties. These areas contained large amounts of invasive exotic and nuisance vegetation and were subject to many forms of disturbance aside from those that might be caused by Tampa Bay Water operations.

5. Reporting

Modified Interpretive Report Schedule/Frequency

The frequency of interpretive report submittals was discussed at the May 2003 HBMP Annual Meeting. Interpretive reports were originally required to be submitted every five years. This 5-year interval included a mid-term, interpretive report submitted in year 3 of each five-year evaluation period, and a comprehensive interpretive report submitted in year 5 of each five-year evaluation period. At the May 2003 Annual Meeting, Tampa Bay Water proposed that the interpretive report submittal schedule be modified such that comprehensive interpretive reports are submitted every three years. Each comprehensive interpretive report would summarize HBMP findings of the previous two years, as well as compare these findings to the HBMP and baseline periods of record. Representatives from the SWFWMD and other meeting participants agreed with this proposed schedule. The first HBMP Interpretive Report was submitted to the District on July 2003 and the second in July 2006. The HBMP reporting the Alafia River and other reporting units was split with the most recent TBC/Hillsborough water use permit. The TBC/Hillsborough interpretive reports are now submitted at five-year interval. The last report was submitted in 2010 and the next report is due in July 2015. The Alafia Interpretive Report remains on a three-year interval. The last report was submitted in 2009. Under the current schedule, the fourth Alafia Interpretive Report will be submitted in July 2012.

APPENDIX B HBMP and HBMP-Related Documents

HBMP Program Documents

PBS&J, 2008. TBC/Alafia River HBMP Quality Assurance Project Plan v2.1. Prepared for Tampa Bay Water, Clearwater, Florida.

PBS&J, 2002. TBC/Alafia River HBMP Quality Assurance Project Plan v1.1. Prepared for Tampa Bay Water, Clearwater, Florida.

PBS&J, 2000. TBC/Alafia River Water Supply Projects HBMP (Design Document) (September). Prepared for Tampa Bay Water, Clearwater, Florida.

SWFWMD Minimum Flows and Levels and Related Documents

Janicki Environmental, Inc., 2005. Alafia River EPCHC Salinity Regression Review. Prepared by Janicki Environmental for the Southwest Florida Water Management District

Janicki Environmental, Inc., 2005. Alafia River Isohaline Regression Models. Prepared by Janicki Environmental for the Southwest Florida Water Management District.

Janicki Environmental, Inc., 2005. Technical Memorandum: Tampa Bypass Canal/McKay Bay Regression Results. Prepared by Janicki Environmental for the Southwest Florida Water Management District.

Janicki Environmental, Inc., 2007. Development of Analytical Tools for Quantifying Minimum Flows in Southwest Florida Tidal Rivers Based Upon Benthic Macroinvertebrate Communities. Report prepared for the Southwest Florida Water Management District. Brooksville, Florida.

MacDonald, T.C., Peebles, E.B., M.F.D. Greenwood, R.D. Matheson, and R.H. McMichael, 2005. Freshwater inflow effects on fishes and invertebrates in the Hillsborough River estuary. Joint report of the Florida Fish and Wildlife Conservation Commission and the University of South Florida College of Marine Science submitted to the Southwest Florida Water Management District. Brooksville, Florida.

MacDonald, T.C., 2007. Written communication - Letter from the Florida Fish and Wildlife Conservation Commission to the Southwest Florida Water Management District regarding identification of hatchery-reared and wild juvenile red drum in the Lower Alafia River and revision of regressions to predict the abundance of juvenile red drum as a function of freshwater inflow.

Matheson, R.E., M.F.D. Greenwood, T.C. MacDonald, R.H. McMichael, 2005. Assessment of Relationships Between Freshwater Inflow and Populations of Fish and Selected Macroinvertebrates in the Lower Alafia River, Florida. Report prepared by the Florida Fish and Wildlife Research Institute for the Southwest Florida Water Management District. Brooksville, Florida.

Montagna, P., G.L. Powell and J.N. Boyer, 2007. Scientific Peer Review of the Lower Hillsborough River Low Flow Study Results and Minimum Flow Recommendation. Prepared for the Southwest Florida Water Management District, Brooksville, Florida.

Mote Marine Laboratory, 2003. An investigation of relationships between freshwater inflows and benthic macroinvertebrates in the Alafia River estuary. Report prepared by Mote Marine Laboratory for the Southwest Florida Water Management District, Brooksville, Florida.

Peebles, E.B., 2002. An Assessment of the Effects of Freshwater Inflows on Fish and Invertebrate Habitat Use in the Alafia River Estuary. Report prepared by the University of South Florida College of Marine Science for the Southwest Florida Water Management District. Brooksville, Florida.

Peebles, E.B., 2005. An Analysis of Freshwater Inflow Effects on the Early Stages of Fish and Their Invertebrate Prey in the Alafia River Estuary. Report prepared by the University of South Florida College of Marine Science for the Southwest Florida Water Management District. Brooksville, Florida.

Peebles, E.B., 2005. Review of Feeding Habits of Juvenile Estuarine-Dependent Fishes and Blue Crabs: Identification of Important Prey. Report prepared by the University of South Florida College of Marine Science for the Southwest Florida Water Management District. Brooksville, Florida

Powell, G.L., P.A. Montagna and R. Walton, 2005. Minimum Flows for the Tampa Bypass Canal, Tampa, Florida: Scientific Peer Review Report. Prepared for the Southwest Florida Water Management District, Brooksville, Florida.

Powell, G.L., M. Alber and B.H. Johnson, 2008. Review of Minimum Flows and Levels for the Lower Alafia River, Florida: Scientific Peer Review Report. Prepared for the Southwest Florida Water Management District, Brooksville, Florida.

Southwest Florida Water Management District, 2005. Minimum Flows for the Tampa Bypass Canal, Tampa, Fl. Prepared by the Southwest Florida Water Management District Ecologic Evaluation Section, Brooksville, Florida.

Southwest Florida Water Management District, 2006. Lower Hillsborough River Low Flow Study Results and Minimum Flow Recommendation. Prepared by the Southwest Florida Water Management District, Brooksville, Florida.

Southwest Florida Water Management District, 2008. The Determination of Minimum Flows for the Lower Alafia River Estuary. Prepared by the Southwest Florida Water Management District Ecologic Evaluation Section, Brooksville, Florida.

HBMP Interpretive and Related Reports

PBS&J, 2010. Summary of Existing Literature for the Lower Alafia River (draft in preparation). Prepared for Tampa Bay Water, Clearwater, Florida.

PBS&J, 2010. TBC/Hillsborough River HBMP Water Year 2010 Year 10 Interpretive Report (July). Prepared for Tampa Bay Water, Clearwater, Florida.

Janicki Environmental, Inc., 2009. Environmental Analysis and Assessment in Support of Tampa Bay Water's Water Use Permit Application for the Alafia River (September). Prepared for Tampa Bay Water, Clearwater, Florida.

PBS&J, 2009. Responses to SWFWMD Comments on Alafia River HBMP Water Year 2008 Year 9 Interpretive Report (August). Prepared for Tampa Bay Water, Clearwater, Florida.

PBS&J, 2009. Alafia River HBMP Water Year 2008 Year 9 Interpretive Report (July). Prepared for Tampa Bay Water, Clearwater, Florida.

Janicki Environmental, Inc., 2006. Tampa Bypass Canal Water Supply Project (Including Hillsborough River Water Source) Water Use Permit Modification: Volume II - Environmental Analysis Report (October). Prepared for Montgomery Watson Harza, Tampa, Florida.

PBS&J, 2006. TBC/Alafia River HBMP Water Year 2005 Year 6 Interpretive Report (July). Prepared for Tampa Bay Water, Clearwater, Florida. Prepared for Tampa Bay Water, Clearwater, Florida.

PBS&J, 2003. TBC/Alafia River Water Year 2002 Year 3 Interpretive Report (August) (includes Lithia and Buckhorn Springs interpolation). Prepared for Tampa Bay Water, Clearwater, Florida.

HBMP Hydrology/Water Quality

English, D.C., R.W. Kitsmiller, and E.B. Peebles, 2007. Bio-Optical Properties of the Tidal Alafia River; Comparisons with Bay Anchovy Distribution. Report prepared by the USF College of Marine Science for Tampa Bay Water (draft in preparation, March 2007).

Janicki Environmental, Inc., 2005. Empirical Analysis and Evaluation of the Potential Effects of Surface Water Withdrawals on Surface Water Elevations in the Alafia River. Prepared for Tampa Bay Water, Clearwater, Florida.

Janicki Environmental, Inc., 2008. Examining the Relationship between Freshwater Flows, Nutrient Loads, Chlorophyll a Concentrations and the Distribution of Benthic Macroinvertebrates in the Lower Alafia River. Prepared for Tampa Bay Water, Clearwater, Florida.

Janicki Environmental, Inc., 2009. Examining the Relationship between Freshwater Flows, Nutrient Loads, Chlorophyll a Concentrations and the Spatial and Temporal Distribution of Zooplankton in the Lower Alafia River (October). Prepared for Tampa Bay Water, Clearwater, Florida.

Pribble, R., et al., 2008. Temporal and Spatial Variability in Salinity in Three Tampa Bay Tributaries (draft). Prepared for Tampa Bay Water, Clearwater, Florida.

Wessel, M., et al., 2008. Relationships between Freshwater Flows, Nutrient Loading, Chlorophyll-a and benthic macroinvertebrates in the Alafia River (draft). Prepared for Tampa Bay Water, Clearwater, Florida.

HBMP Benthic Invertebrates

Grabe, S. et al., 2008. Benthos of the Alafia River Estuary (Tampa Bay, Florida, USA) During and After a Prolonged Period of Low Freshwater Inflow (manuscript submitted to Marine Environmental Research).

Janicki Environmental Inc., 2004. Development of a Benthic Salinity Index for Tampa Bay and Its Tributaries (February). Prepared for Tampa Bay Water, Clearwater, Florida.

Janicki Environmental Inc., 2009. Benthic Salinity Index for the Major Estuarine Tributaries of Hillsborough Bay (October, draft). Prepared for Tampa Bay Water, Clearwater, Florida.

Janicki Environmental, Inc., 2008. Comparison of taxonomic nomenclature used in analysis of Tampa Bay Water's HBMP benthic samples (August). Prepared for Tampa Bay Water, Clearwater, Florida.

Janicki Environmental, Inc., 2008. Examination of the Power of the HBMP Sampling Design to Detect Changes in Fish and Benthos Populations in the Alafia River, Lower Hillsborough River, McKay Bay and the Tampa Bypass Canal (September). Prepared for Tampa Bay Water, Clearwater, Florida.

Janicki Environmental, Inc., 2008. Review of laboratory protocols used in analysis of Tampa Bay Water's HBMP benthic samples (July). Prepared for Tampa Bay Water, Clearwater, Florida.

Janicki Environmental, Inc., 2008. Survey of Oysters and other Mollusks in McKay Bay & the Tampa Bypass Canal (September). Prepared for Tampa Bay Water, Clearwater, Florida.

Janicki Environmental, Inc., 2008. Technical Memorandum: Comparison of Hillsborough River Archived Benthos Sample Collection Dates to Corresponding River Flows (draft). Prepared for Tampa Bay Water, Clearwater, Florida.

Janicki Environmental, Inc., 2009. Technical Memorandum: HBMP Benthos Sampling Design Re-evaluation- May 2009 Workshop (September). Prepared for Tampa Bay Water, Clearwater, Florida.

PBS&J, 2005. McKay Bay Bathymetric and Oyster Bar Survey (March). Prepared for Tampa Bay Water, Clearwater, Florida.

HBMP Fish (Adult/Juvenile), Ichthyoplankton/Zooplankton, Birds

Janicki Environmental Inc., 2004. Extending the Tampa Bay Water HBMP Fish Sampling Effort into Hillsborough Bay, Tech Memorandum: Evaluation of Potential Monitoring Program Design Additions (December). Prepared for Tampa Bay Water, Clearwater, Florida.

Janicki Environmental Inc., 2004. Relationships between Freshwater Inflow and Fish Communities in the Lower Alafia River (May). Prepared for Tampa Bay Water, Clearwater, Florida.

Janicki Environmental, Inc., 2008. Examination of the Power of the HBMP Sampling Design to Detect Changes in Fish and Benthos Populations in the Alafia River, Lower Hillsborough River, McKay Bay and the Tampa Bypass Canal (September). Prepared for Tampa Bay Water, Clearwater, Florida.

Janicki Environmental, Inc., 2008. Examination of the Power of the HBMP Sampling Design to Detect Changes in Ichthyo- and Zooplankton Populations in the Alafia River, Lower Hillsborough River, McKay Bay and the Tampa Bypass Canal (October). Prepared for Tampa Bay Water, Clearwater, Florida.

Janicki Environmental, Inc., 2009. Examining the Relationship between Freshwater Flows, Nutrient Loads, Chlorophyll a Concentrations and the Spatial and Temporal Distribution of Zooplankton in the Lower Alafia River (October). Prepared for Tampa Bay Water, Clearwater, Florida.

PBS&J, 2008. Technical Memorandum: HBMP Special Study Bird Foraging and Benthic Prey (draft TM). Prepared for Tampa Bay Water, Clearwater, Florida.

Peebles, E.B., 2004. An Analysis of Fish and Invertebrate Data Related to the Establishment of Minimum Flows for the Tampa Bypass Canal. Report prepared by the University of South Florida College of Marine Science for the Southwest Florida Water Management District. Brooksville, Florida.

Wessel, M., 2008. Fish Community Response to Inflow Variations in Two Impounded and One Unimpounded Tidal Tributary to Tampa Bay, Florida (manuscript submitted to Environmental Indicators).

Exhibit D
Tampa Bay Water Alafia
Hydrologic Monitoring Sites

TBW ALAFIA HYDROLOGIC MONITORING SITES

PERMITTEE ID	LAT/LONG	WATER BODY	PARAMETER	FREQUENCY
AR-BS	275129/821614	Alafia at Bell Shoals	Stage	Continuous
AR-L	275209/821225	Alafia at Lithia	Stage/Streamflow	Continuous
BS	275329/821810	Buckhorn Springs	Spring Discharge	Weekly
LS	275150/821349	Lithia Springs	Spring Discharge	Weekly
LSM	275158/821351	Lithia Springs Major	Spring Discharge	Weekly

Notice of Rights**ADMINISTRATIVE HEARING**

1. You or any person whose substantial interests are or may be affected by the District's intended or proposed action may request an administrative hearing on that action by filing a written petition in accordance with Sections 120.569 and 120.57, Florida Statutes (F.S.), Uniform Rules of Procedure Chapter 28-106, Florida Administrative Code (F.A.C.) and District Rule 40D-1.1010, F.A.C. Unless otherwise provided by law, a petition for administrative hearing must be filed with (received by) the District within 21 days of receipt of written notice of agency action. "Written notice" means either actual written notice, or newspaper publication of notice, that the District has taken or intends to take agency action. "Receipt of written notice" is deemed to be the fifth day after the date on which actual notice is deposited in the United States mail, if notice is mailed to you, or the date that actual notice is issued, if sent to you by electronic mail or delivered to you, or the date that notice is published in a newspaper, for those persons to whom the District does not provide actual notice.
2. Pursuant to Subsection 373.427(2)(c), F.S., for notices of intended or proposed agency action on a consolidated application for an environmental resource permit and use of sovereignty submerged lands concurrently reviewed by the District, a petition for administrative hearing must be filed with (received by) the District within 14 days of receipt of written notice.
3. Pursuant to Rule 62-532.430, F.A.C., for notices of intent to deny a well construction permit, a petition for administrative hearing must be filed with (received by) the District within 30 days of receipt of written notice of intent to deny.
4. Any person who receives written notice of an agency decision and who fails to file a written request for a hearing within 21 days of receipt or other period as required by law waives the right to request a hearing on such matters.
5. Mediation pursuant to Section 120.573, F.S., to settle an administrative dispute regarding District intended or proposed action is not available prior to the filing of a petition for hearing.
6. A request or petition for administrative hearing must comply with the requirements set forth in Chapter 28.106, F.A.C. A request or petition for a hearing must: (1) explain how the substantial interests of each person requesting the hearing will be affected by the District's intended action or proposed action, (2) state all material facts disputed by the person requesting the hearing or state that there are no material facts in dispute, and (3) otherwise comply with Rules 28-106.201 and 28-106.301, F.A.C. Chapter 28-106, F.A.C. can be viewed at www.flrules.org or at the District's website at www.WaterMatters.org/permits/rules.
7. A petition for administrative hearing is deemed filed upon receipt of the complete petition by the District Agency Clerk at the District's Tampa Service Office during normal business hours, which are 8:00 a.m. to 5:00 p.m., Monday through Friday, excluding District holidays. Filings with the District Agency Clerk may be made by mail, hand-delivery or facsimile transfer (fax). The District does not accept petitions for administrative hearing by electronic mail. Mailed filings must be addressed to, and hand-delivered filings must be delivered to, the Agency Clerk, Southwest Florida Water Management District, 7601 Highway 301 North, Tampa, FL 33637-6759. Faxed filings must be transmitted to the District Agency Clerk at (813) 367-9776. Any petition not received during normal business hours shall be filed as of 8:00 a.m. on the next business day. The District's acceptance of faxed petitions for filing is subject to certain conditions set forth in the District's Statement of Agency Organization and Operation, available for viewing at www.WaterMatters.org/about.

JUDICIAL REVIEW

1. Pursuant to Sections 120.60(3) and 120.68, F.S., a party who is adversely affected by District action may seek judicial review of the District's action. Judicial review shall be sought in the Fifth District Court of Appeal or in the appellate district where a party resides or as otherwise provided by law.
2. All proceedings shall be instituted by filing an original notice of appeal with the District Agency Clerk within 30 days after the rendition of the order being appealed, and a copy of the notice of appeal, accompanied by any filing fees prescribed by law, with the clerk of the court, in accordance with Rules 9.110 and 9.190 of the Florida Rules of Appellate Procedure (Fla. R. App. P.). Pursuant to Fla. R. App. P. 9.020(h), an order is rendered when a signed written order is filed with the clerk of the lower tribunal.